



# Energy storage

Technology descriptions and projections for long-term energy system planning.



## Technology Data – Energy storage

ISBN 978-87-94447-11-9

First published 2018 by the Danish Energy Agency and Energinet

Current version published by:

Danish Energy Agency

Carsten Niebuhrs Gade 43

1577 Copenhagen

E-mail: [teknologikatalog@ens.dk](mailto:teknologikatalog@ens.dk),

Internet: <https://ens.dk/technologydata>

Design and production: Danish Energy Agency

Front cover photo: Adobe Stock

Version number: 0010

This work is licensed under [Attribution 4.0 International](https://creativecommons.org/licenses/by/4.0/) 

## Amendment sheet

### Publication date

Publication date for this catalogue “Technology Data for Energy Storage” is October 2018. This amendment sheet has been added and also the possibility to add descriptions of amendments in the individual chapters if required. Hereby the catalogue can be updated continuously as technologies evolve, if the data changes significantly or if errors are found.

The newest version of the catalogue will always be available from the Danish Energy Agency’s web site.

### Amendments after publication date

All updates made after the publication date will be listed in the amendment sheet below.

Date	Ref.	Description
May 2025	180, 181	Updated chapters and data for Lithium-ion Batteries for Grid-Scale Storage and Vanadium Redox Flow Battery
February 2025	140, 143	Updated chapter and data on Seasonal Heat Storage, now named Large thermal energy storage.  New chapter on Carnot batteries and high temperature thermal energy storage
April 2024	Guideline/cover	Updated guideline in terms of scenario projection reference, price year, and further minor updates / new cover
January 2020	151	New chapter on hydrogen storage. The chapter contains three sections on storage in steel containers, liquid organic hydrogen carriers (LOHC) and in underground salt caverns
December	180	Revised technology specific data for the LIB chapter regarding specific power and power density
October 2019	180	Revised financial data for the Lithium ion battery chapter, regarding PCM reinvestment and the power to capacity ratio.
August 2019	142	Updated chapter for small scale hot water storage tank
March 2019	180, 183	Minor corrections to the Lithium ion battery and the Na-NiCl <sub>2</sub> chapters
February 2019	180, Front page	Small corrections to the Lithium ion battery datasheet implemented.  Version number added to front page
January 2019	180	Lithium ion battery chapter added

<b>December 2018</b>	160, 180, 181, 182, 183	Formatting and internal references fixed in CAES chapter Added chapters on VRB-, Na-S- and Na-NiCl <sub>2</sub> batteries Previous battery chapter removed
<b>November 2018</b>	140 Seasonal Heat Storage, 141 Large-scale Hot Water Tanks, 161 CAES	Updated chapters on Seasonal Heat Storage and Large-scale Hot Water Tanks Updated chapter on CAES Small update to the Introduction and Electricity Storage chapters
<b>October 2018</b>	142 Small-scale Hot water tanks, 150 Underground storage of gas, 151 Hydrogen storage, 160 PHS, 161 CAES and 180 Batteries	Chapters transferred from previous Technology Data Catalogue for Electricity and district heating production from May 2012

## Preface

The *Danish Energy Agency* publishes catalogues containing data on technologies for Energy Storage. This is the first edition of the catalogue. This catalogue includes updates of a number of technologies which replace the corresponding chapters in the catalogue for Energy Plants published in May 2012. The catalogue will continuously be updated as technologies evolve, if data change significantly or if errors are found. All updates will be listed in the amendment sheet on the previous page and in connection with the relevant chapters, and it will always be possible to find the most recently updated version on the Danish Energy Agency's website.

The primary objective of publishing technology catalogues is to establish a uniform, commonly accepted and up-to-date basis for energy planning activities, such as future outlooks, evaluations of security of supply and environmental impacts, climate change evaluations, as well as technical and economic analyses, e.g. on the framework conditions for the development and deployment of certain classes of technologies.

With this scope in mind, it is not the target of the technology data catalogues, to provide an exhaustive collection of specifications on all available incarnations of energy technologies. Only selected, representative, technologies are included, to enable generic comparisons of technologies with similar functions in the energy system e.g. thermal gasification versus combustion of biomass or electricity storage in batteries versus fly wheels.

Finally, the catalogue is meant for international as well as Danish audiences in an attempt to support and contribute to similar initiatives aimed at forming a public and concerted knowledge base for international analyses and negotiations.

## Danish preface

Energistyrelsen udarbejder teknologibeskrivelser for en række energilagringsteknologier. Dette er den første udgave. Kataloget indeholder opdateringer af teknologier, som erstatter de tilsvarende kapitler i kataloget for el og fjernvarme, som blev udgivet i 2012. Kataloget vil løbende opdateres i takt med at teknologierne udvikler sig, hvis data ændrer sig væsentligt eller hvis der findes fejl. Alle opdateringer vil registreres i rettelsesbladet først i kataloget, og det vil altid være muligt at finde den seneste opdaterede version på Energistyrelsens hjemmeside.

Hovedformålet med teknologikataloget er at sikre et ensartet, alment accepteret og aktuelt grundlag for planlægningsarbejde og vurderinger af forsyningsikkerhed, beredskab, miljø og markedsudvikling hos bl.a. de systemansvarlige selskaber, universiteterne, rådgivere og Energistyrelsen. Dette omfatter for eksempel fremskrivninger, scenarieanalyser og teknisk-økonomiske analyser.

Desuden er teknologikataloget et nyttigt redskab til at vurdere udviklingsmulighederne for energisektorens mange teknologier til brug for tilrettelæggelsen af støtteprogrammer for energiforskning og -udvikling. Tilsvarende afspejler kataloget resultaterne af den energirelaterede forskning og udvikling. Også behovet for planlægning og vurdering af klima-projekter har aktualiseret nødvendigheden af et opdateret databeredskab.

Endeligt kan teknologikataloget anvendes i såvel nordisk som internationalt perspektiv. Det kan derudover bruges som et led i en systematisk international vidensopbygning og -udveksling, ligesom kataloget kan benyttes som dansk udspil til teknologiske forudsætninger for internationale analyser og forhandlinger. Af disse grunde er kataloget udarbejdet på engelsk.

## Table of contents

Guideline/Introduction .....	7
Electricity Storage .....	27
140 Seasonal Heat Storage .....	37
141 Large-scale Hot Water Tanks .....	56
142 Small-scale Hot Water Tanks .....	64
143 Carnot batteries and high temperature thermal energy storage .....	71
150 Underground Storage of Gas .....	86
151 Hydrogen Storage .....	90
160 Pumped Hydro Storage .....	138
161 Compressed Air Energy Storage .....	141
162 Flywheels .....	162
180 Lithium-ion Batteries for Grid-Scale Storage .....	179
181 Vanadium Redox Flow Battery .....	207
182 Na-S battery .....	223
183 Na-NiCl <sub>2</sub> batteries .....	239

---

## GUIDELINE/INTRODUCTION

This catalogue addresses technologies for energy storage. The focus is on the specific storage technology. Therefore, its interaction with the system and the combination with other technologies is not always considered. For example, hydrogen storage will be described as a gas storage system and not as a potential mean to store electricity. Each storage unit is defined by its energy carrier such that the boundary to the energy system is the input and output of this same energy carrier. For example, while a flywheel stores kinetic energy, it is in this catalogue for all intend and purposes defined as an electricity storage. Therefore, the conversion from electricity to kinetic energy and back again is included in the storage technology. Likewise, when defining the boundaries of an ATEs a heat pump is not included in the storage since ATEs is defined as a heat storage while the heat pump requires an external energy source - usually in the form of electricity or steam.

Each chapter contains the necessary qualitative description and quantitative data to complete the storage of the energy carrier. The exact system boundaries and energy carrier being stored is defined for each technology in the qualitative description.

The main purpose of the catalogue is to provide generalized data for analysis of energy systems, including economic scenario models and high-level energy planning.

These guidelines serve as an introduction to the presentations of the different technologies in the catalogue, and as instructions for the authors of the technology chapters. The general assumptions are described in section 1.1. The following sections (1.2 and 1.3) explain the formats of the technology chapters, how data were obtained, and which assumptions they are based on. Each technology is subsequently described in a separate technology chapter, making up the main part of this catalogue. The technology chapters contain both a description of the technologies and a quantitative part including a table with the most important technology data.

### General classification

Since there are different forms of energy stored and different possible applications of certain technologies, these are categorized as shown in the following table.

The possible forms of energy stored are electricity, heat or gas. The applications are divided into system or local level. While the former includes large scale technologies to provide system services, the latter refers to household level or other smaller size applications.

The table only lists the technologies included in the catalogue.

		Application	
		System level	Local level
Form of energy stored	Electricity	Flywheel (FES) Large Batteries (NaS, VRB, SoNick) Stationary lithium-ion batteries	Lead-acid batteries Flywheel (FES) Stationary lithium-ion batteries Electric car batteries
	Heat	Seasonal Heat storage – Water pits Aquifer thermal energy storage (ATES) Large Scale Hot Water tank	Small scale hot water tank
	Gas	Underground natural gas storage (caverns and aquifer) Hydrogen Storage above ground Hydrogen Storage in caverns	Compressed hydrogen storage

Technologies for electricity storage are further divided into power-intensive storage services and energy-intensive storage services. See section 1.4 for definitions.

The table below shows a categorization of electricity storage technologies.

Technology	Service provided	
	Power-intensive	Energy-intensive
Flywheel (FES)	✓	✓
Large Batteries (NaS, VRB, SoNick)	✓	✓
Lead-acid batteries		✓
Stationary lithium-ion batteries	✓	✓
Electric car batteries		✓

---

## 1.2. Qualitative description

The qualitative description covers the key characteristics of the technology as concise as possible. The following paragraphs are included where relevant for the technology.

### Contact information

Containing the following information:

- Contact information: Contact details in case the reader has clarifying questions to the technology chapters. This could be the Danish Energy Agency, Energinet.dk or the author of the technology chapters.
- Author: Entity/person responsible for preparing the technology chapters
- Reviewer: Entity/person responsible for reviewing the technology chapters.

### Brief technology description

Brief description for non-engineers of how the technology works and for which purpose. This includes the form of energy stored, any potential storage medium and the application of the technology, as mentioned in the table in the introduction. Moreover, the type of services that the storage technology can provide is expressed (e.g. storage for production plants, primary frequency regulation, load shifting, etc.)

The system boundaries are identified in this section. In cases where the conversion units are not parts of the system, examples of typical conversion technologies used with the storage unit are mentioned such as heat pumps for ATEs systems etc.

An illustration of the technology is included, showing the main components and working principles.

### Input/output

The form of energy input to be stored (electricity, hot water, natural gas etc.) and the output(s).

### Energy efficiency and losses

The energy conversion efficiency

- Charge/discharge efficiency
- Round-trip efficiency

and energy losses such as idle losses, self-discharge (batteries), heat loss, mechanical loss, etc.

### Regulation ability and other system services

Mainly relevant for electricity storage technologies, i.e. how fast can they start up and how quickly are they able to respond to demand changes (response time) or provide grid services. For electricity storage technologies, especially if suitable for power intensive application, the qualitative description includes the technology's capability for delivering the following power system services:

- Inertia
- Short circuit power
- Black start

- 
- Voltage control
  - Damping of system oscillations (PSS)

### Typical characteristics and capacities

The characteristics are stated for a single unit capable of providing the storage service needed. In the case of modular technologies such as batteries, the unit is represented by a typical size of battery installation, to provide the service described.

The typical characteristics expressed are:

- Energy storage capacity, in MWh: amount of energy that can be stored
- Input and output capacities, in MW: rate at which the energy can either charge or discharge
- Energy density and specific energy, in Wh/m<sup>3</sup> and Wh/kg respectively

Beside electricity, the units MW and MWh are used for heat and gas as well. While this is not in accordance with thermodynamic formalism, it makes comparisons easier and provides a more intuitive link between capacities, production and full load hours.

For some storage technologies, there is a certain amount of energy that has to be constantly kept in the storage unit to ensure low degradation or to maintain specific conditions (e.g. pressure, temperature).

For example, in electrical batteries there could be a lower bound for the state of charge (SOC) and for gas storage in caverns a certain amount of cushion gas is normally required. In such cases, only the “active storage capacity” is specified, meaning the amount of energy between maximum and minimum level. Information regarding the minimum required amount of energy stored is also explained here.

Ranges for the different parameters could be indicated here if the technology has various typical sizes.

### Typical storage period

Qualitative expression of how long the energy is typically stored in the unit, which is closely related to the application and the services provided. The storage period is typically in the range from hours or days to longer periods such as months or years.

### Space requirement

The space requirement for the installation of the storage technology is expressed in m<sup>2</sup> per MWh. The space requirements may for example be used to calculate the rent of land, which is not included in the financial cost, since this cost item depends on the specific location of the plant.

### Advantages/disadvantages

A description of specific advantages and disadvantages relative to equivalent technologies. Generic advantages are ignored; e.g. renewable energy technologies mitigating climate risks and enhance security of supply.

---

## Environment

Particular environmental characteristics are mentioned, for example special emissions or the main ecological footprints.

For water reservoirs, as well as for cavern gas storage, the methane leakage is specified.

For batteries the use of critical, toxic or regulated materials is specified.

## Research and development perspectives

This section lists the most important challenges to further development of the technology. Also, the potential for technological development in terms of costs and efficiency is mentioned and quantified if possible. Danish research and development perspectives are highlighted, where relevant.

## Examples of market standard technology

Recent full-scale commercial projects, which can be considered market standard, are mentioned, preferably with links. A description of what is meant by “market standard” is given in the introduction to the quantitative description section (Section 1.3). For technologies where no market standard has yet been established, reference is made to best available technology in R&D projects.

## Prediction of performance and costs

Cost reductions and improvements of performance can be expected for most technologies in the future. This section accounts for the assumptions underlying the cost and performance in the first technology year (base year) as well as the improvements assumed for the future years.

The specific technology is identified and classified in one of four categories of technological maturity, indicating the commercial and technological progress, and the assumptions for the projections are described in detail.

In formulating the section, the following background information is considered:

### *Data for the base year*

In case of technologies where market standards have been established, performance and cost data of recent installed versions of the technology in Denmark or the most similar countries in relation to the specific technology in Northern Europe are used for the base year estimates.

If consistent data are not available, or if no suitable market standard has yet emerged for new technologies, the base year costs may be estimated using an engineering based approach applying a decomposition of manufacturing and installation costs into raw materials, labor costs, financial costs, etc. International references such as the IEA, NREL etc. are preferred for such estimates.

### *Assumptions for projecting costs into future years*

According to the IEA:

---

*“Innovation theory describes technological innovation through two approaches: the technology-push model, in which new technologies evolve and push themselves into the marketplace; and the market-pull model, in which a market opportunity leads to investment in R&D and, eventually, to an innovation” [6].*

The level of “market-pull” is to a high degree dependent on the global climate and energy policies. Hence, in a future with strong climate policies, demand for e.g. renewable energy technologies will be higher, whereby innovation is expected to take place faster than in a situation with less ambitious policies. This is expected to lead to both more efficient technologies, as well as cost reductions due to economy of scale effects. Therefore, for technologies where large cost reductions are expected, it is important to account for assumptions about global future demand.

The **IEA’s Announced Pledges Scenario (APS)** is used as a central estimate for projections in the Technology Catalogue, whenever possible. The IEA describes the Announced Pledges Scenario in their 2022 version as follows:

*“The Announced Pledges Scenario introduced in 2021 aims to show to what extent the announced ambitions and targets, including the most recent ones, are on the path to deliver emissions reductions required to achieve net zero emissions by 2050. It includes all recent major national announcements as of September 2022 for 2030 targets and longer term net zero and other pledges, regardless of whether these have been anchored in implementing legislation or in updated NDCs. In the APS, countries fully implement their national targets to 2030 and 2050, and the outlook for exporters of fossil fuels and low emissions fuels like hydrogen is shaped by what full implementation means for global demand. [...] Non-policy assumptions, including population and economic growth, are the same as in the STEPS.”*

According to the IEA, the less ambitious **Stated Policies Scenario (STEPS)** *“provides a more conservative benchmark for the future, because it does not take it for granted that governments will reach all announced goals. Instead, it takes a more granular, sector-by-sector look at what has actually been put in place to reach these and other energy-related objectives, taking account not just of existing policies and measures but also of those that are under development. The STEPS explores where the energy system might go without a major additional steer from policy makers.”*

The STEPS Scenario may be used as an upper bound and to assess the expected development of technologies based on a frozen-policy approach. Previous versions of the Technology Catalogue before updating the guideline in april 2024 have used the outdated New Policies Scenario, relatively equivalent to the current STEPS, as a central framework for projections (and supplemented by other outdated scenarios of the IEA). This scenario corresponds to the frozen-policy approach that the Danish Energy Agency uses to project international fuel prices and CO<sub>2</sub>-prices and technologies may be assessed in that regard when suitable.

Technologies updated before this cutoff date and which do not contain any explicit methodological description within the chapter regarding alternative supplementary scenarios have been updated based in this previous methodology.

As a more ambitious projection, the **Net Zero Emissions by 2050 Scenario (NZE)** may be used as a lower bound for the technology development. According to the IEA, the NZE *“is a normative IEA scenario that shows a pathway for the global energy sector to achieve net zero CO<sub>2</sub> emissions by 2050, with advanced economies reaching net zero emissions in advance of others. This scenario also meets key energy-related United Nations Sustainable Development Goals (SDGs), in particular by achieving universal energy access by 2030 and major improvements in air quality. It is consistent with limiting the global temperature rise to 1.5 °C with no or limited temperature overshoot (with a 50% probability), in line with reductions assessed in the IPCC in its Sixth Assessment Report.”*

---

By using this approach, the quantitative data in the Technology Catalogue provides a sample space that is consistent with the IEA's Global Energy and Climate Model, encompassing relevant outcomes for policy assessments of technologies as well as technology developments in compliance with national targets, and international treaties.

#### *Learning curves and technological maturity*

Predicting the future costs of technologies may be done by applying a cost decomposition strategy, as mentioned above, decomposing the costs of the technology into categories such as labor, materials, etc. for which predictions already exist. Alternatively, the development could be predicted using learning curves. Learning curves express the idea that each time a unit of a particular technology is produced, learning accumulates, which leads to cheaper production of the next unit of that technology. The learning rates also take into account benefits from economy of scale and benefits related to using automated production processes at high production volumes.

The potential for improving technologies is linked to the level of technological maturity. The technologies are categorized within one of the following four levels of technological maturity.

Category 1. Technologies that are still in the *research and development phase*. The uncertainty related to price and performance today and in the future is highly significant (e.g. wave energy converters, solid oxide fuel cells).

Category 2. Technologies in the *pioneer phase*. The technology has been proven to work through demonstration facilities or semi-commercial plants. Due to the limited application, the price and performance is still attached with high uncertainty, since development and customization is still needed. The technology still has a significant development potential (e.g. gasification of biomass).

Category 3. *Commercial technologies with moderate deployment*. The price and performance of the technology today is well known. These technologies are deemed to have a certain development potential and therefore there is a considerable level of uncertainty related to future price and performance (e.g. offshore wind turbines)

Category 4. *Commercial technologies, with large deployment*. The price and performance of the technology today is well known and normally only incremental improvements would be expected. Therefore, the future price and performance may also be projected with a relatively high level of certainty. (e.g. coal power, gas turbine)

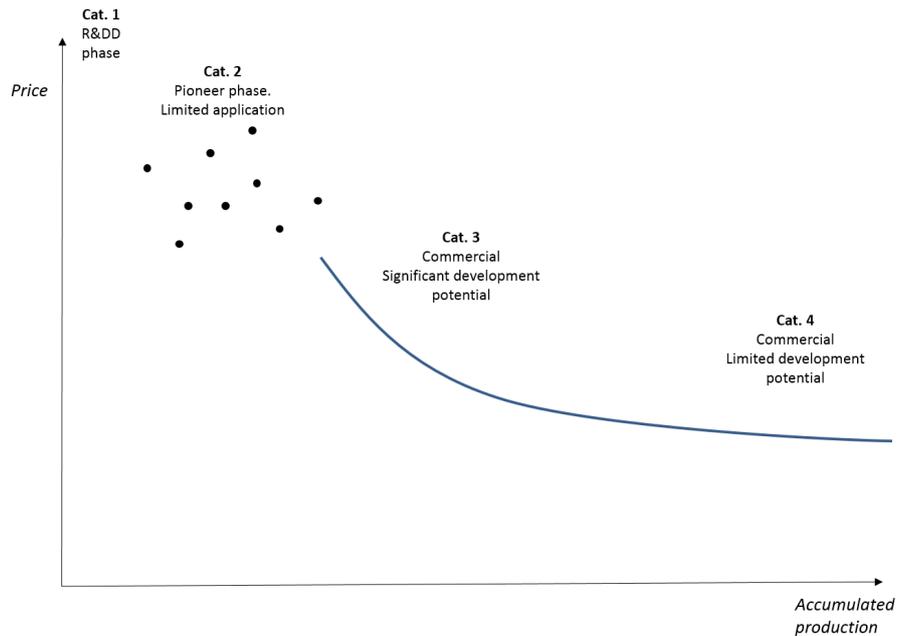


Figure 1: Technological development phases. Correlation between accumulated production volume (MW) and price.

### Uncertainty

The catalogue covers both mature technologies and technologies under development. This implies that the price and performance of some technologies may be estimated with a relatively high level of certainty whereas in the case of others, both cost and performance today as well as in the future are associated with high levels of uncertainty.

This section of the technology chapters explains the main challenges to precision of the data and identifies the areas on which the uncertainty ranges in the quantitative description are based. This includes technological or market related issues of the specific technology as well as the level of experience and knowledge in the sector and possible limitations on raw materials. The issues should also relate to the technological development maturity as discussed above.

The level of uncertainty is illustrated by providing a lower and higher bound beside the central estimate, which shall be interpreted as representing probabilities corresponding to a 90% confidence interval whenever possible. It should be noted, that projecting costs of technologies far into the future is a task associated with very large uncertainties. Thus, depending on the technological maturity expressed and the period considered, the confidence interval may be very large. It is the case, for example, of less developed technologies (category 1 and 2) and long time horizons (2050).

### Additional remarks

This section includes other information, for example links to web sites that describe the technology further or give key figures on it.

### References

References are numbered in the text in squared brackets and bibliographical details are listed in this section.

---

## Quantitative description

To enable comparative analyses between different technologies it is imperative that data are actually comparable: All cost data are stated in real prices excluding value added taxes (VAT) and other taxes. The information given in the tables relate to the development status of the technology at the point of final investment decision (FID) in the given year (2015, 2020, 2025, 2030, 2035, 2040 and 2050 where applicable). FID is assumed to be taken when financing of a project is secured and all permits are at hand. The year of commissioning will depend on the construction time of the individual technologies after permits have been received.

A typical table of quantitative data is shown below, containing all parameters used to describe the specific technologies. The table consists of a generic part, which is identical for all storage technologies and a technology specific part, containing information which is only relevant for the specific technology or the group of technologies (power, gas, heat storage). The generic part is made to allow for an easy comparison.

Each cell in the table contains only one number, which is the central estimate for the market standard technology, i.e. no range indications. Uncertainties related to the figures are stated in the columns named *uncertainty*. To keep the table simple, the level of uncertainty is only specified for the base year and final year.

The level of uncertainty is illustrated by providing a lower and higher bound. These are chosen to reflect the uncertainties of the best projections by the authors. The section on uncertainty in the qualitative description for each technology indicates the main issues influencing the uncertainty related to the specific technology. For technologies in the early stages of technological development or technologies especially prone to variations of cost and performance data, the bounds expressing the confidence interval could result in large intervals. The uncertainty is related to the market standard technology; in other words, the uncertainty interval does not represent the product range (for example a product with lower efficiency at a lower price or vice versa).

The level of uncertainty is stated for the most critical figures such as investment cost and efficiencies. Other figures are considered if relevant.

All data in the tables are referenced by a number in the utmost right column (Ref), referring to source specifics below the table. The following separators are used:

- ; (semicolon)            separation between the time horizons (2015, 2020, etc.)
- / (forward slash)        separation between sources with different data
- + (plus)                 agreement between sources on same data

Notes include additional information on how the data are obtained, as well as assumptions and potential calculations behind the figures presented. Before using the data, please be aware that essential information may be found in the notes below the table.

The generic parts of the tables for storage technologies are presented below:

Technology	name/ description									
	2020 <sup>1</sup>	2025 <sup>1</sup>	2030 <sup>1</sup>	2050 <sup>1</sup>	Uncertainty (2020 <sup>1</sup> )		Uncertainty (2050 <sup>1</sup> )		Note	Ref
Energy/technical data	Lower		Upper		Lower		Upper			
Form of energy stored										
Application										
Energy storage capacity for one unit (MWh)										
Output capacity for one unit (MW)										
Input capacity for one unit (MW)										
Round trip efficiency (%)										
- Charge efficiency (%)										
- Discharge efficiency (%)										
Energy losses during storage (%/period)										
Auxiliary electricity consumption (% of output) (Expressed only for heat and gas storages)										
Forced outage (%)										
Planned outage (weeks per year)										
Technical lifetime (years)										
Construction time (years)										
<b>Regulation ability</b> (only for electricity storage)										
Response time from idle to full-rated discharge (sec)										
Response time from full-rated charge to full-rated discharge (sec)										
<b>Financial data</b>										
Total investment cost (M€2020 per MWh)										
- energy component (M€/MWh)										
- capacity component (M€/MW)										
- other project costs (M€)										
Fixed O&M (% total investment)										
Variable O&M (€2020/MWh)										
<b>Technology specific data</b>										
Alternative Total investment cost (M€2020 per MW)										

<sup>1</sup>Technology years may be updated from this shown example and extended

---

## Energy/technical data

### Energy storage capacity for one unit

The storage capacity, preferably a typical capacity (not maximum capacity), represents the size of a standard unit in terms of energy stored. It refers to a single unit capable of providing the storage service needed, e.g. a hydro plant, a heat tank or a battery installation.

In the case of a modular technology such batteries, a typical size based on historical installations or the market standard is chosen as a unit. Different sizes may be specified in separate tables, e.g. small, medium, large battery installation.

As explained under “Typical characteristics”, the energy storage capacity refers only to the active part of the storage unit, i.e. the energy that can be used, and not to the rated storage capacity of the storage. Additional information on the minimum level of energy required is found in the notes.

The unit MWh is used for electricity, heat and gas energy storage capacity.

### Output and input capacity for one unit

The nominal output capacity is stated for a full unit and refers to the active part of the storage. Any other information regarding the minimum level is specified in the notes. It is given as net output capacity in continuous operation, i.e. gross output capacity minus own consumption.

The nominal input capacity is stated for a full unit as well. In case it is equal to the output capacity, the value specified will be the same.

The unit MW is used for all output and input capacities.

### Charge and discharge efficiencies (round trip efficiency)

The efficiencies of the charging and discharging processes are stated separately in percent where possible.

The round-trip efficiency is the product of charging and discharging efficiencies and expresses the fraction of the input energy, which can be recovered at the output, assuming no losses during the storage period. It represents the ratio between the energy provided to the user and the energy needed to charge the storage system.

For electricity storage, it is intended as AC-AC value, therefore including losses in the converters and other auxiliaries.

The round-trip efficiency enables comparisons of different storage technologies with respect to efficiency of the storage process. However, not including the losses during the storage period, it does not give a complete picture. Losses are treated below.

### Energy losses during storage

The energy lost from the storage unit due to losses in a specific time horizon is specified here.

Technologies with different storage periods will show very different behaviour with respect to energy losses. Therefore, the period is chosen based on the characteristics of the technology (e.g. % losses/hour, % losses/day or % losses/year).

---

Losses are expressed as a percentage of the energy storage capacity (as defined above) lost over the timeframe chosen.

### **Auxiliary electricity consumption**

Storage systems for heat and gas usually need auxiliary systems to operate, such as pumps and/or compressor. The auxiliary consumption expresses the consumption of electricity from such equipment as a percentage of output, which has gone through the full storage cycle.

For electricity storage, this component is already included in the overall round trip efficiency (AC-AC).

### **Forced and planned outage**

Forced outage is defined as the number of weighted forced outage hours divided by the sum of forced outage hours and operation hours. The weighted forced outage hours are the sum of hours of reduced production caused by unplanned outages, weighted according to how much capacity was out.

Forced outage is given in percent, while planned outage (for example due to renovations) is given in days per year.

### **Technical lifetime**

The technical lifetime is the expected time for which the storage facility can be operated within, or acceptably close to, its original performance specifications, provided that normal operation and maintenance takes place. During this lifetime, some performance parameters may degrade gradually but still stay within acceptable limits. For instance, efficiencies often decrease slightly (few percent) over the years, and O&M costs increase due to wear and degradation of components and systems. At the end of the technical lifetime, the frequency of unforeseen operational problems and risk of breakdowns is expected to lead to unacceptably low availability and/or high O&M costs. At this time, the plant is decommissioned or undergoes a lifetime extension, which implies a major renovation of components and systems as required making the storage unit suitable for a new period of operation.

The technical lifetime stated in this catalogue is a theoretical value inherent to each technology, based on experience. The expected technical lifetime takes into account a typical number of start-ups and shut-downs.

In real life, specific storage facilities of similar technology may operate for shorter or longer times. The strategy for operation and maintenance, e.g. the number of operation hours, start-ups, and the reinvestments made over the years, will largely influence the actual lifetime.

The lifetime is expressed in years for all the storage technologies. For electrical batteries it is expressed both in years and in number of cycles, since different utilization of the battery in terms of frequency of charge/discharge depth has an impact on its lifetime. This second figure is specified in the Technology Specific Data.

To calculate the technical lifetime in years for batteries based on the total number of cycles, a certain number of cycles per year has been assumed and is expressed in the notes.

### **Construction time**

Time from final investment decision (FID) until commissioning completed (start of commercial operation), expressed in years.

---

## Regulation ability

The regulation ability parameters are expressed for electricity storage application, while for heat and gas storage these parameters are not relevant.

The electricity regulation capabilities of the technologies are described by two parameters:

- Response time from idle to full-rated discharge (sec)
- Response time from full-rated charge to full-rated discharge (sec)

The response time from idle to full-rated discharge is defined as the time, in seconds, the electricity storage takes to reach 100% of the discharge capacity from idle condition. It is assumed to be equal for the charging process.

The response time from full-rated charge to full-rated discharge is defined as the time, in seconds, the electricity storage takes to go from charging at full capacity to discharging at full capacity. It is assumed to be equal in the other direction.

## Financial data

Financial data are all in Euro (€), real prices, at the 2020-level and exclude value added taxes (VAT) and other taxes. For updates before 2020, prices were given at the 2015-level.

Several data originate in Danish references. For those data a fixed exchange ratio of 7.45 DKK per € has been used.

The first catalogue was in 2011 prices. Some data had been updated by applying the general inflation rate in Denmark (2011 prices have been multiplied by 1.0585 to reach the 2015 price level).

Similarly, real 2015 prices were multiplied by 1.0634 to update them to 2020 prices.

European data, with a particular focus on Danish sources have been emphasized in developing this catalogue. This is done as generalizations of costs of energy technologies have been found to be impossible above the regional or local levels, as per IEA reporting from 2020 [8]. For renewable energy technologies this effect is even stronger as the costs are widely determined by local conditions.

---

## Investment cost

The investment cost is also called the engineering, procurement and construction (EPC) price or the overnight cost. Infrastructure and connection costs, i.e. electricity, fuel and water connections inside the premises of a plant, are also included.

The rent of land is not included but may be assessed based on the space requirements, if specified in the qualitative description.

The owners' predevelopment costs (administration, consultancy, project management, site preparation, approvals by authorities) and interest during construction are not included. The costs to dismantle decommissioned plants are also not included. Decommissioning costs may be offset by the residual value of the assets.

The total investment cost is reported on a normalized basis, i.e. cost per MWh of storage capacity. It is the total investment cost divided by the energy storage capacity for one unit, stated in the table.

For most of the storage technologies it is possible to identify three main cost components: an *energy* component, a *capacity* component and other fixed costs. Where possible, total investment costs is divided into these components. Cost may be disaggregated in a more detailed cost breakdown if it improves readability or understanding of the given technology.

The cost of energy component includes all the cost related to the equipment to store the energy, which you would incur in case you want to expand the MWh rating of the system, for example battery modules, reservoirs in a pumped-hydro plant or heat tank. The cost of capacity component refers to the part of equipment which condition or convert the energy carrier and make it available to the user or the grid, for example converter and grid connection for a battery system, turbine/pump and grid connection for pumped-hydro plant and heat exchanger and piping for a heat storage. This is the cost you would incur if you would increase the MW capability of the system. Finally, another cost component reflects the fixed costs related to the project, such as data management and control system, project engineering, other civil works, commissioning.

Summarizing, the components considered are the following:

- *Cost of Energy component* ( $C_E$ ) [M€/MWh]: cost related to the equipment to store the energy (incl. their installation);
- *Cost of Capacity component* ( $C_P$ ) [M€/MW]: cost related to the equipment to condition or convert the energy carrier and make it available to the user or the grid (incl. their installation);
- *Other project costs* ( $C_{other}$ ) [M€]: includes fixed costs which do not scale with capacity or energy, such as those for data management and control system, project engineering, civil works, buildings, site preparation, commissioning.

In this catalogue, the **Total investment cost** is expressed in relative terms, in M€/MWh, by dividing the Total Capital Expenditure by the *Energy storage capacity for one unit* in MWh.

---


$$\text{Total Capital Expenditure} = C_E * E_{SC} + C_P * P_{out} + C_{other} \quad [M\text{€}]$$

$$\text{Total investment cost} = \frac{\text{Total Capital Expenditure}}{E_{SC}} = C_E + \frac{C_P}{h} + \frac{C_{other}}{E_{SC}} \quad [M\text{€}/MWh]$$

where:

$E_{SC}$  = Energy Storage Capacity for one unit [MWh]

$P_{out}$  = Output capacity for one unit [MW]

$h = \frac{E_{SC}}{P_{out}}$  = unload hours [h]

For electricity storage applications with a power-intensive service, an alternative Total investment cost in M€/MW is indicated in the Technology specific data, calculated by dividing the Total Capital Expenditure by the *Output capacity for one unit* ( $\text{Total Capital Expenditure}/P_{out}$ ).

#### *Cost of grid expansion*

The costs for the connection of the storage unit to the system are included in the investment cost (shallow costs), while no cost of grid expansion or reinforcement is taken into account in the presented data (deep costs).

#### *Business cycles*

Historic costs of energy equipment can show fluctuations that are related to business cycles. This was the case of the period 2007-2008 for example or more recently around 2021-2022, where prices costs of many energy generation technologies increased dramatically driven by rapid increases in global raw material costs and supply chain costs. The primary objective of the technology catalogues is to establish general representative techno-economic data for different technologies, which can form a basis for energy planning activities and technical and economic analyses. The catalogues do not attempt to reflect fluctuations in technology costs due to fluctuations in costs of labour and materials driven by e.g. global/regional crises or major events affecting short term supply or demand. The technology cost developments in the catalogues thus intend to reflect an average business cycle situation and macroeconomic environment in a general long-term equilibrium.

#### *Economy of scale*

A typical size of the storage unit is stated in the technology description and data-sheet. No economy of scale or scaling rule is considered in this catalogue. Instead, the cost components for energy and capacity are specified for the technologies. It is intended to be used in a limited range around the typical capacity and not, for example, for doubling the capacity.

---

In case a technology has a modular nature and could be scaled across different sizes, this will be specified in the specific technology chapter.

### Contingency

Project owners often add a contingency to a project's capital cost estimate to deal with project overruns due to uncertainties and risks caused by uncertainties in the project definition. The Association for the Advancement of Cost Engineering International (AACE International) has defined contingency as *"An amount added to an estimate to allow for items, conditions, or events for which the state, occurrence, or effect is uncertain and that experience shows will likely result, in aggregate, in additional costs. Typically estimated using statistical analysis or judgment based on past asset or project experience."* AACE International further describes contingency as *"...planning and estimating errors and omissions.....design developments and changes within the scope, and variations in market and environmental conditions"*. The Technology Catalogues represent general techno-economic data for different technologies; and are not intended as basis for investment decisions. Therefore the data in the Technology Catalogues aim at not including contingency.

\*Source: AACE (2022) Cost engineering terminology (<https://library.aacei.org/terminology/welcome.shtml>).

### Operation and maintenance (O&M) costs

The fixed share of O&M can be expressed in two different ways.

1. The fixed share of O&M can be expressed in terms of percentage (%) of the Total investment cost, as defined in the previous paragraph and stated in the tables
2. The fixed share of O&M is calculated as cost per energy storage capacity for one unit per year (€/MWh/year), where the energy storage capacity is the one defined at the beginning of this chapter and stated in the tables

It includes all costs which are independent of how the storage system is operated, e.g. administration, operational staff, payments for O&M service agreements, network or system charges, property tax, and insurance. Any necessary reinvestments to keep the unit operating within the technical lifetime are also included, whereas reinvestments to extend the life are excluded. Reinvestments are discounted at 4 % annual discount rate in real terms. The cost of reinvestments to extend the lifetime of the storage unit may be mentioned in a note if the data are available.

The variable O&M costs (€/MWh) are calculated as costs per MWh of energy effectively released by the storage. They include consumption of auxiliary materials (water, lubricants, fuel additives), treatment and disposal of residuals, output related repair and maintenance, and spare parts (however not costs covered by guarantees and insurances).

Auxiliary electricity consumption is included for heat and gas storage technologies. The electricity price applied is specified in the notes for each technology, together with the share of O&M costs due to electricity consumption. This enables corrections from the users with own electricity price figures. The electricity price does not include taxes and PSO.

For electricity storage technologies, auxiliary electricity consumption is included in the round-trip efficiency instead.

Planned and unplanned maintenance costs may fall under fixed costs (e.g. scheduled yearly maintenance works) or variable costs (e.g. works depending on actual operating time), and are split accordingly.

It should be noticed that O&M costs often develop over time. The stated O&M costs are therefore average costs during the entire lifetime.

### Technology specific data

Additional data is specified in this section, depending on the form of energy stored.

In heat and gas storage systems the volume (m<sup>3</sup>) and pressure (bar) is specified. For heat applications, the storage temperature sets are indicated as well (°C).

For heat storage units, energy density (Wh/m<sup>3</sup>) at relevant temperatures is expressed, for example 80/40°C, 60/35°C and 20/5°C (ATES).

Energy density for gas storage systems is indicated in Wh/Nm<sup>3</sup>.

For electricity storage technologies (batteries in particular) the power density (W/m<sup>3</sup>) and energy density (Wh/m<sup>3</sup>) are stated, as well as the specific energy (Wh/kg) and specific power (W/kg).

For power intensive-applications, the total investment cost per MW is also stated, as an alternative figure to the total investment in €/MWh (see Financial data paragraph above for clarification).

Moreover, for technologies where it is relevant, such as pumped hydro and cavern gas storage, the leakage of methane is shown in m<sup>3</sup> per year.

The following table summarizes the technology specific data for each of the categories:

Technology specific data		
Electricity	Heat	Gas
Alternative Total investment cost (M€/MW) for power-intensive applications	-	-
-	Volume (m <sup>3</sup> )	Volume (m <sup>3</sup> )
-	Pressure (bar)	Pressure (bar)
	Temperature sets (°C)	
Lifetime in total number of cycles		
Specific power (W/kg)	-	-
Power density (W/m <sup>3</sup> )	-	-

---

Specific energy (Wh/kg)	-	-
Energy density (Wh/m <sup>3</sup> )	Energy density (Wh/m <sup>3</sup> )	Energy density (Wh/Nm <sup>3</sup> )
Water leakage (m <sup>3</sup> /year) for pumped hydro	-	Methane leakage (m <sup>3</sup> /year) for gas storage in cavern.

---

## Definitions

Based on the service provided, electricity storage technologies can be divided into two main categories: power-intensive and energy-intensive.

**Power-intensive applications** are required to provide ancillary services to the electricity system in maintaining the balance of frequency and voltage or providing power quality. Power intensive applications do this by delivering large amounts of power for time periods on the scale of seconds or minutes, and thus, they are characterized by a high ratio of power to energy (short discharge times) and fast response.

**Energy-intensive applications** are used for storing large amounts of energy in order to match demand and supply, perform load leveling or reducing congestion in the network. These technologies are characterized by a lower ratio of power to energy (long discharge times) and used on an hourly to seasonal scale.

The distinction between technologies providing power or energy intensive services is not always clear and neat. Some technologies, such as pumped-hydro or Li-ion batteries, can provide both services.

---

## References

- [1] Danish Energy Agency: "Forudsætninger for samfundsøkonomiske analyser på energiområdet" (Generic data to be used for socio-economic analyses in the energy sector), May 2009.
- [2] "Technology Data for Hydrogen Technologies", EUDP Project, 2015.
- [3] "Strategy for Storage and Distribution of Energy", The Danish Partnership for Hydrogen and Fuel Cells, June 2015.
- [4] "Thermal Energy Storage. Technology Brief", IEA-ETSAP and IRENA, January 2013.
- [5] "Electricity Storage. Technology Brief", IEA-ETSAP and IRENA, April 2012.
- [6] "Energy Technology Perspectives", International Energy Agency, 2012.
- [7] International Energy Agency. Available at: <http://www.iea.org/>. Accessed: 11/03/2016.
- [8] "Projected Costs of Generating Electricity", International Energy Agency, 2020.
- [9] "Konvergensprogram Danmark 2015". Social- og Indenrigsministeriet. March 2015.

---

## ELECTRICITY STORAGE

Electricity storage is a key technology to enable the next phase of the energy transition, driven by the large-scale deployment of variable renewable energy sources (VRES) like solar and wind power. The technologies presented in this chapter will help to cope with the integration challenges arising from intermittent generation sources: the needs to both ensure the balance of production and consumption in real time maintaining the quality of supply and to store excess electricity over different time horizons (minutes, days, weeks).

In 2017, it is estimated that 4.67 TWh of electricity storage exists, 96% of which in form of pumped-hydro storage. The total amount of electricity storage worldwide is set to triple from 2017 to 2030, with a foreseeable reduction of the share of pumped-hydro, in favor of battery energy storage (BES) systems, which capacity is set to increase 17-fold driven by growth of utility scale and local behind-the-meter applications [1].

While electrical energy storage systems are identified by the fact that they can be utilized to exchange power (the energy carrier) with the grid, different types of them can be identified, depending on the energy form ultimately stored. They are illustrated in Figure 1:

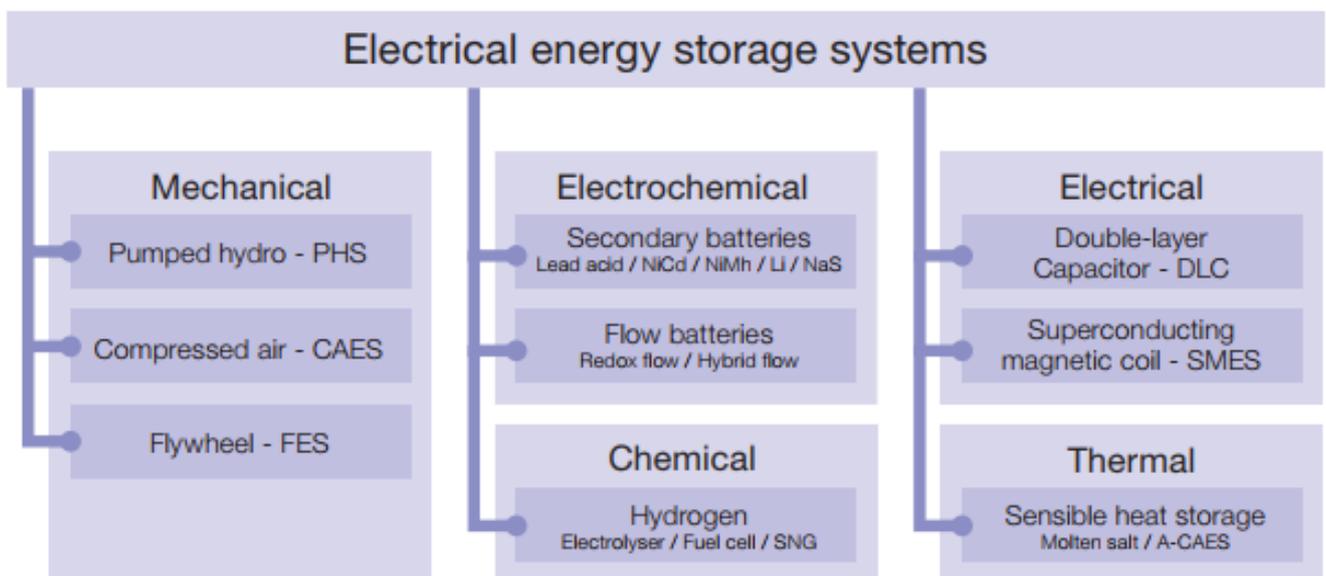


Figure 1 Classification of electrical energy storage systems according to energy form. Source [2]

## Electricity storage characteristics and services

The services electricity storage can provide are various and are inherently related to the physical characteristics of the storage media and the storage system. One way to categorize the different storage systems and the potential service they can provide is by looking at their power rating and the discharge time at rated power. Figure 2 shows how different types of storage classify with respect to these two variables.

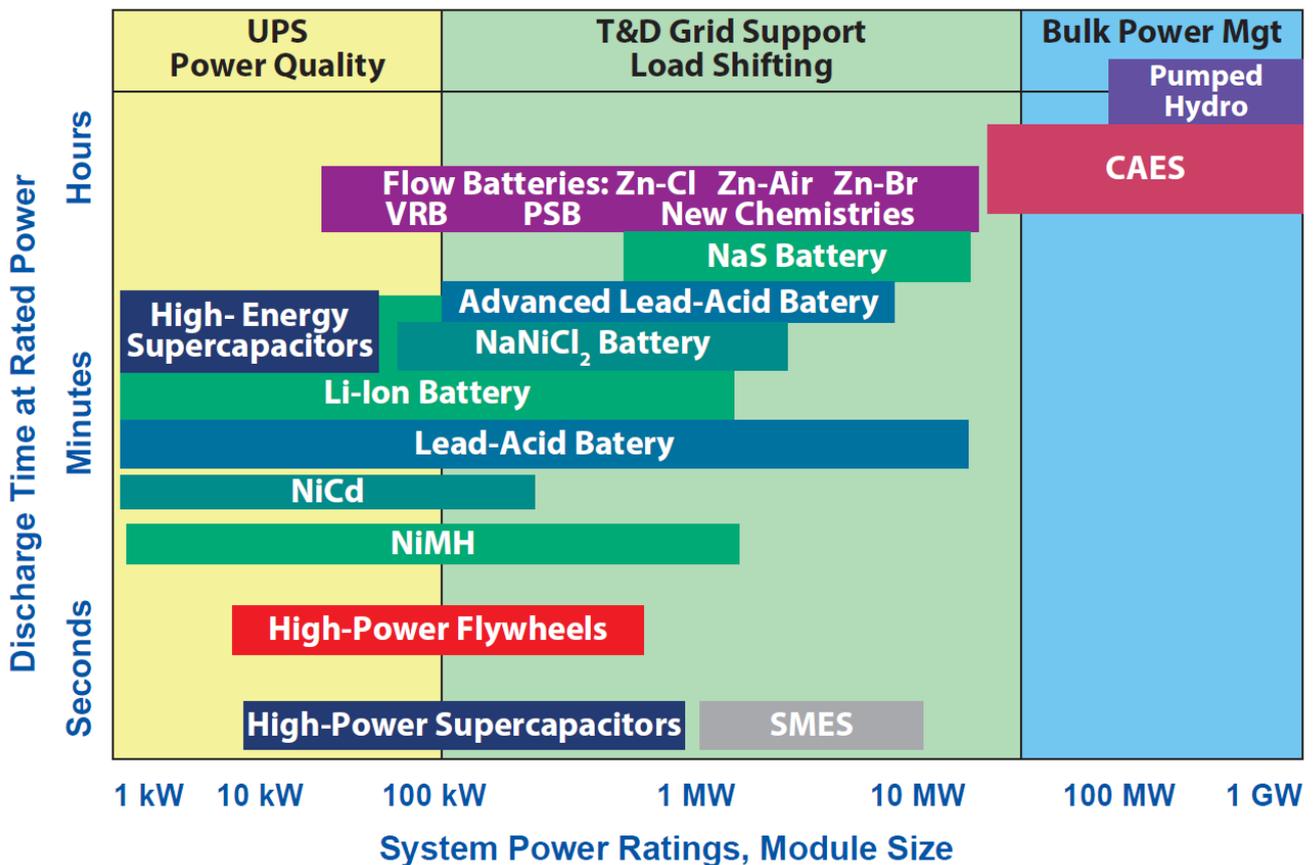


Figure 2. System power rating versus discharge time at rated power for different storage technologies [1].

Based on their characteristics and positioning in Figure, electricity storage technologies can be divided into two main categories: power-intensive and energy-intensive.

**Power-intensive applications** are required to provide ancillary services to the system in maintaining the balance of frequency and voltage or providing power quality. Power intensive applications do this by delivering large amounts of power for time periods on the scale of seconds or minutes, and thus, they are characterized by a high ratio of power to energy (short discharge times) and fast response.

**Energy-intensive applications** are used for storing large amounts of energy in order to match demand and supply, perform load leveling or reducing congestion in the network. These technologies are characterized by a lower ratio of power to energy (long discharge times) and used on an hourly to seasonal scale.

---

The potential applications for electricity storage across the entire value chain are various. Some of these applications refers to more energy-intensive services, while others to power-intensive ones. The most important ones can be categorized as follows<sup>1</sup>:

- **Time-shift:** purchase of electricity when the price is lower to use it or sell it when the price is higher (also referred to as *arbitrage*). The effect is an increased demand in hours with lower load (*load levelling*), with advantages related to the generation pattern of conventional plants, and a reduction of the peak demand (*peak shaving*), resulting in a lower utilization of more expensive generators and a lower strain on the system. This service includes the potential provision of peak power to ensure system adequacy, when the power system is under stress<sup>2</sup>.
- **Time-of-use management and self-consumption:** residential and small commercial application to maximize the self-consumption of solar photovoltaics or to shift the consumption in hours with lower tariffs. The application principle is similar to time-shift, but more small-scale/local.
- **RE capacity firming and production smoothing:** compensation of the fluctuations of the production from variable renewables (e.g. solar and wind) to obtain a more predictable and regular generation profile. Reduction of the balancing cost for the plant operator and, from a system perspective, reduced need for reserve and modulation/ramping of conventional plants.
- **Network support and investment deferral:** postponement of costly expansion of the power network thanks to the reduction of situations of overload and congestions in transmission or distribution networks. In connection to variable renewables, it refers also to the reduction of curtailed energy.
- **Primary regulation:** participation in the primary frequency regulation, ensuring the balance between production and consumption is restored in the event of frequency deviations. The response time for the primary regulation is 15-30 sec. It is also referred to as Frequency Containment Reserve (FCR).
- **Secondary regulation:** participation in the secondary frequency regulation, ensuring the frequency is brought back to its nominal value after a major system disturbance. The response time of secondary regulation is 15 min. It is also referred to as Automatic Frequency Restoration Reserve (aFRR).
- **Tertiary regulation:** participation in the tertiary frequency regulation, which partially complements and replaces secondary reserve by re-scheduling generation. The response time must be within 15 minutes. It is also referred to as Manual Frequency Restoration Reserve (mFRR).
- **Black-start:** service of reestablishment of the grid after a generalized black-out. It can be provided by plants that are able to start operation autonomously, i.e. without alimentation from the grid.
- **Voltage support:** provision of reserve for the modulation of reactive power in specific nodes of the grid for voltage management purposes.

---

<sup>1</sup> The list of descriptions and applications are based on elaborations from [1], [11] and [12].

<sup>2</sup> Provision of peak power is very similar to arbitrage in terms of requirements from the storage system, but it differs in the utilization rate. The service of peak power provision would be activated only during very few hours in the year, where the price is very high, to ensure adequacy and security of supply. This would be feasible only in the case storage, due to the lower battery costs, becomes competitive with gas or other peaker technologies in terms of capital cost expenditure.

- **Power quality:** refers to a number of services related to the improvement of the quality of the power supplied. For example, improved voltage quality (compensation of voltage dips and distortion of voltage), reduction of the impact of distorting loads (e.g. harmonics, flicker) and shaving of localized power peaks (timescale of seconds).

The suitability of different storage technologies for the specific applications described are shown in Table 1<sup>3</sup>.

Application	Hydro	CAES	NaS	NaNiCl	Li-Ion	Redox	Fly-wheel
<i>Time-shift</i>	●	●	●	●	●	●	●
<i>Time-of-use management</i>	●	●	●	●	●	●	●
<i>RE firming and smoothing</i>	●	●	●	●	●	●	●
<i>Network support and deferral</i>	●	●	●	●	●	●	●
<i>Primary regulation</i>	●	●	●	●	●	●	●
<i>Secondary regulation</i>	●	●	●	●	●	●	●
<i>Tertiary regulation</i>	●	●	●	●	●	●	●
<i>Black start</i>	●	●	●	●	●	●	●
<i>Voltage support</i>	●	●	●	●	●	●	●
<i>Power quality</i>	●	●	●	●	●	●	●

**Legend:** ● Suitable      ● Less suitable      ● Not suitable  
 Table 1 Suitability of different electricity storage technologies for different applications. Adapted from [3].

Based on data from the U.S. DOE Database of Storage project [4], today the main uses of electricity storage by technology group are those displayed in Figure. The vast majority of pumped-hydro storage is used for Time-shift applications, followed by capacity firming and black start capabilities. Differently, electro-chemical storage is used for frequency regulation and provision of reserve, with a lower share dedicated to more energy-intensive services like time-of-use management and time shift. Electro-mechanical storages, like flywheel systems, see the largest deployment in on-site power quality services and black start.

<sup>3</sup> The suitability for the different services is primarily based on [1], [3] and [11]. Additional and more recent information have been considered. For example, thanks to the current reduction in cost, Li-ion batteries are starting to be deployed for energy-intensive services such as time-shift and load management. See for example: [13], [14] and other Li-ion projects with more than 4h of storage duration in [4].

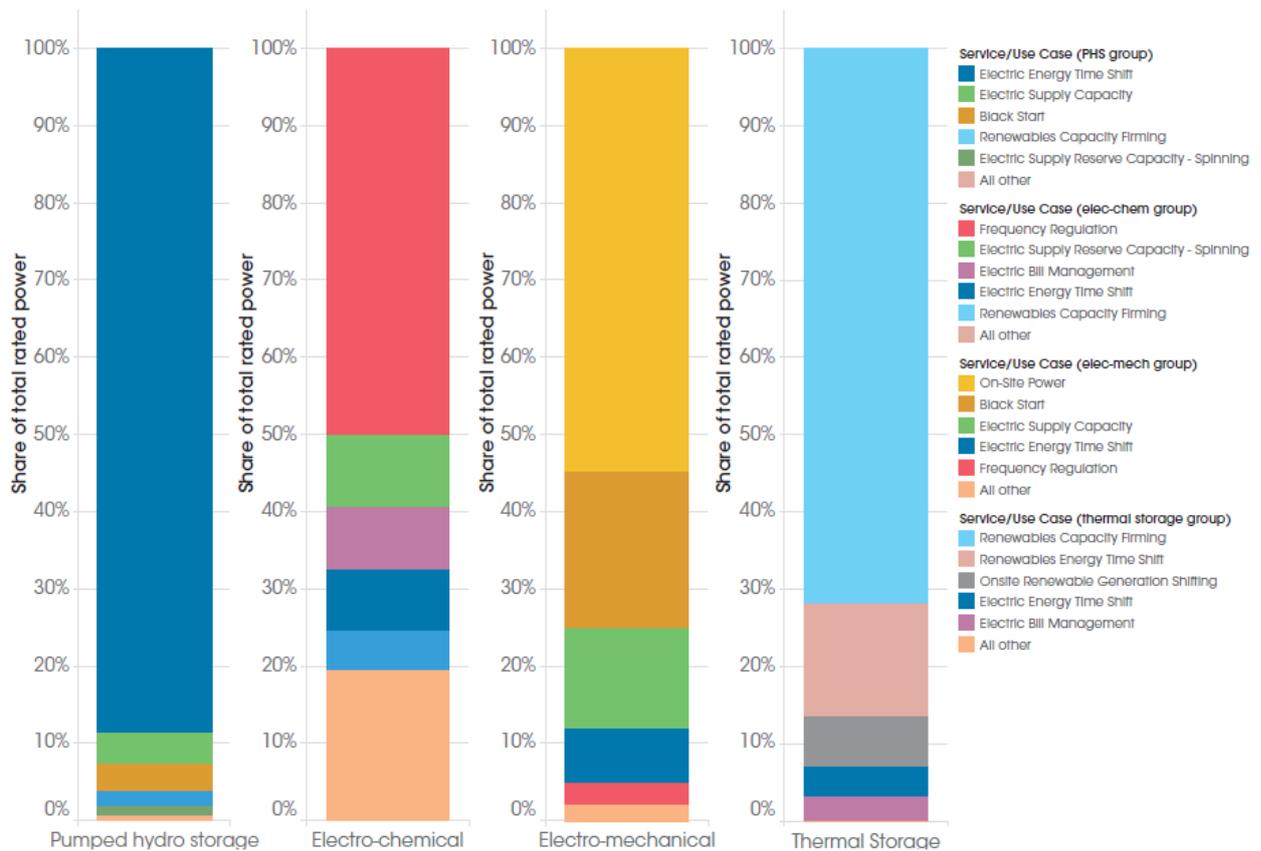


Figure 3 Global Energy Storage power capacity share by main use and technology group. Source [1].

In the future, electro-chemical storage is expected to experience an evolution towards more energy-intensive applications, following the reduction of battery cost. IRENA [1] estimates that its main applications will be:

- Energy shifting for PV to increase self-consumption (60-64%)
- RE capacity firming and smoothing at utility scale (11-14%)
- Frequency regulation (10-15%)
- Ability to provide multiple services and “stack” revenues

### Components of electricity storage cost

The system considered when defining the characteristics of the electrical energy storage - in particular its cost and efficiency performance - is the entire energy storage system including the connection to the grid. The system boundaries and the subdivision of the equipment in the three cost components, as defined in the *Investment cost* paragraph of the main guideline, are shown below for different electricity storage technologies.

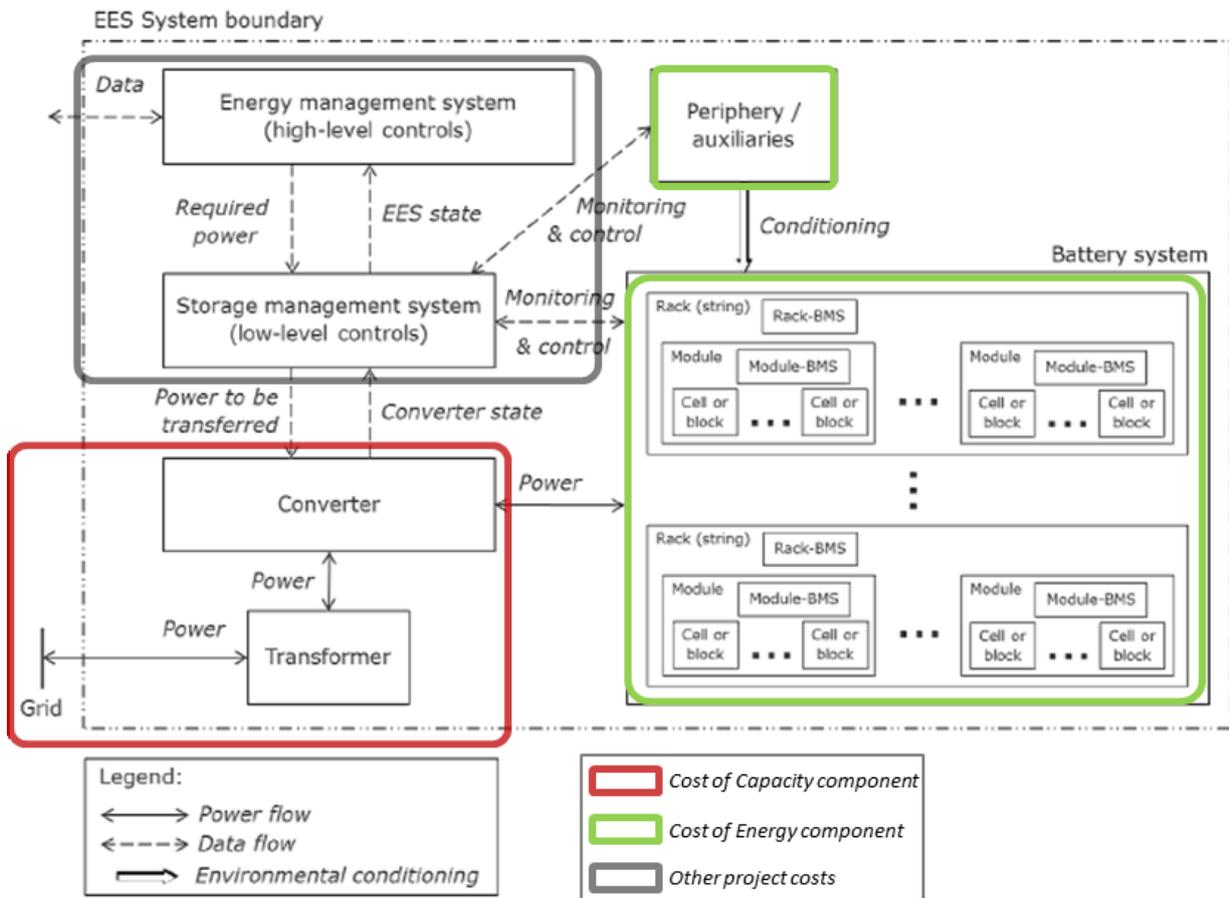


Figure 4 Components and their categorization for cell-based batteries, such as Li-ion, NaS and NaNiCl. Source: elaboration of [5].

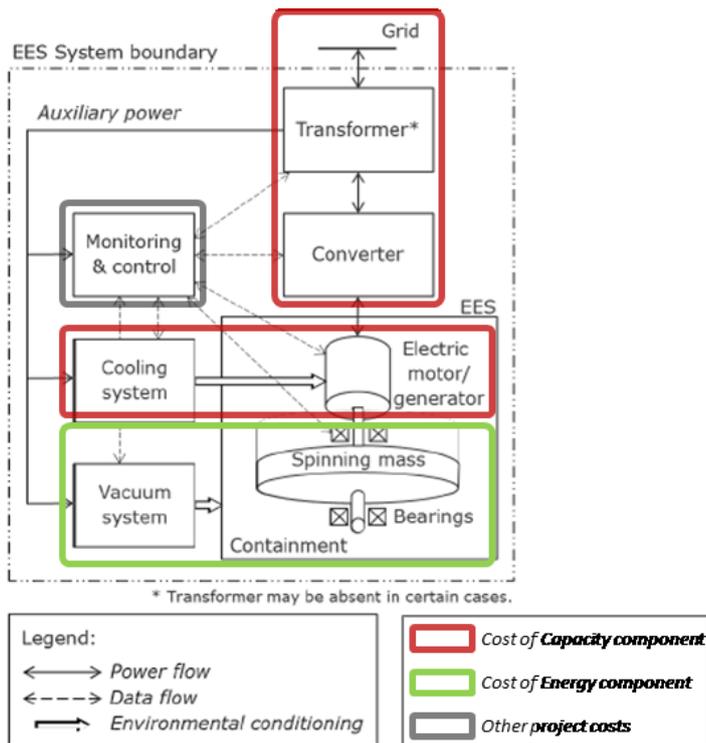


Figure 5 Components and their categorization for Flywheel. Source: elaboration of [5].

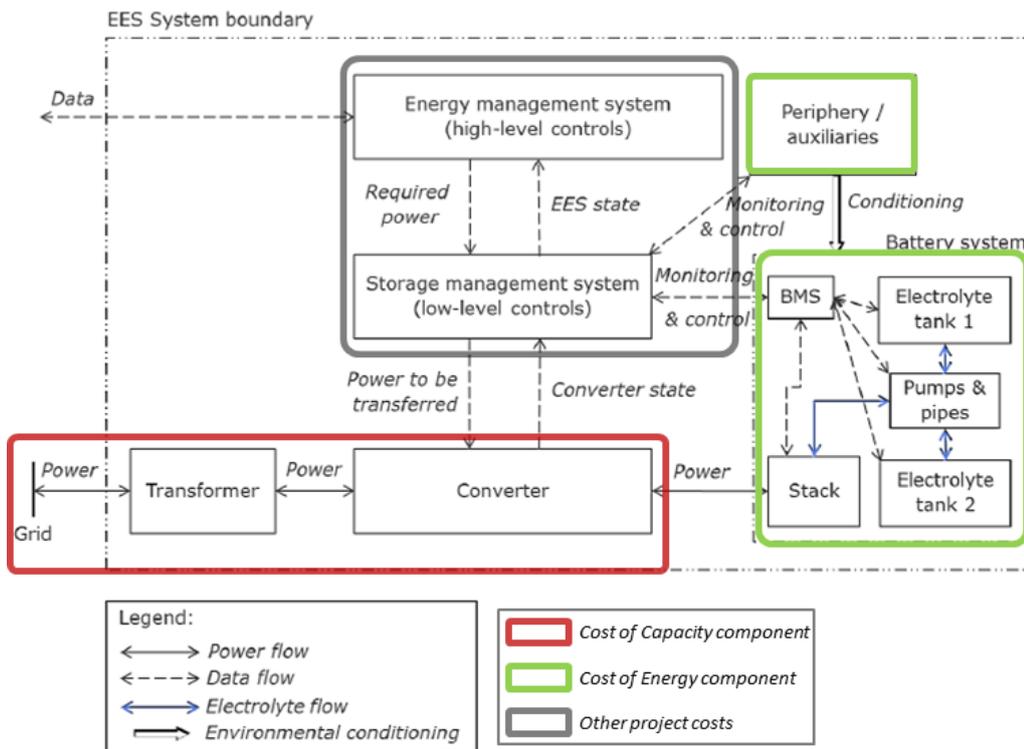


Figure 6 Components and their categorization for Vanadium-redox flow battery. Source: elaboration of [5].

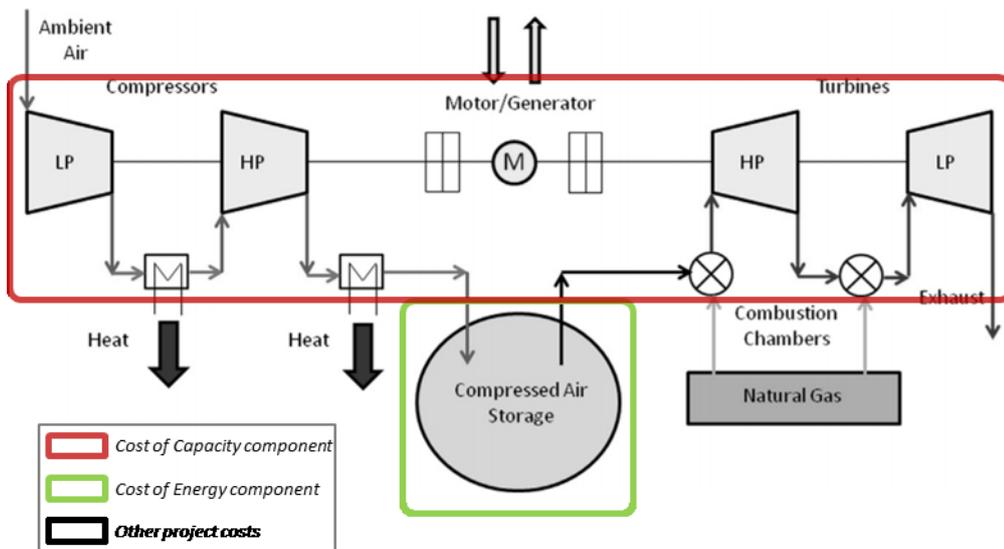


Figure 7 Components and their categorization for CAES. Source: elaboration of [5].

### Energy component

The energy component includes the following equipment and its installation:

- Cell-based batteries: battery modules, battery management system (BMS), local protection, racking frame/cabinet;
- Vanadium-redox: electrolytes, pumps and pipes, stack, battery management system (BMS);
- Flywheel: spinning mass, bearings, containment and vacuum system;
- Compressed Air Energy Storage: pressure tank or underground cavern, cavity or aquifer. Includes the air shaft.

For batteries and vanadium redox storage, auxiliaries for cooling are considered in the energy component, since they need to be scaled when more cells or electrolytes are added to increase the energy storage capacity.

### Capacity component

The capacity component includes the following equipment and its installation:

- Cell-based batteries and vanadium-redox: power conversion system (PCS), grid connection and protection;
- Flywheel: power conversion system (PCS), grid connection and protection, as well as electric motor/generator and cooling system;
- Compressed Air Energy Storage: all the components excluding tank/cavern (energy component) and those that falls under *other costs*. Includes the grid connection.

### Grid connection

The costs for the connection of the storage unit to the power system are included (shallow costs), while no cost of grid expansion or reinforcement (deep costs) is taken into account.

---

For system level application, unless otherwise stated, the connection is assumed to be at medium level voltage. The costs include: step-up transformer (low-medium voltage for BES), switchgears, breakers, meters and dedicated cabling to reach the connection point. In case of local level applications of BES, the transformer is not needed and the battery is normally connected to the low voltage, with a low cost for grid connection.

#### *Power conversion system (PCS)*

The power conversion system (or power conditioning system) ensures the bi-directional conversion AC to DC and DC to AC during charge and discharge respectively. This is done through a bi-directional inverter. To control the voltage level and avoid harmonics in the grid, a two-stage converter is sometimes used, complementing the inverter with a DC-DC converter to keep the inverter DC voltage constant [6].

An important design parameter is the voltage range in which the converter works. Today's applications are typically at 1000V, but some 1500V applications are emerging [7].

The cost of power conversion for battery storage systems, based on a number of references [8] [9] [10], is the range 0.2-0.3 M€/MW (0.4-0.5 M€/MW if including the connection to the grid). This is higher than the inverter cost for photovoltaic (PV) plants.

Among the reasons for a higher cost is the necessity for higher power performance and compliance to grid codes to provide ancillary services, bidirectional electricity flow and two-stage conversion, as well as the early stage of development and the fact that few manufacturers can guarantee turnkey systems [7].

In the future, with larger deployment of the technology and a move towards more commercial phase, the price of power conversion system (PCS) can be expected to drop, which is also the case for the module cost.

---

## References

The following list includes the references used in Chapter 2.

- [1] IRENA, "Electricity storage and renewables: Costs and markets to 2030," 2017.
- [2] International Electrotechnical Commission (IEC), "Electrical Energy Storage - White Paper," 2011.
- [3] A. Schrøder Pedersen, "European Energy Storage Technology Development Roadmap towards 2030," 2014.
- [4] U.S. Department of Energy, "Global Energy Storage Database." [Online]. Available: <https://www.energystorageexchange.org/>. [Last viewed 01.12.17].
- [5] DNV GL, "Safety, operation and performance of grid-connected energy storage systems," 2017.
- [6] M. Andriollo, R. Benato, M. Bressan, S. D. Sessa, F. Palone, and R. M. Polito, "Review of power conversion and conditioning systems for stationary electrochemical storage," *Energies*, vol. 8, no. 2, pp. 960–975, 2015.
- [7] "Interview with the manufacturer NIDEC." 2018.
- [8] R. Benato, G. Bruno, F. Palone, R. M. Polito, and M. Rebolini, "Large-scale electrochemical energy storage in high voltage grids: Overview of the Italian experience," *Energies*, vol. 10, no. 1, 2017.
- [9] B. Zakeri and S. Syri, "Electrical energy storage systems: A comparative life cycle cost analysis," *Renew. Sustain. Energy Rev.*, vol. 42, pp. 569–596, 2015.
- [10] G. Huff *et al.*, "DOE/EPRI 2013 electricity storage handbook in collaboration with NRECA," 2013.
- [11] Ricerca sul Sistema Energetico - RSE, "RSEview: L'accumulo di energia elettrica," 2011.
- [12] Energinet.dk, "Ancillary Services To Be Delivered in Denmark," 2017.
- [13] Enel, "Enel signs 85 mw of capacity storage agreements in us with pacific gas and electric," 2017. [Online]. Available: <https://www.enel.com/media/press/d/2017/12/enel-signs-85-mw-of-capacity-storage-agreements-in-us-with-pacific-gas-and-electric>. [Last viewed 01.02.18].
- [14] Lyon Energy, "LYON's Energy Storage Projects," 2017. [Online]. Available: <http://lyonbatterystorage.com.au/>. [Last viewed 01.02.18].

### 140 SEASONAL HEAT STORAGE

#### Contact information

Danish Energy Agency: Emil de Bekker Steffensen, edbst@ens.dk

Author: Per Alex Sørensen, Niels From and Hendrik Wetzel, PlanEnergi

#### Publication date

November 2018

#### Amendments after publication date

---

Date	Ref.	Description
Feb 25		Updated chapter and datasheet

---

#### Brief technology description

Large-scale thermal energy storage, LTES, (for district heating purposes) is normally based on water as the storage medium, but other storage mediums (ground for BTES and ATES and gravel for PTES) can be used as well.

Large thermal storages are commonly defined as storages with a storage capacity of at least 1 GWh. Large thermal storages can be utilized as short-term storages or long term/seasonal storages depending on their storage cycle duration.

This technology sheet addresses 4 different options for large thermal storages for district heating systems:

- PTES, pit thermal energy storage (focal technology in the chapter)
- BTES, borehole thermal energy storage, ground storage with closed water loops
- ATES, aquifer thermal energy storage, ground storage with open water loops
- TTES, tank thermal energy storage

For PTES and TTES, treated water (district heating water quality) is the storage medium in order to avoid corrosion. For ATES and BTES, the surrounding soil or aquifer is the storage medium.

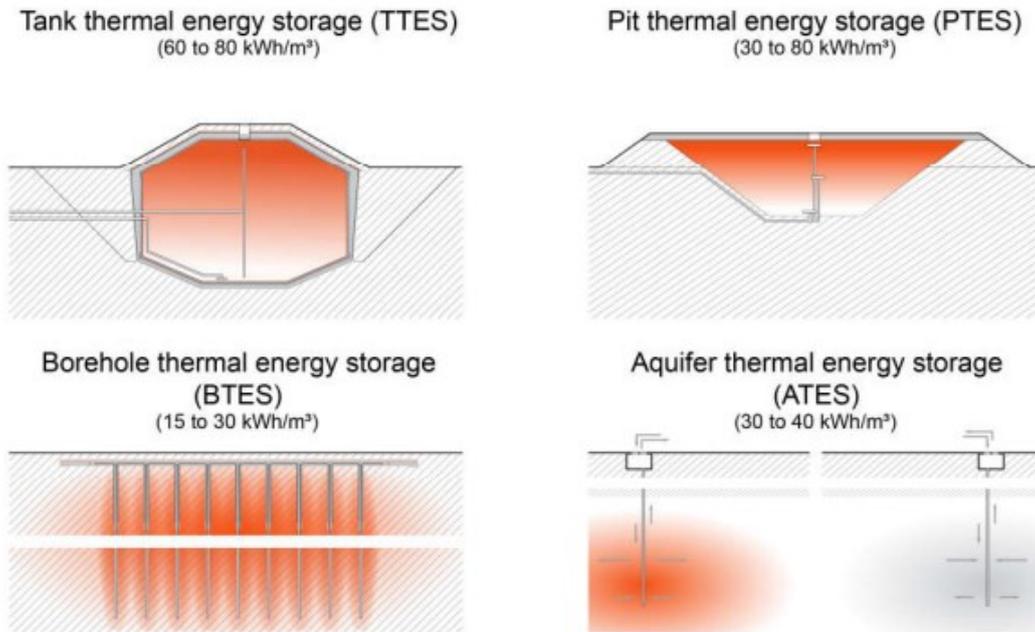


Figure 1: Overview of available thermal energy storage concepts. TTES can also be above ground [18].

## 140 Seasonal Heat Storage

Table 1: Comparison of storage concepts regarding heat capacity and geological requirements. TTES can also be above ground [18].

TTES	PTES		BTES	ATES
<b>Storage Medium</b>				
water	water*	gravel-water*	soil/rock	sand-water rock-water
<b>Heat Capacity in kWh/m<sup>3</sup></b>				
60 - 80	60 - 80	30 - 50	15 - 30	30 - 40
<b>Storage Volume for 1 m<sup>3</sup> water equivalent</b>				
1 m <sup>3</sup>	1 m <sup>3</sup>	1.3 – 2 m <sup>3</sup>	3 – 5 m <sup>3</sup>	2 – 3 m <sup>3</sup>
<b>Geological Requirements</b>				
<ul style="list-style-type: none"> <li>- stable ground conditions</li> <li>- preferably no groundwater</li> <li>- 5 – 15 m deep</li> </ul>	<ul style="list-style-type: none"> <li>- stable ground conditions</li> <li>- preferably no groundwater</li> <li>- 5 – 15 m deep</li> </ul>	<ul style="list-style-type: none"> <li>- drillable ground</li> <li>- high heat capacity</li> <li>- high thermal conductivity</li> <li>- low hydraulic conductivity (<math>k_f &lt; 10^{-10}</math> m/s)</li> <li>- natural groundwater flow <math>&lt; 1</math> m/a</li> <li>- 30 – 100 m deep</li> </ul>	<ul style="list-style-type: none"> <li>- natural aquifer layer with high hydraulic conductivity (<math>k_f &gt; 10^{-5}</math> m/s)</li> <li>- confining layer on top</li> <li>- no or low natural groundwater flow</li> <li>- suitable water chemistry at high temperatures</li> <li>- aquifer thickness of 20 – 100 m</li> </ul>	
<b>Storage Temperature Range</b>				
5 - 95 °C	5 - 95 °C		-5 - 90 °C	2 - 20 °C for shallow and 2 - 80 °C for deep systems

\* Water is more favorable from the thermodynamic point of view. Gravel-water is often used if the storage surface is to be designed for further usage (e.g. for streets, parking lots etc.)

A hot-water tank (TTES) is similar to the water tanks used for short-term (diurnal) heat storage, only larger. They are used as long term (weeks or months) storage for solar heating systems in e.g. Germany, where the largest tank is 12,000 m<sup>3</sup> [2]. The TTES is not further addressed in this chapter, see instead chapter 141 “Large-scale hot water tanks”. The technologies PTES, BTES and ATES will be outlined in the following.

### Pit thermal energy storages (PTES)

In principle, a pit thermal energy storage (PTES) is a large water reservoir for storing of thermal energy. The use of water as a storage medium has several advantages; it is non-toxic, enables stratification (layering according to different temperature levels), has good heat transfer characteristics and high specific heat capacity. Using water also enables high charging and discharging capacities. Moreover, water is cheap.

PTES using plastic liners for water-proofing is a relatively cheap storage technology, developed for operation with solar thermal energy. This concept has been developed in Denmark. PTES in the Danish version is essentially a hole in the ground lined by a water-proof membrane, filled with water and covered with a floating and insulating lid. PTES following this Danish concept have been developed for operation at relatively high temperature levels (up to 90°C all year round), increasing the area of application to excess heat from industries and waste incineration, as buffer storage for power plants and peak shaving. Furthermore, the requirement of constant high temperatures has led to a further development of suitable plastic liner materials.



Figure 2: Principle sketch of a cross section of a PTES [15]. Blue color is water, brown color is undisturbed soil and sand color is excavated soil build into embankments around the excavation.

The PTES can be designed with different shapes, but the simplest is an excavation shaped as a truncated pyramid placed upside down in the ground as shown in Figure 2. To minimize the cost of soil handling and transportation, the excavation is normally made with soil balance, which means that the soil excavated from the bottom part of the storage is used as embankments around the upper part of the storage. The necessary water volume of the storage depends on the overall energy system it is connected to, and it is necessary to make a calculation model of the overall system to find the optimal volume.

PTES is the most commonly used large thermal storage technology in Denmark, since initial demonstrations showed that this is the most cost-effective solution for large volumes [1, 4, 18].

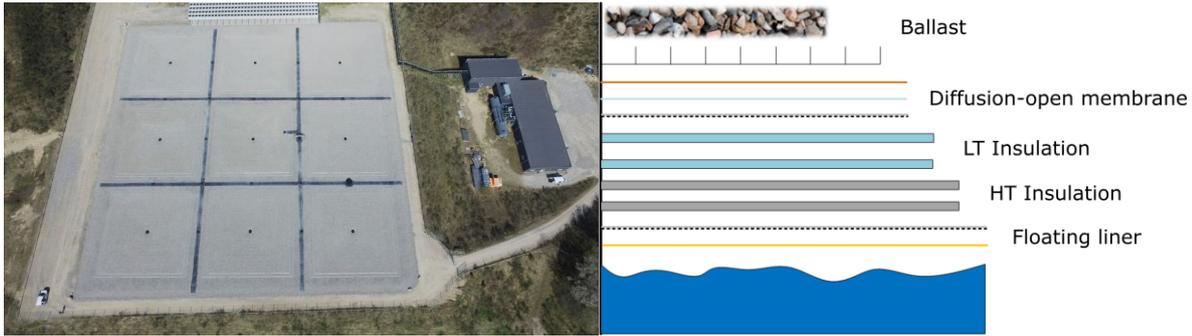


Figure 3: Illustrations of the lid in SUNSTORE 3 in Dronninglund. The lid construction is developed by Arcon-Sunmark and now implemented by Aalborg CSP [21].

The heat loss depends on several parameters such as geometry, storage temperatures, operation pattern, cycle duration and weather conditions.

A characteristic figure for the heat loss per amount of stored energy is the surface/volume ratio of the storage. With similar geometry, the surface/volume ratio is reduced by 50% each time the volume is increased by a factor of 8. Hence, the relative heat losses (referred to the stored energy) are twice as high for the small storage than for the large one. The heat losses from a PTES are larger during the first years than afterwards, as the surrounding soil will be heated up until a new heat balance is obtained.

Another important issue is whether a heat pump is used to cool the stored water. Doing so can decrease the annual heat losses and increase the storage capacity.

Based on design simulations, the heat loss from the PTES in Marstal (SUNSTORE 4) has been calculated to be 0.08 K/day (average water temperature of 78°C) and to be 0.04 K/day (average water temperature of 56°C) [1]. Storage efficiency depends very much on the number of cycles (see definitions in the final part of Chapter 140). As an example, in Dronninglund the efficiency is approximately 90% (with two yearly cycles) [14, 16].

PTES are characterized by a significant effect of economy of scale as illustrated in Figure 4. The economy of scale is due to the fact that the volume (and therefore the energy capacity) scales with the linear dimensions to the power of 3, whereas the materials and the installation of these only scales with the linear dimensions to the power of 2. The soil works scales with the linear dimensions to the power of approx. 2.8. The linear dimensions are e.g. the side length or the storage depth. The powers above are based on optimal geometry including soil balance.

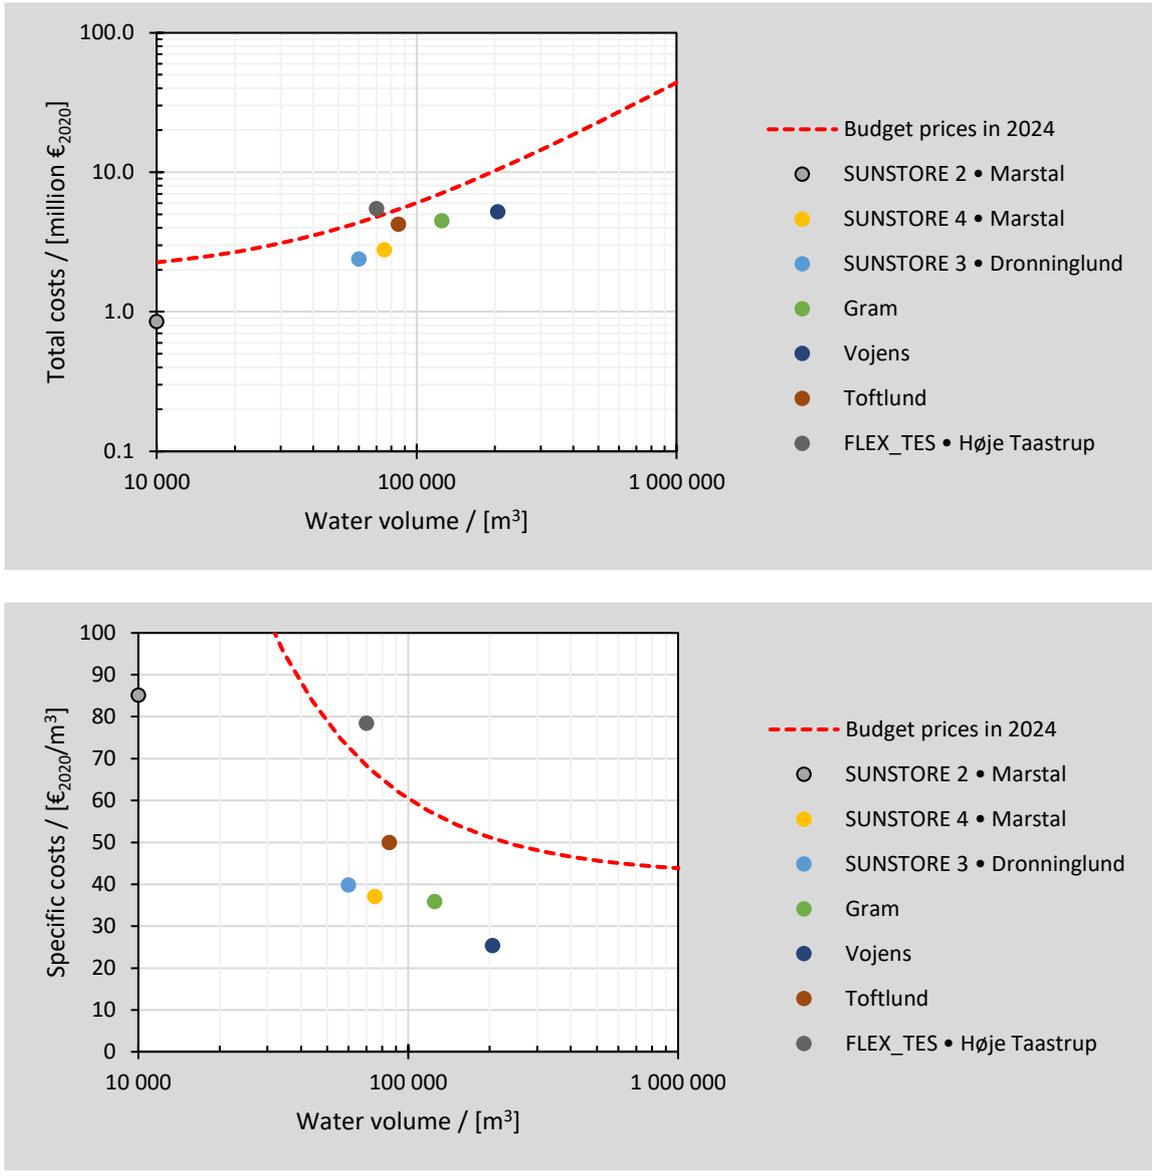


Figure 4: Project costs for PTES in Denmark [5, 16]. Top is total costs and bottom is specific costs. The dots are realized costs for PTES in Denmark. The red dotted line is budget prices in 2024 calculated as  $42.0 \text{ €}_{2020}/\text{m}^3 + 1.84 \text{ million } \text{€}_{2020}$ . Except for Høje Taastrup, the budget prices are higher than the realized costs, primarily due to higher quality and lifetime.

### Borehole Thermal Energy Storages (BTES)

BTES, a system consisting of tubes in boreholes (duct storage), normally operated in combination with heat pumps, are implemented in several countries. A typical BTES operates at low temperatures (0 to 30°C). The storage efficiency can reach 90 to 100 % when the BTES is operating around the average natural temperature of the ground [3], and there is no strong natural groundwater flow. Furthermore, BTES are characterized by requiring a relatively small area of land, as the surface area may be used for other purposes, depending on plant design. BTES can also be used for storing higher temperatures (up to 90°C). A pilot storage (19,000 m<sup>3</sup> soil) of that type has been implemented in connection to solar thermal at Brædstrup Fjernvarme in Denmark. Larger storages has a.o. been implemented in Okotoks, Canada and Crailsheim, Germany.

Figure 5 illustrates the system in Brødstrup with 2 U-pipes in each of the 48 boreholes. The BTES is charged by pumping hot water from the centre of the BTES down and up from the boreholes (6 in series) and back to the centre. That will heat up the soil in the summer period. In the winter period the BTES is discharged by pumping cold water in the opposite direction. The BTES is connected to an accumulation tank (TTES).

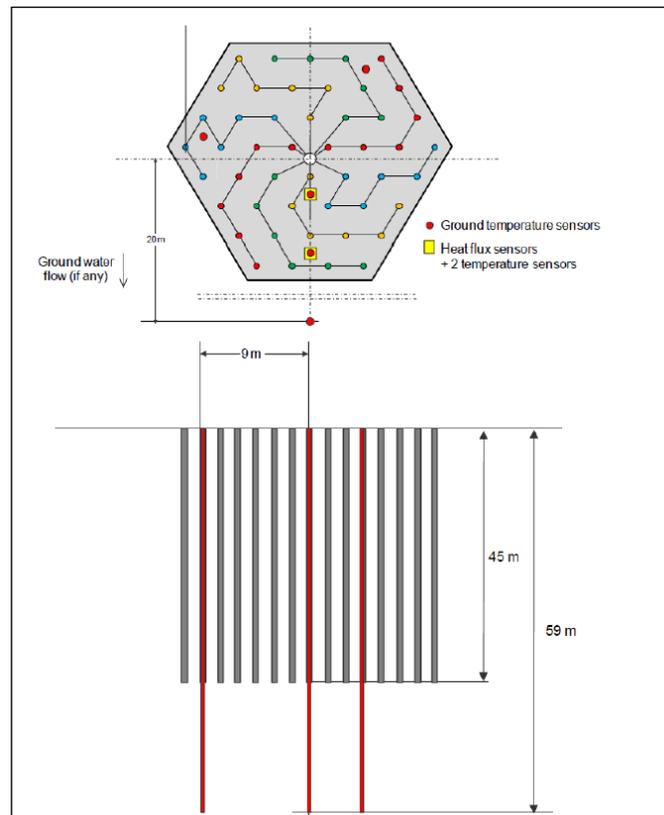


Figure 5: BTES in Brødstrup, Denmark. The depth of the pipes (grey lines) is 45 m, the depth of the ground temperature sensors (red lines) is 59 m. The horizontal distance between the sensors is 9 m [1].

The heat loss of a  $185,000 \text{ m}^3$  soil volume BTES has been calculated (simulation), cf. the storage design illustrated above at full-scale deployment. The calculation resulted in a storage efficiency of 81.5 % [1].

### Aquifer Thermal Energy Storage (ATES)

When storing hot and/or cold water in natural underground aquifers, direct heat exchange is taking place in the aquifers by the use of vertical or horizontal wells, typically with one or more pair of wells, each with one “cold” and one “warm” well connected by a heat exchanger. Several aquifer storages are being operated simultaneously for free cooling and heating together with heat pumps e.g. in the Netherlands, Sweden and Denmark, typically for space cooling during summer and space heating during winter, thus operating with storage of heat in summer and storage of cold in winter. Primary energy savings up to 75% in comparison to separate traditional cooling and heating methods. China has a long tradition of cold water storage in aquifers, the first projects reported in 1958. The chemical composition of the aquifer and natural groundwater flow may negatively influence the performance. Aquifer storage is the most cost-effective technique for large low-temperature volumes, the largest plant in Denmark has capacities of 4.7 MW heating and 5.3 MW cooling with 12 wells in operation [22].

Charging of the storage with heat is done by pumping ground water from a “cold” well through a heat exchanger and then to a “warm” well typically 50-100 m from the “cold” well. The heat is thus stored in the aquifer structure (sand, gravel, limestone, chalk). When discharging the storage, the water flow is reversed: the hot water is pumped from the “warm” well, through the heat exchanger and then to the “cold” well. In the heat exchanger the heat is extracted from the groundwater by a heat pump, thus reducing the temperature of the groundwater.

In Denmark, the maximum average storage temperature in an ATEs is 20°C (by law) and a peak temperature of 25°C. Cold storage is permitted down to 2°C. Hence, ATEs is a low temperature heat storage technology in Denmark. Natural groundwater temperature in Denmark is 8.5-11°C within a depth of 100 meters below the surface.

Typical ATEs charging and discharging capacity (for each pair of wells; a hot and a cold well) is 50-75 m<sup>3</sup>/h, corresponding to 600-900 kW at a temperature difference of app. 10°C.

The application in Denmark is limited, and ATEs is mainly applicable for small-scale plants 500 kW-5,000 kW heat production (large office complexes, schools, hospitals, universities, industry, small district-heating plants etc.), and with the best economy when both heating and cooling can be utilized. There is currently few ATEs-plants in relation to local district heating in Bjerringbro [1], Bispebjerg Hospital and Copenhagen Airport [22].

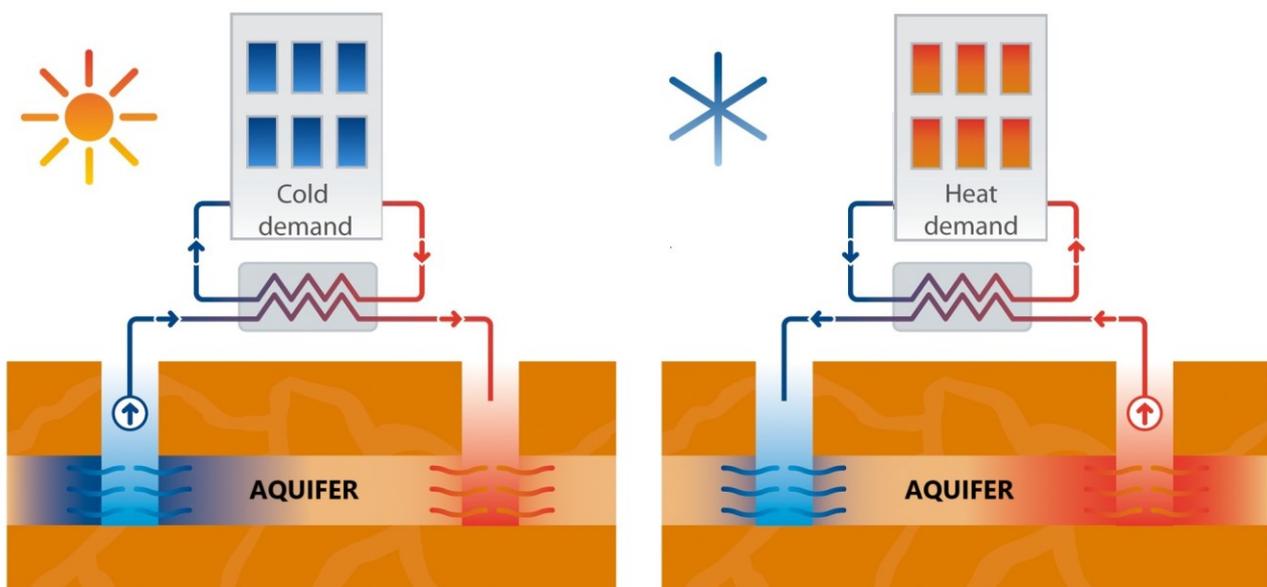


Figure 6: Principle of an ATEs [20].

In the remainder of the chapter the descriptions will only refer to the PTES technology, unless otherwise stated.

### Input

Hot water from any heat source, e.g. solar collectors, excess heat or power to heat.

If the heat storage is operated in combination with a heat pump, the power driving the heat pump is either electricity or, in the case of an adsorption/absorption heat pump, high temperature heat.

### Output

High temperature water for direct district heating or low-mid temperature water for heat pumps or direct low-temperature district heating.

If the heat storage is operated in combination with a heat pump, (district) cooling can be a co-product of the thermal storage.

### Typical storage capacities (PTES)

Typical storage capacities for large thermal energy storages are in the range of 50,000-500,000 m<sup>3</sup> water volume, or 5,000-40,000 MWh at one full charging cycle. Appropriate capacities depend on the total system design, e.g. heat demand and heat resources (excess heat available, a desired solar fraction, possibilities to more efficient CHP production, desired peak shaving) and restrictions according to area and transmission capacity.

### Typical charging and discharging capacities (PTES)

Typical charging and discharging capacities for PTES has been in the range of 100-1,000 m<sup>3</sup>/h water flow, or 5-50 MW thermal power. However, a PTES with a charging and discharging capacity of 3,000 m<sup>3</sup>/h or 150 MW of thermal power is currently in the late planning phase, and charge/discharge capacity can potentially be higher based on the specifications and limitations of each system.

### Typical Storage Period

A typical application for e.g. solar thermal systems is storage for several months from the summer months to autumn. Using a heat pump to cool the storage further down can expand this period to approx. December. An increase in storage period beyond this is typically not financially feasible, unless the PTES is used to store seasonally available and cheap (excess) heat. The optimal storage period (and i.e. the storage capacity) is thus to be determined by the local context, incl. the existing and available heat sources.

Applications for solar thermal systems have normally 1-2 cycles/year. Applications utilizing excess heat and providing flexibility to CHP systems can have several cycles/year. An example is the PTES in Høje Taastrup [19]. More cycles/year will normally be a financial advantage.

### Regulation ability and other system services

The PTES can indirectly participate in the electricity market by charging heat from CHPs in periods with low electricity prices and discharging heat to district heating in periods with high electricity prices. The charging and discharging capacity depend on pumps, valves and in- and outlet capacity. In Høje Taastrup the charge and discharge capacity can be changed with 0.2-0.5 MW/min or 1-2% of the in- and outlet capacity/min. because of the systems outside the storage. For the storage itself the charging and discharging can go from 0 to max within few minutes.

### Space requirements

PTES requires space. As a rule of thumb, the areas in Table 2 can be used for the storage alone, but extra 10% will be needed for rainwater, materials etc.

Table 2: Water volume, area, water depth and water depth below surface for different storage volumes. 10% area must be added for additional activities.

Water volume, shape	Area, outer edge of the slope of banks	Storage depth	Water depth below surface
100,000 m <sup>3</sup> square	26,244 m <sup>2</sup>	16 m	10.76 m
200,000 m <sup>3</sup> square	42,937 m <sup>2</sup>	16 m	10.75 m
300,000 m <sup>3</sup> square	47,651 m <sup>2</sup>	16 m	8.85 m
300,000 m <sup>3</sup> rectangular	51,844 m <sup>2</sup>	16 m	9.47 m
600,000 m <sup>3</sup> square	74,595 m <sup>2</sup>	19 m	9.81 m

For a PTES with a squared footprint, a suggested water depth can be calculated as  $\text{Water depth} / [\text{m}] = 0.382 * (\text{Volume} / [\text{m}^3])^{1/3}$ . Based on this water depth, and assuming soil balance, the footprint of the PTES can then be calculated as  $\text{Footprint} / [\text{m}^2] = 20.15 * (\text{Volume} / [\text{m}^3])^{0.61}$ . As an example, a PTES of 100,000 m<sup>3</sup> will then have a water depth of 17.73 m, and a footprint of 22,600 m<sup>2</sup> with soil balance.

**Advantages/disadvantages**

**Advantages:**

The PTES offers a buffer capacity for district heating/electricity systems, enabling increased utilization of renewable energy sources such as solar thermal and wind turbines (when using power to provide the heat) and financial optimization of CHP systems. These are generic advantages of large-scale heat storage technologies. The increased buffer also allows cheap baseload units to operate at high capacity during longer periods, independent of the seasonal changes in the heat demand. This increases the utilization of those units and decreases the need for more expensive peak load units.

PTES	BTES	ATES
<ul style="list-style-type: none"> <li>• High storage capacity possible</li> <li>• High storage temperature possible</li> <li>• Quick charging and discharging with high capacity</li> <li>• High specific heat capacity</li> <li>• Cheap storage medium with good heat transfer characteristics</li> </ul>	<ul style="list-style-type: none"> <li>• Requiring relatively small area of land</li> <li>• Very limited visual impact</li> <li>• Expandable</li> <li>• Limited risk of leakages (possible to close single loops)</li> <li>• Closed system</li> <li>• Long lifetime</li> </ul>	<ul style="list-style-type: none"> <li>• Low investment costs</li> <li>• Low operation costs</li> <li>• Small physical footprint</li> <li>• Scalable, easy to expand</li> <li>• Low temperature storage can be used for heating and cooling</li> <li>• High storage capacity in each borehole-pair (1.2-1.4 GWh at 10°C temp. difference and 2,000 hours)</li> </ul>

• Enables stratification <sup>4</sup>		
---------------------------------------	--	--

**Disadvantages:**

A generic disadvantage of PTES, BTES and ATES is that a suitable site in terms of e.g. soil or groundwater conditions must be available in order to make a large thermal storage possible.

PTES	BTES	ATES
<ul style="list-style-type: none"> <li>• Requiring a relatively large area of land</li> <li>• Risk of difficult establishment (excavation) due to climatic conditions (rainfall) and ground water</li> <li>• Availability of site can be crucial for the feasibility</li> <li>• Specialized handling of liner materials necessary, as improper handling increases risk of leaks</li> <li>• Polymer liners and insulation materials have limited lifetimes depending on temperatures, moisture, oxygen and stress conditions.</li> <li>• Risk of increased heat loss due to ground water flow</li> </ul>	<ul style="list-style-type: none"> <li>• Unknown sub-surface conditions (risk of higher investment costs)</li> <li>• Risk of heat loss due to ground water flow</li> <li>• Buffer tank required</li> <li>• Application of a heat pump required</li> <li>• Slow charging and discharging</li> </ul>	<ul style="list-style-type: none"> <li>• Risk of thermal short circuit of ground water</li> <li>• Several parameters influence the feasibility</li> <li>• Low storage temperatures (max. 20°C in DK)</li> <li>• Open system (direct circulation of ground water in the aquifer)</li> <li>• Risk for clogging of heat exchangers and/or injection holes.</li> </ul>

**Environment**

- For PTES and BTES, there is a general risk of leakage of treated water.
- For especially ATES and BTES, there is a risk of heating of ground water surrounding the storage. Heating the aquifers to more than the legal 20°C (average temperature in DK) may result in bacterial growth. But until now there are no reported bacterial growth at temperatures up to 25°C.
- If not planned properly, PTES can have a substantial visual impact on the surrounding landscape. This may be addressed and minimized in the design phase.

**TRL**

TRL for PTES, BTES and ATES is 9 for standard solutions. In some countries (for instance NL) shallow ATES is TRL 10-11.

---

<sup>4</sup> If the diffusers are not designed properly, stratification will not be achieved. If stratification is achieved, it has a positive effect on the storage performance.

### Research and development objectives

A general research and development objective is the improvement of modelling of large thermal energy storages to improve the planning security in investment decisions [5].

#### PTES

- Improvement of polymer liners that can withstand a storage temperature of up to 95°C all year round. Current HDPE liners are suitable for shorter storage periods at max. temperature (up to approx. 90°C), e.g. in relation to solar thermal production peaks in the summer, and a rapid decrease in the storage temperature in the beginning of the heating season. PP-liners are expected to have lifetime of more than 20 years at 90°C, but this has to be proved.
- PTES to store heat from waste incineration and industries and as buffer storages for CHPs adding flexibility to the electricity production is until now only demonstrated in Høje Taastrup in Copenhagen (DK). Experiences in operation are needed.
- Further development of insulated lids, moisture resistant at high temperature levels.
- Development of corrosion free in- and outlet systems to avoid expensive treatment of the water in the PTES.
- Low-cost PTES for low temperature heat sources as heat source for heat pumps.
- Utilisation of the produced cooling for process cooling and district cooling.

#### BTES

- Demonstration of full-scale BTES, expected to be competitive to PTES, considering the expected longer lifetime than PTES.
- Investigation of BTES established at locations with higher level of ground water (non-floating). Location in water-saturated soil would imply a higher heat conductivity. Location of PTES in these areas is expensive – hence BTES could be a more feasible solution.

#### ATES

- High temperature storage in ATES requires more research to ensure reliable operation (low temperature storage in ATES is more mature and is feasible and already proven in stable operation). One project has under a dispensation stored heat at 35°C without any harmful bacterial growth [22].
- Development of replicable screening program for suitable sites for ATES (e.g. methods to easily identify relevant aquifers, including information regarding e.g. natural ground water flow. The tool could also be applied in relation to PTES.
- Further investigation of critical ground water flow rates and heat losses in ATES and BTES.

### Storage in geothermal reservoirs

Large thermal energy storages in geothermal reservoirs has been investigated in Denmark, including investigations of the selection of suitable geological formations, identification of risks associated to heat storage and determination of a suitable injection strategy [4, 7].

**Examples of Market Standard Technology**

In all examples prices are for the storage and related work and preparation, excluding heat pumps, heat exchangers and pipes connecting to the district heating system.

**PTES**

Denmark is a front-runner for PTES for district heating systems. Key data for a number of Danish large scale thermal storages are presented in Table .

Table 3: Key data for 8 Danish PTES [1, 13, 14, 16, 19]. Calculated heat loss data for SUNSTORE 3 from [10]. Prices are the real implementation costs in the implementation year (current prices).

#Measured data for 1998-2001 (Pilot storage in Ottrupgård) [14], 2013 (Marstal) and 2014 (Dronninglund).

PTES	Ottrup-gård	SUN-STORE 2 Marstal	SUN-STORE 3 Dronning lund	SUN-STORE 4 Marstal	Vojens	Gram	Toftlund	Høje Taastrup
Year of construction	1993-95	2003	2013	2011-12	2014-15	2014-15	2016-17	2020-22
Size, m <sup>3</sup> (water volume)	1,500	10,000	60,000	75,000	210,000	125,000	85,000	70,000
Price, million €	0.23	0.67	2.3	2.7	5.0	4.3	4.1	6.0
Price, €/m <sup>3</sup>	150	67	38	36	24	34.5	48	86
Price, €/kWh	5.2	1.0	0.43	0.45	0.41	0.36	0.59	1.83
Temperature range, °C	35-60	35-90	10-89	17-88	40-90	20-90	20-90	45-90
Capacity, MWh	43.5	638	5,400	6,000	12,180	12,125	6,885	3,300
Charging and discharging cap., MW	0.39	6.51	26.1	10.5	38.5	30.0	22.0	30.0
Calc. heat loss, total, MWh/y	85	402	1,602	2,475	5,500	4,024	1,900	1,577
Measured heat loss, MWh/y <sup>#</sup>	70		1,175	2,927				

**BTES**

There is currently only one BTES in operation in a Danish district heating system (Brødstrup).

**Table 4: Key data for BTES in three examples. The heat loss for Drake Landing is calculated in year 4 [1]. Current prices. \*Measured for 2014-17 [8].**

BTES	Drake Landing (Okotoks, CA)	Crailsheim (DE)	Brødstrup (DK)
Year of construction	2006-07	2008	2011-12
Size, m <sup>3</sup> (soil volume)	34,000	37,500	19,000
Price, million €	0.45	0.52	0.26
Price, €/kWh	0.64	0.46	0.66
Number of boreholes	144		48
Depth, m	35		45
Temperature range, °C	35-65	20-70	12-50
Storage capacity (calc.), MWh	700	1,135	400
Charging and discharging cap., MW			0.3-0.6
Heat loss 1. year, calc., MWh/y	280	305	148
Measured heat loss, MWh/y*			90

**ATES**

There is currently only one ATES in operation in a Danish district heating system.

**Table 5: Characteristics of the ATES in Bjerringbro, Denmark, connected to a district heating network. The price pr. kW is excluding transmission pipelines (the total price is 1,600 – 1,750 €/kW) [1].**

ATES	Bjerringbro
Year of construction	2013
T <sub>return</sub> , °C	17
T <sub>forward</sub> , °C	9
Charging and discharging cap., MW	1.5
Temperature difference, heat, °C	8
Size, m <sup>3</sup> /h	160
Price, million €	2.5
Price, €/m <sup>3</sup> water	10-20
Price, €/kW	700-900

Prediction of performance and costs

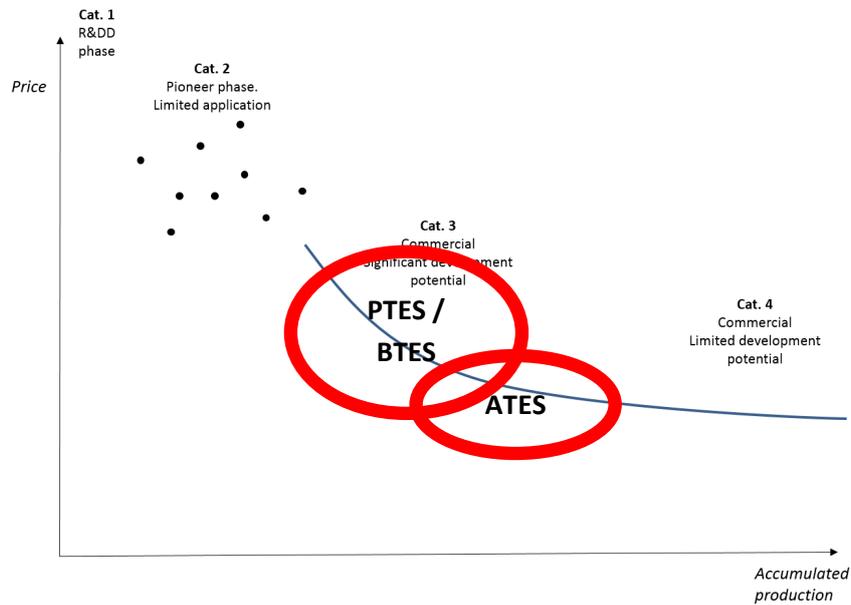


Figure 7: Technological development phases. Correlation between accumulated production volume (MWh) and price.

**PTES**

Crucial knowledge regarding PTES in the context of Danish district heating systems has been gathered through the last decade. Thus, PTES is categorized as “early category 3” or TRL9 on IEAs TRL scale as the key development potentials lie in increased standardization in work procedures as well as the development of high temperature resistant liners at feasible prices, which is to be seen as improvement of existing designs.

**BTES**

The one demonstration plant in Denmark (Brædstrup – pilot project) is evaluated positively as a technical solution since implementation and operation has worked as expected. However, no full-scale storage is yet implemented in Danish district heating systems. Further development of BTES is expected through means of standardization of processes and improved modelling of the energy system, resulting in optimized storages for the given system.

**ATES**

ATES is a well-proven technology in e.g. Sweden and The Netherlands and Denmark, primarily for cooling of individual commercial buildings and alike. In the context of Danish district heating, it is still a niche technology. However, as many key assumptions and knowledge about the technology can be adjusted to the Danish context, ATES is assumed to be in development category 3 or TRL9 on IEAs TRL scale, as there is yet only limited locally embedded expertise in combination with district heating, but the experiences from the building sector and industries can easily be adopted by the district heating sector. For The Netherlands TRL is 10-11 for shallow ATES for buildings.

## 140 Seasonal Heat Storage

### Uncertainty

The above is based on available information regarding the development of technical solutions in PTES, BTES and ATES. Hence the uncertainty as to the state-of-the-art data is very low. However, the results are sensible to the stated circumstances, system integration etc. I.e. the data can only be applied to the stated limitations as to e.g. soil conditions (soil material, absence of flowing groundwater etc.).

### Additional remarks

Under Danish climatic conditions long term storage for solar heat typically requires 0.3-2 m<sup>3</sup> water storage volume per m<sup>2</sup> solar collector, with solar heat contributing 20-40 % of the total yearly heat load (cf. technology element Solar district heating in this Technology Data Catalogue). For systems with higher solar fraction, the marginal additional storage volume needs to be about 4 m<sup>3</sup> per m<sup>2</sup> solar collector [5 & 9].

### Quantitative description

Technology	Pit Thermal Energy Storage (PTES)										-	-
	2020	2025	2030	2035	2040	2050	2025	2025	2050	2050		
year	ctrl	ctrl	ctrl	ctrl	ctrl	ctrl	lower	upper	lower	upper		
est	ctrl	ctrl	ctrl	ctrl	ctrl	ctrl	lower	upper	lower	upper		
cat	par											
<b>Energy/technical data</b>												
Form of energy stored	Heat	Heat	Heat	Heat	Heat	Heat	Heat	Heat	Heat	Heat		
Application	System	System	System	System	System	System	System	System	System	System		
Energy storage capacity for one unit [MWh]	4 500	4 500	4 500	4 500	4 500	4 500	4 500	4 500	4 500	4 500		
Output capacity for one unit [MW]	30	30	150	200	200	200	30	150	30	200	A	5
Input capacity for one unit [MW]	30	30	150	200	200	200	30	150	30	200	A	5
Round trip efficiency [-]	80%	80%	80%	80%	80%	80%	75%	90%	80%	95%	B, I	1, 5, 14, 23
- Charge efficiency [-]	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	B	
- Discharge efficiency [-]	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	B	
Energy losses during storage [K/day]	0.08	0.08	0.08	0.08	0.08	0.08	0.04	0.1	0.04	0.1	B	12
Auxiliary electricity consumption [- of output]	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	C	5
Forced outage [-]	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%		
Planned outage [weeks/year]	1	1	1	1	1	1	1	1	1	1		
Technical lifetime [years]	20	30	30	30	30	30	20	40	30	50	D	24
Construction time [years]	1	2	2	2	2	2	2	2	2	2	E	
<b>Regulation ability</b>												
Primary regulation [-/30 sec]												
Secondary regulation [-/minute]												
<b>Financial data</b>												
Specific investment [M2020-MEUR/GWhCapacity]	1.06	1.06	1.06	1.06	0.98	0.90	0.90	1.22	0.74	1.06	F	5
- hereof equipment [-]	75%	75%	75%	75%	75%	75%	75%	75%	75%	75%		5
- hereof installation [-]	25%	25%	25%	25%	25%	25%	25%	25%	25%	25%		5
Fixed O&M [2020-EUR/MWhCapacity/year]	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	G	1, 5
Variable O&M [2020-EUR/MWhoutput]	0	0	0	0	0	0	0	0	0	0	G	1, 5
<b>Technology specific data</b>												
Storage volume for one unit [m3]	70 000	70 000	70 000	70 000	70 000	70 000	70 000	70 000	70 000	70 000		
Storage medium	Water	Water	Water	Water	Water	Water	Water	Water	Water	Water		
Max. storage temperature, hot [°C]	90	90	90	90	90	90	90	90	90	90		
Storage temperature, discharged [°C]	35	35	35	35	35	35	35	35	35	35	H	

## 140 Seasonal Heat Storage

---

### Notes:

- A. The charge/discharge capacity corresponds to an example where a solar fraction of 40% was desired. Other input/output capacities (also relative to storage capacity) may occur for other purposes. Measurements from SUNSTORE 3 show approx. 80% efficiency for a storage with a heat pump.
- B. Values in the table are without a heat pump. The storage loss depends on several parameters, such as storage volume, insulation, whether a heat pump is part of the system etc. Round trip efficiency of approx. 80% when applying a heat pump for cooling to 10°C.  
(Dis-)charge losses 0 cf. Direct use of water from the connected district heating grid (without heat exchanger).  
Losses are dependent on the temperature of the storage. 0.08 K/day at average temperature of approx. 78°C, falling to 0.04 K/day at 56°C.
- C. Approx. 100 MWh/year for pumps, at 2,000 fullload hours for the pumps, considering one full cycle pr. year.
- D. Depends on the storage operation temperature profile (seasonal, permanent) temperature in relation to the technical lifetime for liners and insulation. Values stated refer to permanent high temperatures, which means in turn a theoretically unlimited number of cycles.
- E. Excl. extensive planning phase with possible Environmental Impact Assessment etc. Careful timing of steps is mandatory. Depending on the storage size the steps of excavation, building, installation of liners etc. can be done within one summer. For very large volumes the water filling phase can take several months (depending on the filling speed) and filling should preferably be scheduled during the winter. A construction time of approx. 2 years for very large storages is not unrealistic.
- F. Estimated from numerous budget calculations and the cost of the Danish plants, described in the text, and due to effects of economy of scale, the total costs of a PTES in 2020 could be described in a formula:  $\text{Cost [MEUR]} = 1.84 + 42.00 \cdot 10^{-6} \cdot V$ , with V being the volume in m<sup>3</sup>. Corresponding to 69 EUR/m<sup>3</sup> at 70,000m<sup>3</sup> and 1,06 MEUR/GWh capacity. The costs are based on decent soil conditions, i.e. sand ground and not e.g. heavy clay.  
The costs can be split as follows:
  - 15% Excavation and reinstallation of soil
  - 35% Bottom and side surfaces & insulation material
  - 20% Installation (of primarily liner)
  - 15% Piping
  - 15% Water (incl. desalination)
- G. The Fixed O&M is set according to capacity of the energy storage specified in the top of the table. Corresponding to approx. 28,000 EUR/storage/year for e.g. divers for inspection, adding of possible leakages and minor fixes.
- H. Cooling to lower temperatures is only possible when a heat pump is used to chill the PTES.
- I. Total efficiency during a one year cycle, including losses during the storage period.  
The efficiency is very depended on the operation of the storage.  
E.g. if the yearly efficiency is 80% with one cycle, the same storage will have a yearly efficiency of 90% with two cycles.  
Examples are: Seasonal without heat pump: 70%, Seasonal with heat pump: up to 90%, and Short-term: 95%.

### References:

- 1. PlanEnergi, Teknologisk Institut, GEO & Grøn Energi, 2013, Udredning vedrørende varmelagringsteknologier og store varmepumper til brug i fjernvarmesystemer
- 5. PlanEnergi, 2017, based on latest three projects and tender material for two planned PTES (2017/18)
- 12. Danish Energy Agency, 1988, Energy Technology Catalogue 38.01
- 14. Schmidt, 2018, Monitoring Results from Large Scale Heat storages for District Heating in Denmark. 14th International Conference on Energy Storage, 25-28 April 2018, Adana, Turkey
- 23. Sørensen, From, Wetzel, Sifnaios, Jensen [2024] Design, implementation, and monitoring results from the 70,000 m<sup>3</sup> pit thermal energy storage (PTES) in Høje Taastrup, Copenhagen - Enerstock Conference, Lyon, France, 5.-7. June 2024
- 24. Peham et.al 2024, Lifetime assessment of pit thermal energy storages based on various polyolefinic liner materials

## References

- [1] PlanEnergi, Teknologisk Institut, GEO & Grøn Energi, 2013, Udredning vedrørende varmelagringsteknologier og store varmepumper til brug i fjernvarmesystemer
- [2] Ellehauge & Kildemoes and COWI, 2007, Seasonal heat storages in district heating networks. A project (Preheat) funded by Intelligent Energy – Europe and the Danish Transmission System Operator Energinet.dk.
- [3] Mangold, 2007, Seasonal Heat Storage. Pilot projects and experiences in Germany, ([www.solites.de](http://www.solites.de)). Presentation at the PREHEAT Symposium at Intersolar 2007, Freiburg, Germany, June 2007.
- [4] Henninger, Ellehauge et. al., 2008, Heat Storage Technologies Markets, Actors, Potentials, from the PREHEAT project, funded by the Intelligent Energy – Europe programme ([www.preheat.org](http://www.preheat.org)).
- [5] PlanEnergi (Danish company; [www.planenergi.dk](http://www.planenergi.dk)), which has been involved in several pit heat storages in Denmark and internationally.
- [6] Schossig, 2008, Technologies for thermal energy storage, presentation at the “Third International Renewable Energy Storage Conference (IRES 2008)”, Berlin, November 2008, Fraunhofer Institut, Solare Energiesysteme.

- [7] “HeHo - Heat Storage in Hot Aquifers”, Four-year research project supported by the Danish Council for Strategic Research (2011-2015).
- [8] Schmidt, 2019, Brædstrup District Heating Monitoring Data Evaluation for the Years 2014-2017
- [9] Solar Heating Plants in Denmark, Simon Furbo, Bengt Perers and Federico Bava, Department of Civil Engineering, Technical University of Denmark
- [10] PlanEnergi et. Al., 2015, Sunstore 3, Final Report for EUDP 2009 projects 64009-0043 and 64010-0447.
- [11] Solites, <http://www.solites.de/> Personal communication, 2017
- [12] Danish Energy Agency, 1988, Energy Technology Catalogue 38.01
- [13] Sørensen, P. A. & Schmidt, T. (2018). Design and Construction of Large Scale Heat storages for District Heating in Denmark. 14th International Conference on Energy Storage, 25-28 April 2018, Adana, Turkey
- [14] Schmidt, Sørensen (2018). Monitoring Results from Large Scale Heat storages for District Heating in Denmark. 14th International Conference on Energy Storage, 25-28 April 2018, Adana, Turkey, Design Aspects for Large-Scale Aquifer and Pit Thermal Energy Storage for District Heating and Cooling
- [15] Vang Jensen, Morten (2014). Seasonal pit heat storages – Guidelines for design of seasonal pit heat storages, SHC Task 45 Large Systems, Guidelines <http://task45.iea-shc.org/fact-sheets>
- [16] Schmidt 2019. Dronninglund District Heating Monitoring Data Evaluation for the Years 2015-2017
- [17] Rambøll, consultancy, which has been involved in several pit heat storages in Denmark and internationally.
- [18] Pauschinger, T. et al. Design Aspects for Large-Scale Aquifer and Pit Thermal Energy Storage for District Heating and Cooling. IEA-DHC Annex XII, March 2020.
- [19] Sørensen, P. A. et al. Design and Construction of the Pit Thermal Energy Storage in Høje Taastrup, 2023.
- [20] IEA Task 39, HT-ATES Factsheet - High Temperature Aquifer Thermal Energy Storage (HT-ATES) - <https://topsectorenergie.nl/documents/987/Factsheet-HT-ATES.pdf>
- [21] Aalborg CSP. PTES supplier that has delivered new lids to Sunstore 3 and Sunstore 4, and delivered the lid in Høje Taastrup.
- [22] Sørensen, Stig Niemi: personal consultation about ATES in Denmark
- [23] Sørensen, From, Wetzel, Sifnaios, Jensen [2024] Design, implementation, and monitoring results from the 70,000 m3 pit thermal energy storage (PTES) in Høje Taastrup, Copenhagen - Enerstock Conference, Lyon, France, 5.-7. June 2024
- [24] Peham et. al 2024. Lifetime assessment of pit thermal energy storages based on various polyolefinic liner materials

**Definitions [14]**

Storage efficiency: 
$$\eta_{TES} = \frac{Q_{DC} + dQ_{int}}{Q_{CH}}$$

Storage cycles number: 
$$CN = \frac{Q_{DC}}{Q_{CAP}}$$

Heat capacity: 
$$Q_{CAP} = V_{TES} \cdot \rho \cdot c_p \cdot (T_{max} - T_{min})$$

Storage heat loss: 
$$Q_{loss} = Q_{CH} - Q_{DC} + dQ_{int}$$

- With  $Q_{DC}$ : heat discharged from the storage  
 $Q_{CH}$ : heat charged into the storage  
 $Q_{loss}$ : thermal losses of the storage  
 $dQ_{int}$ : internal energy change of the storage within the considered period  
 ( $dQ_{int} < 0$  if energy content is lost within the period)  
 $Q_{CAP}$ : heat capacity of the storage  
 $V_{TES}$ : volume of thermal energy storage (TES)  
 $\rho$ : density of storage medium  
 $c_p$ : specific heat capacity of storage medium  
 $T_{max} / T_{min}$ : maximum / minimum temperatures in the storage

## 141 LARGE-SCALE HOT WATER TANKS

### Contact information

Danish Energy Agency: Filip Gamborg

Energinet.dk: Rune Duban Grandal

Author: Max Guddat, PlanEnergi

### Publication date

November 2018

### Amendments after publication date

Date	Ref.	Description

---

### Brief technology description

Thermal storage options can be split into three different technologies [1]:

1. Sensible stores, which use the heat capacity of the storage material – mainly water for its high specific heat content per volume, low cost and non-toxic medium.
2. Latent stores, which make use of the storage material's latent heat during a solid/liquid phase change at a constant temperature.
3. Chemical stores, which use the heat stored in a reversible chemical reaction. Sorption stores, which use the heat of ad- or absorption of a pair of materials such as zeolite-water (adsorption) or water-lithium bromide (absorption), are examples of chemical stores.

The market is dominated by sensible hot water storage vessels due to the qualities, the cost, the simplicity and the versatility of water as a storage medium. Sensible stores may be constructed as steel, concrete or glass-fibre reinforced plastic tanks.

Sensible stores in context of this catalogue are typically insulated on-surface steel-constructions on a concrete foundation. They are connected to a district heating network and supplied with an inlet nozzle at the top and an outlet nozzle at the bottom for charging. The cycle is reversed for discharging. A tank may be supplied with more nozzles than the essential two, to increase the possibility of layering (and hence more efficient storage of heat less than nominal storage capacity).

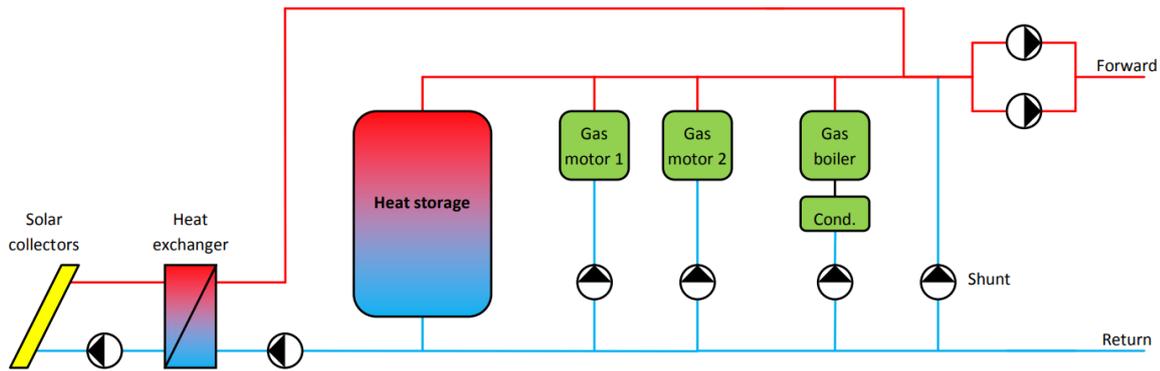


Figure 1: Principal scheme of the hydraulic integration of a large scale water tank in a simple district heating system [6].

### Application in Danish District Heating Systems

In recent decades, steel tanks have been used as short-term storage in connection with most combined heat and power plants and for almost all biomass-heating plants in Denmark to control operation and to reduce emissions. Most of the installed tanks at small-scale CHP-plants were designed for operation of the CHP-plants according to the 3-part electricity tariff, which no longer applies. Water tanks are also applied in larger district heating systems, supplied by centralised CHP-plants, and in district heating systems with heat-only heat production. The application of water tanks is changing from a role defined by the demand of the electricity market to facilitating fluctuating renewable energy production e.g. solar thermal. [2]

The total volume of water tanks in Danish district heating systems was in 2013 approx. 875,000 m<sup>3</sup>, located on 284 district heating plants [2], with a typical tank capacity being 500-5,000 m<sup>3</sup>.

To increase energy efficiency in storage systems, it is often chosen to fill the large-scale water tanks with district heating water, i.e. treated water at pH 9.8, which impedes corrosion. Alternatively, tanks can be filled with pH-neutral water, which however necessitates an additional heat exchanger and pressurization of the tank, to avoid corrosion.

### Energy efficiency

Steel tanks for hot water storage are a well-established technology. Typically, a steel tank for diurnal use in district heating applications is insulated with about 300 mm insulation (mineral wool), but for long-term storages, 450 mm may be more suitable [3].

The size and height/diameter factor also influence the heat loss. A theoretical calculation of three different sizes (500, 1,000 and 5,000 m<sup>3</sup>) with a height/diameter factor of 1.8 shows heat losses of 2.1 %, 1.7 % and 1.0 % per week at 90°C water temperature and 0°C outside temperature, 10 m/s wind and 300 mm insulation [2].

### Input

Hot water, max. approx. 95°C. If the tank is pressurized higher temperature can be obtained. Eg. 100-120°C

## Output

Hot water.

## Typical capacities

Typical capacities vary by the district heating plant. Sizes of 500-5,000 m<sup>3</sup> are very common for this purpose in a Danish district heating context, with an average tank size of approx. 3,000 m<sup>3</sup>. [2]

The estimated energy capacity in the Danish district heating system in 2017 is 56 GWh, based on an assumption of a temperature difference of 55K. However, in practice, only approximately 90 % can be utilized, and the available total capacity is therefore approximately 50 GWh. [2]

The capacity of the tanks in terms of energy depends on the temperature difference and therefore also the temperature levels. The change of production technology towards e.g. heat pumps and solar thermal results in lower temperatures (e.g. 70-80°C), whereas the temperature is higher (e.g. 90-100°C) if the heat is produced on e.g. a CHP-plant. Hence, the capacity of the tanks in terms of energy is likely to be reduced, depending on the heat production technology. [2]

## Typical Storage Period

The typical storage period depends on the heat demand and varies from a few hours to approx. two weeks. Additionally, water tanks can be used for covering peak demands, i.e. to cover morning and evening peaks by charging the tank in the night and throughout the day.

In smaller district energy systems, large-scale water tanks can be used for seasonal storage, when the desired storage capacity is too small to necessitate e.g. a pit thermal energy storage (cf. Seasonal Heat Storage, chapter 60). For storages up to approx. 10,000 m<sup>3</sup> storage volume, steel tanks have generally proven to be more cost-effective than e.g. small-scale pit heat storages.

## Regulation ability and other system services

N.A.

## Space Requirements

With a typical ratio height:diameter of 1:1.5-2.5 the space requirements for a steel tank with 300 mm insulation, 55K temperature difference, 40 m<sup>2</sup> for piping and service area and 90 % availability are as follows:

Storage volume	m <sup>3</sup>	1000		3000		5000	
Storage capacity	MWh	58		173		288	
Ratio h:D		1.5	2.5	1.5	2.5	1.5	2.5
Space requirements	m <sup>2</sup>	71.9	67.3	85.1	78.4	93.1	85.1
Space requirements	m <sup>2</sup> /MWh	1.25	1.17	0.49	0.45	0.32	0.30

Table 1: Space requirements for examples.

## Advantages/disadvantages

Advantages:

- Well-known technology
- Increases short-term flexibility of operation in district heating plants

- Can in some cases keep the pressure in district heating systems
- Cost-effective storage of heat
  - The most cost-effective storage medium for thermal energy storage at low (0 - 20°C) to medium (20 - 100°C) temperature is water, because it is relatively cheap, environmental friendly and convenient material. Furthermore, water has, compared to other common storage materials, a very high specific heat capacity as well as a very high volumetric heat capacity and possibility of temperature stratification.
- Low investment cost

Disadvantages:

- Space requirements
- Energy losses
- N<sub>2</sub> or steam is necessary as protection against oxygen for corrosion protection in pressure less tanks

### Environment

Large tanks may have an influence on the surrounding landscape. However, as they are typically installed next to district heating plants, this influence is assessed to only have little impact.

The risk of leakage of treated water is a possible environmental threat. However, major leakages happen very seldom.

### Research and development perspectives

The research and development of large steel tanks in Danish district heating systems is assessed to be limited to adjusted operation strategies of the existing technological solutions. This includes:

- Operation at lower temperatures and temperature differences in district heating grids, resulting in lower energy content per water volume.
- Use of large tanks for cooling storage.
- Using one tank for storage at different temperature levels to accommodate the optimal supply temperatures for heating and cooling purposes.

### Examples of Market Standard Technology

Large scale water tanks are installed in approx. 280 district heating systems [2] and are thus widely applied.

Prediction of performance and costs

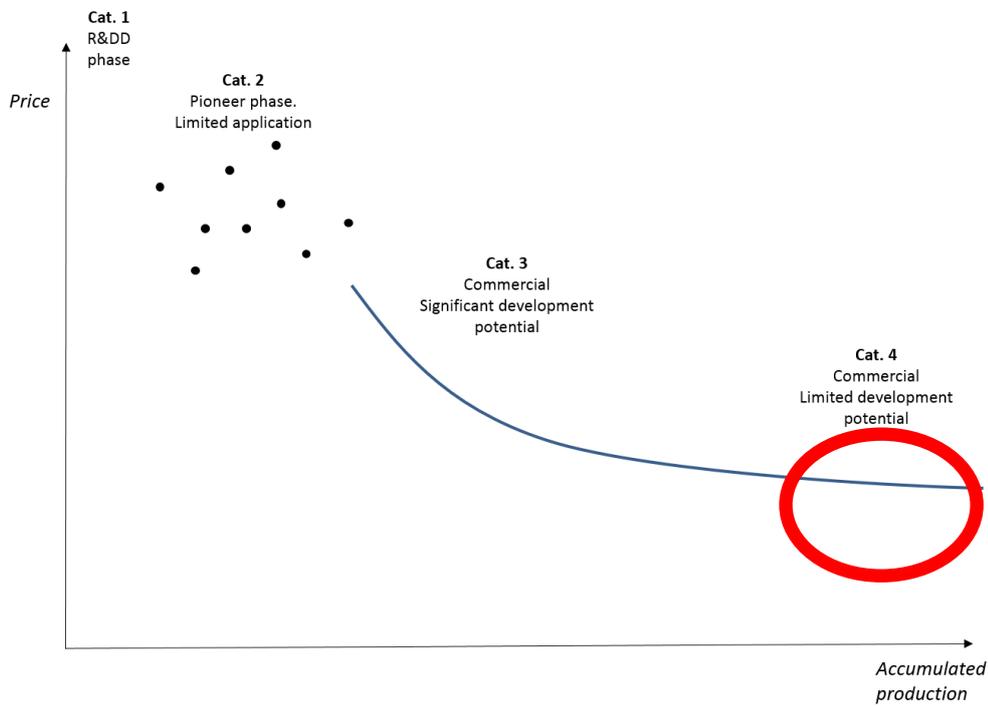


Figure 2: Technological development phases. Correlation between accumulated production volume (MW) and price.

Large-scale water tanks are a mature and proven technology; hence, the technology is in category 4 “Commercial”. The development potential comprises storage at different temperature levels.

Additional remarks

Economy of scale

Large-scale water tanks are characterized by a considerable effect of economy of scale. Cf. Figure 3, the unit price is best described in an exponential formula, as stated in note H in Section 0. However, as Figure 3 only indicates the change in CAPEX for the given sizes, it must be noted that the optimal size of a water tank must be evaluated over the total lifetime of the tank, including the benefits for operation flexibility it may contribute with in the specific energy system that the tank is installed in.

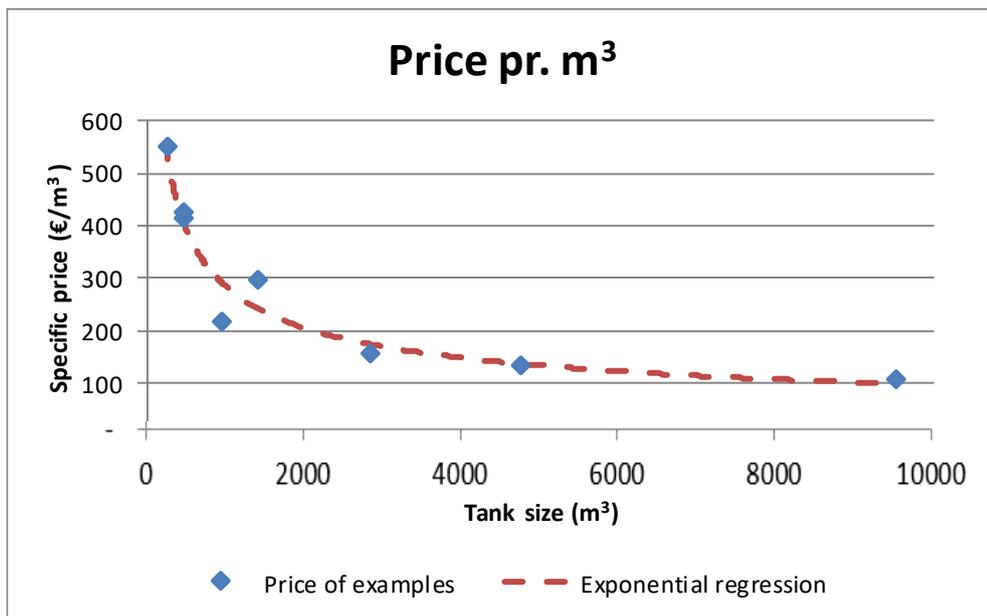


Figure 3: Specific price pr. m<sup>3</sup> by total size of tank, incl. foundation [2 & 4].

Quantitative description

Technology	Large-Scale Hot Water Tanks (steel)										
	2015	2020	2030	2040	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref
<b>Energy/technical data</b>						Lower	Upper	Lower	Upper		
Form of energy stored	Heat										
Application	System										
Energy storage capacity for one unit (MWh)	175	175	175	175	175	45	315	45	315	A	
Output capacity for one unit (MW)	2.9	2.9	2.9	2.9	2.9	0.8	5.3	0.8	5.3	B	7
Input capacity for one unit (MW)	2.9	2.9	2.9	2.9	2.9	0.8	5.3	0.8	5.3	B	7
Round trip efficiency (%)	98	98	98	98	98	96	99	96	99	J	2
- Charge efficiency (%)	100	100	100	100	100	100	100	100	100	C	
- Discharge efficiency (%)	100	100	100	100	100	100	100	100	100		
Energy losses during storage (% / day)	0.2	0.2	0.2	0.2	0.2	0.14	0.24	0.14	0.24		2
Auxiliary electricity consumption (% of output)	1	1	1	1	1	0	1	0	1	D	7
Forced outage (%)	0	0	0	0	0	0	3	0	3		7
Planned outage (weeks per year)	1	1	1	1	1	0	4	0	4	E	7
Technical lifetime (years)	40	40	40	40	40	30	50	30	50	F	2
Construction time (years)	0.5	0.5	0.5	0.5	0.5	0.5	1.0	0.5	1.0	G	7
<b>Financial data</b>											
Specific investment (ME2015 / GWh <sub>Capacity</sub> )	3.0	3.0	3.0	3.0	3.0	2.2	8.0	2.2	8.0	H	2, 7
- hereof equipment (%)	70	70	70	70	70	70	70	70	70		7
- hereof installation (%)	30	30	30	30	30	30	30	30	30		7
Fixed O&M (€2015/MWh <sub>Capacity</sub> /year)	8.6	8.6	8.6	8.6	8.6	5	33	5	33	E	7
Variable O&M (€2015/MWh <sub>output</sub> )	0	0	0	0	0	0	0	0	0	I	7
<b>Technology specific data</b>											
Tank volume of example (m <sup>3</sup> )	3,000	3,000	3,000	3,000	3,000	1,500	5,000	1,500	5,000		
Typical temperature difference in storage (hot/cold, K)	55	55	55	55	55	30	60	30	60		

Notes:

- A Considering a temperature difference of 55K (hot/cold), 90% availability.
- B Considering a full charging cycle of 60 hours (2.5 days), cf. traditional application of steel tanks in Danish DH-plants. The capacity is practically limited by the available pipe dimensions for charge/discharge and the number of installed valves in the tank (in order to increase flow at same low turbulence).
- C As tanks are typically connected directly to the district heating supply/return hydraulic system, there is no loss due to the dis-/charging.
- D Less than 1 % of the stored energy for circulation pumps and N<sub>2</sub>-production.
- E The Fixed O&M is set according to capacity of the Energy Storage specified in the top of the table. Corresponding to approx. 1500 €/tank/year. Typically limited to one inspection/year using a diver, if any at all.
- F Primarily limited by the extent to which the system is held corrosion-free.
- G Installation period for approval by authorities, site preparation, welding, connection, cleansing, initial filling and insulation. Additional delivery time for steel may apply.
- H CAPEX for large-scale water tanks are best described in a formula, due to significant impact of economy of scale. For 2015, the following equation is used to estimate the CAPEX in € pr. m<sup>3</sup>, based on data as presented in Figure 61.2: 7450\*V<sup>-0.47</sup>, V=Water Volume of tank in m<sup>3</sup>. Development in CAPEX depends primarily on the development in steel prices.
- I Only variable O&M is electricity consumption for pumps and N<sub>2</sub>-production as specified above.
- J Total efficiency during a one year cycle, including losses during storage period.

References:

- 2 PlanEnergi, Teknologisk Institut, GEO & Grøn Energi, 2013, Udredning vedrørende varmelagrings teknologier og store varmepumper til brug i fjern-
- 7 PlanEnergi, references from various projects in Danish district heating systems.

## References

- [1] Energinet.dk, Energistyrelsen, 2015, Technology Data for Energy Plants – Generation of Electricity and District Heating, Energy Storage and Energy Carrier Generation and Conversion. 2015-version of the catalogue at hand.
- [2] PlanEnergi, Teknologisk Institut, GEO & Grøn Energi, 2013, Udredning vedrørende varmelagringsteknologier og store varmepumper til brug i fjernvarmesystemer, November 2013, available at [https://ens.dk/sites/ens.dk/files/Forskning\\_og\\_udvikling/udredning\\_om\\_varmelagringsteknologier\\_og\\_store\\_varmepumper\\_i\\_fjernvarmesystemet\\_nov\\_2013.pdf](https://ens.dk/sites/ens.dk/files/Forskning_og_udvikling/udredning_om_varmelagringsteknologier_og_store_varmepumper_i_fjernvarmesystemet_nov_2013.pdf) [Last viewed 18.07.18]
- [3] Danish District Heating Association, January 2012.
- [4] Grøn Energi, 2017, Personal Communication
- [5] Pedersen, AS, Elmegaard, B, Christensen, CH et. al. 2014, Status and recommendations for RD&D on energy storage technologies in a Danish context, 2014
- [6] Sørensen P.A., Solar heat combined with other fuels, Solar District Heating Guidelines Fact Sheet 2.1, August 2012, available at [http://www.euroheat.org/wp-content/uploads/2016/04/SDHtake-off\\_SDH\\_Guidelines.pdf](http://www.euroheat.org/wp-content/uploads/2016/04/SDHtake-off_SDH_Guidelines.pdf) [last viewed 18.07.18]
- [7] PlanEnergi, references from various projects in Danish district heating systems.

### 142 SMALL-SCALE HOT WATER TANKS

#### Contact information

Danish Energy Agency: Filip Gamborg

Energinet.dk: Rune Duban Grandal

Author: Max Guddat, PlanEnergi

#### Publication date

May 2012

#### Amendments after publication date

Date	Ref.	Description
August 2019		Major update of text and data

---

#### Brief technology description

Hot water storage vessels in private homes are used for different purposes:

- Domestic hot water; to ensure sufficient flow for high demands such as showers and filling bath tubs. Basically a drum filled with water and equipped with a heating mechanism on the bottom or inside.
- Space heating; to increase operating periods for e.g. heat pumps and biomass boilers and hence facilitate more efficient operation of these technologies.
- As storages to facilitate shift load storage to capture the cheaper, off-peak electricity and using it at other times, effectively shifting portions of peak load to off-peak hours. Reshaping the load curve improves the utility's capacity factor and, by extension, its financial health.

For solar domestic hot water, the heat exchanger from the solar collectors is usually placed in the bottom of the store, cf. the lower coil in figure 1. Often, an extra coil is placed in the top of the store to raise the temperature by an additional heat source, when needed.

For shift load storage there is no need to have heat exchanger coils, if for example the store is a component in a closed circuit with a heat pump.

In Denmark, hot water vessels are typically made in steel, corrosion protected by enamel and an anode. Other countries also use stainless steel, which is generally found too costly in Denmark [1].

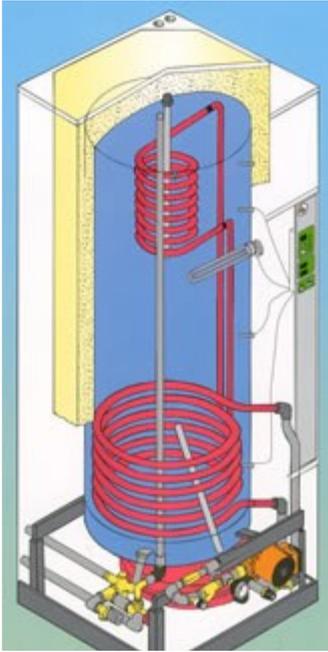


Figure 1: Typical domestic hot water store used for solar heating [1].

### Input

Hot water.

### Output

Hot water.

### Typical capacities

To store domestic hot water, the volume is often 60 - 160 litres for a single-family dwelling, depending primarily on the heat source and the hot tap water demand in the building.

For domestic solar water heaters, with no seasonal storage, the store volume needs to be around 50-65 litres per m<sup>2</sup> solar collector [4].

If a large volume is needed, the limit is often determined by the available space, e.g. in the laundry room of the dwelling. A cupboard solution, 60 by 60 cm horizontal and 2+ metres high, has a water volume of up to 300 litres due to the space utilised for insulation [4; 5].

### Typical Storage Period

The typical storage period is a few hours, facilitating appropriate operation of the heat production capacity, with close-to-constant operation of the heat source, at varying heat loads.

### Regulation ability and other system services

N.A.

### Space Requirements

Small buffer tanks come in different shapes and forms. The compact units (up to approx. 2-300 L) are usually designed as cabinet solutions (60x60 cm horizontal), to fit in utility rooms etc. Larger buffer tanks have a slightly larger horizontal (circular) footprint with a diameter of approx. 80-100 cm [5].

### Advantages/disadvantages

#### Advantages:

- Can be used as storages to facilitate shift load storage to capture the cheaper, off-peak electricity and using it at other times, effectively shifting portions of peak load to off-peak hours. Reshaping the load curve improves the utility's capacity factor and, by extension, its financial health. In the same way, decentralized production units may be operated more efficiently when combined with a storage.
- Cheap and easy to produce (millions of 50-1,000 L produced internationally each year)
- Well proven technology

#### Disadvantages:

- Comparably large footprint, partly due to insulation.
- Depending on storage temperatures, legionella bacteria inside the tank may be an issue
- May cause high return temperature in district heating systems, which results in higher energy losses. Furthermore, the possibilities for lowering temperatures are weakened in traditional systems, during the summer time, and generally in low temperature district heating systems, due to the higher flow temperatures required compared to heat exchanger sub stations.

### Environment

There is no local environmental impact from small-scale water tanks.

### Research and development objectives

Tanks with high storage density and reduced losses are key to an increased solar heat share in households. Austrian research institute AEE INTEC [3] has recently inaugurated a pilot research facility. The heart of the test facility is two low-pressure vessels filled with 750 kg of zeolite beads or spheres each.

The storage density is 180 kWh/m<sup>3</sup>, which is approx. 4-5 more than that of regular hot water buffer tanks (depending on the temperatures in the storages).



Figure 2: Zeolit storage at AAE INTEC. [3]

Challenges remain and one of them is the costs of zeolite spheres. Despite zeolites being an important component in other industries, the market price for energy purposes is comparably high, making zeolite-storages unfeasible at current conditions [2].

Improvements of storages using water as storage medium are primarily within the area of intelligent storage operation through flexible storage temperatures in (parts of) the storage tanks. For this please refer to e.g. Cabeza et. al, 2014 [7].

### Examples of Market Standard Technology

Small-scale water tanks are installed in most buildings with biomass boilers, heat pumps and/or solar thermal and many buildings with other heating sources.

### Assumptions and perspectives for further development

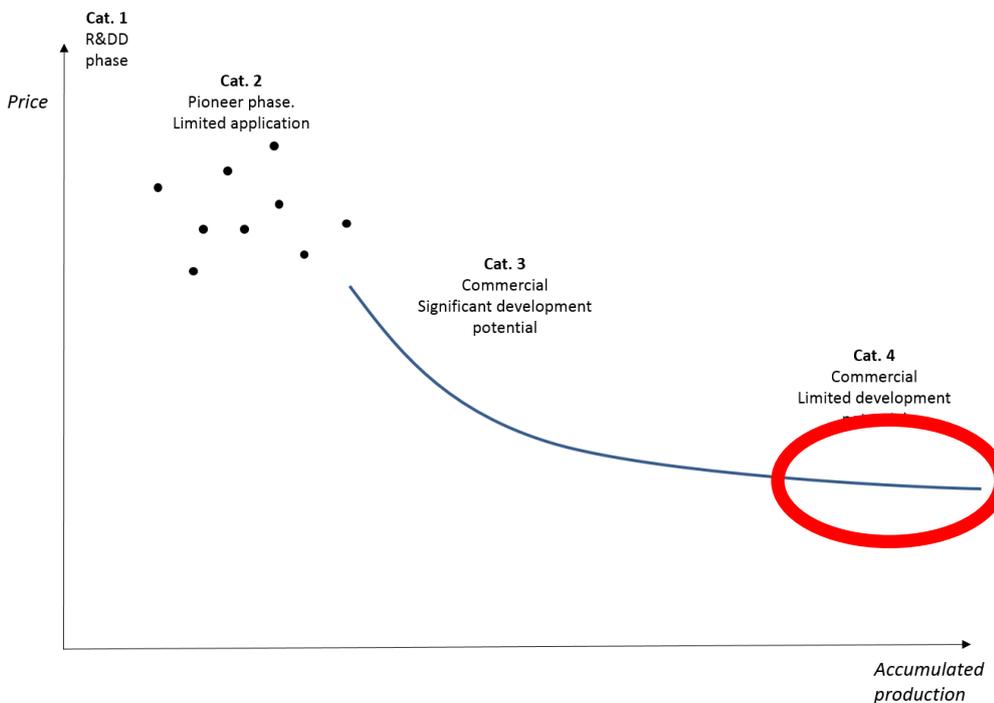


Figure 0.3: Technological development phases. Correlation between accumulated production volume (MW) and price.

Traditional water tanks are in category 4 “Commercial”, i.e. it is mature technology and there is only a limited development potential.

### Additional remarks

The heat loss coefficient for a 90 liter store insulated by 5 cm PUR-foam is about 2.1 J/s per K, and about 2.9 J/s per K, if the volume is 300 liters. The coefficient is doubled, when the insulation thickness is halved.

Further information / additional reading:

- “Potentiale og muligheder for fleksibelt elforbrug med særligt fokus på individuelle varmepumper”(Opportunities for flexible electricity demand using heat pumps in private homes), Energinet.dk, January 2011.

## Quantitative description

Technology	Small-Scale Hot Water Tanks (steel)										
	2015	2020	2030	2040	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref
Energy/technical data						Lower	Upper	Lower	Upper		
Form of energy stored	Heat										
Application	Local										
Energy storage capacity for one unit (kWh)	3	3	3	3	3	2	19	2	19	A	
Output capacity for one unit (kW)	20	20	20	20	20	10	40	10	40		5
Input capacity for one unit (kW)	20	20	20	20	20	10	40	10	40		5
Round trip efficiency (%)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	J	
- Charge efficiency (%)	100	100	100	100	100	100	100	100	100	B	
- Discharge efficiency (%)	100	100	100	100	100	100	100	100	100		
Energy losses during storage (% / hour)	2.1	2.1	2.1	2.1	2.1	2.5	1	2.5	1	I	
Auxiliary electricity consumption (% of output)	1	1	1	1	1	0	1	0	1	C	
Forced outage (%)	0	0	0	0	0	0	3	0	3		5
Planned outage (weeks per year)	1	1	1	1	1	0	4	0	4	D	
Technical lifetime (years)	30	30	30	30	30	15	50	15	50	E	5
Construction time (years)	0	0	0	0	0	0	0	0	0	F	6
<b>Regulation ability</b>											
Primary regulation (% per 30 sec)											
Secondary regulation (% per minute)											
<b>Financial data</b>											
Specific investment (€2015 per kWh)	410	410	410	410	410	510	130	510	130	F,G,L	5, 6
- hereof equipment (%)	50	50	50	50	50	40	35	40	35		6
- hereof installation (%)	50	50	50	50	50	60	65	60	65		6
Fixed O&M (€2015/tank/year)	50	50	50	50	50	25	80	25	80	D	5, 6
Variable O&M (€2015/MWh)	0.6	0.7	1	1.2	1.2	0	0.7	0	1.2	H	6
- of which is electricity costs (€/MWh)	0.6	0.7	1	1.2	1.2	0	0.7	0	1.2	K	
- of which is other O&M costs (€/MWh)	0	0	0	0	0	0	0	0	0		
<b>Technology specific data</b>											
Efficiency at typical cycle period (%)	92	92	92	92	92	97	90	97	90	I, B	
Tank volume of example (l)	90	90	90	90	90	50	300	50	300		
Typical temperature difference in storage (hot/cold, K)	30	30	30	30	30	30	60	30	60	A	8

**Notes:**

A Considering a temperature difference of 30K (hot/cold), cf. DS12897:2016 [8], and 60K for large tanks, typically for solar thermal applications.

- B As tanks are typically connected directly to the hydraulic heating system of a building, there is no loss due to the dis-/charging. The heat loss of the tank will typically be utilised as spatial heating, if the tank is mounted inside the building.
- C Less than 1 % of the stored energy for circulation pumps.
- D Typically limited to replacement of the anode for every 3 years, potentially the control unit or valves and fittings.
- E Primarily limited by the extent to which the system is held corrosion-free (the enamelling is held undamaged).
- F Installation period assessed to be 3-8 hours each for two skilled workers, i.e. the construction site is cleared/prepared, varying by the tank size.
- G CAPEX cf. a stand-alone cabinet-solution, mounted, site-clearance/preparation and removal of existing heating source/storage not included. Cost for fittings etc. approx. 10 % of total CAPEX. Additional investment for electric heater of approx. 100 € may be added if necessary.
- H Only variable O&M is electricity consumption for pumps as specified above.
- I Considering a heat loss of 60 W at temperature 65/35°C in the storage and 20°C ambient for the 90 l unit. Considering an idle/discharging cycle of total 4 hours.
- J Round trip efficiency is not applicable for seasonal storage.
- K The cost of auxiliary electricity consumption is calculated using the following electricity prices in €/MWh: 2015: 63, 2020: 69, 2030: 101, 2040: 117, 2050: 117. These prices include production costs and transport tariffs, but not any taxes or subsidies for renewable energy.
- L CAPEX is related to storage volume. I.e. an increase of temperature difference in storage yields a lower specific investment per MWh.

### References:

- 5 Metro-Therm A/S, 2019, sales department and homepage.
- 6 PlanEnergi, 2019
- 8 Danish standard, "Specification for indirectly heated unvented (closed) storage water heaters", DS12897:2016

## 143 CARNOT BATTERIES AND HIGH TEMPERATURE THERMAL ENERGY STORAGE

### Contact information

Danish Energy Agency: Emil Rasmussen, emrm@ens.dk

Author: Morten Herget Christensen mohc@teknologisk.dk

### Publication date

February 2025

### Amendments after publication date

Date	Ref.	Description
Feb 25		New chapter and datasheet

### Qualitative description

#### Brief technology description

Carnot batteries are systems that convert electricity into heat, store the heat in thermal energy storages, and convert it back into electricity. This is shown in simplified form in Figure 4.

The family of technologies covered under the term Carnot batteries is quite broad. In this description, we focus on the sub-group of Carnot batteries that store heat in sensible heat and convert it back into electricity using a Rankine cycle.

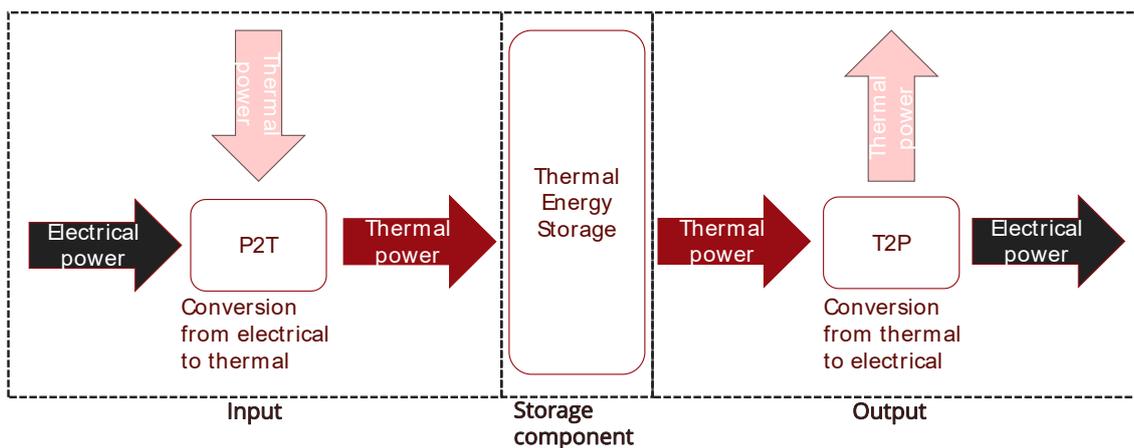


Figure 4 Typical Carnot battery (Vandersickel 2023)

In the following sections the focus of the technology description is on Carnot batteries with three main properties:

- Input conversion using resistive electrical heating.
- Sensible heat storage using molten salt or hot rocks to store at  $> 200\text{ }^{\circ}\text{C}$ .
- Output conversion using steam generators and Rankine cycle for power generation.

We also consider use cases where the steam is not used for the regeneration of electricity but is used for industrial processes. Strictly speaking, these use cases are not Carnot batteries, but they are relevant for certain business cases related to thermal energy storage.

This focus reflects the status of the Danish commercial solutions available for Carnot batteries at the time of writing and thus is not meant to exclude other potential designs that could be included in future updates as the technologies mature.

### Applications of the technology

The main use case for the type of Carnot batteries that is the focus of the chapter has been chosen to reflect the status of the most advanced pilots and demonstration plants in Denmark in autumn 2024. These are centered on replacing gas consumption for industrial applications by electrification of steam production. In such cases industrial natural gas boilers are replaced or supplemented by Carnot batteries that produce process steam or heat for industrial processes using electricity as input, as shown in Figure 5. The Carnot battery is designed to store amounts of energy, typically covering anywhere from a few hours up to two weeks of energy demand. The input power of the Carnot battery can often be designed independently of the storage and production capacity, in order to take advantage of local conditions, i.e. maximizing self-consumption of behind the meter renewable electricity or price arbitrage in electricity markets.

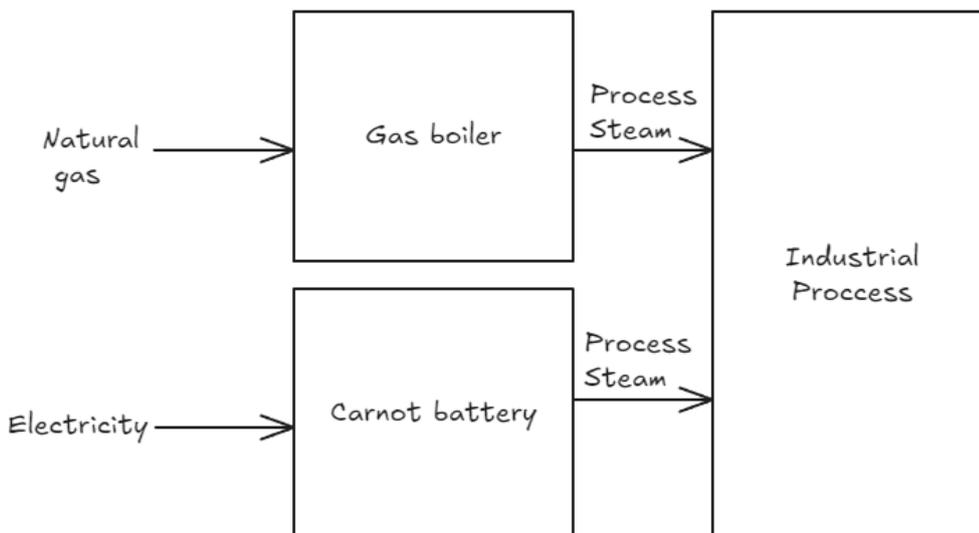


Figure 5 Replacement or supplementation of natural gas boilers by Carnot batteries

For industrial steam production the temperature requirements of the process become an important factor when considering the type of Carnot battery, as the temperature used in the thermal energy storage must

be higher than the process requirements. For industrial processes both rock-based and molten salt-based Carnot batteries can be used.

A similar use case for Carnot batteries is for the replacement or supplementation of coal or biomass in combined heat and power production as shown in Figure 6 where the steam production from the Carnot battery is used to drive a steam turbine for electricity production and heat or steam is extracted or condensed for process or district heating use. Designs have been shown that can cover the thermal needs of centralized coal- or biomass-fired power plants (>400MW) for a storage duration up to two weeks. However, the first real-world implementations outside of concentrated solar power applications still remain to be realized.

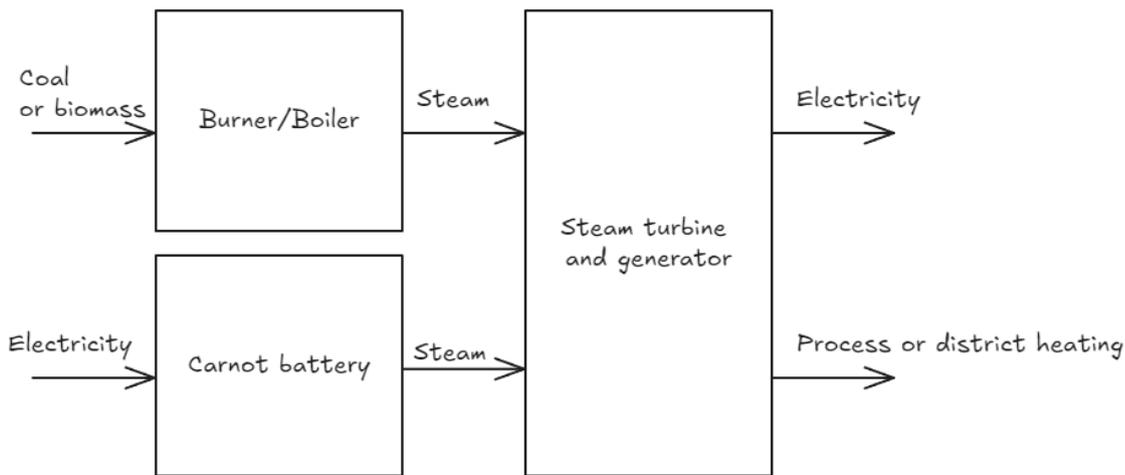


Figure 6 Replacement or supplementation of coal or biomass by Carnot batteries

For combined Heat and power applications with steam cycles, the storage temperature needs to be very high. The molten salt Carnot batteries have been shown with temperatures approaching 600 °C, while rock-based storages from Danish manufacturers have significantly lower storage temperatures. For some rock-based storage designs the heat transfer fluids limit the maximum temperature in the storage. Other designs use gas (typically air) as the heat transfer medium, allowing for rock-based storages to be operated at much higher temperatures suitable for integration in CHP plants, however for such designs it can be challenging to reach high output power, due to lower heat capacity of gases.

### Input conversion

In a Carnot battery, the main input is electricity that is converted to heat. This is typically done using resistive electric heating, this technology is commercially available for common heat transfer fluids, in a wide range of power capacities and temperature ranges.

Another configuration, that is often considered, is to include a source of “waste” or excess heat as supplement, since this can increase the overall energy efficiency and reduce the required input energy. When used in combination with High-temperature heat pumps, excess heat can be upgraded and therefore has the potential to further reduce energy input drastically. However, the current technological maturity of these is not comparable to resistive heating systems and are mainly available for pilot implementation in temperature ranges above 200 °C (IEA HPT TCP 2023). In addition, high temperature heat pump implementations generally require a source of high-quality waste heat to achieve high coefficients of

performance (COP), which means that the solutions quickly become very site-specific and not suitable for the generalized description presented here.

### Storage component

In Carnot batteries, energy is stored as heat. The Thermal Energy Storage (TES) component is a central part of the Carnot battery and a main distinguisher from electro-chemical batteries. Three main categories of thermal energy storages exist: sensible, latent and thermo-chemical.

In sensible TES, energy is stored by increasing the temperature of the storage in a single phase. Examples of sensible TES are molten salt TES or solid rock TES. The charging cycle of this type of Carnot battery is done by heating the material from the uncharged temperature to the charged temperature. Discharging is done by removing heat from the storage material and thus lowering the temperature. Normal configurations are either a single stratified tank where the charged (heated) material would tend to gather in the top, or two-tank configurations. In a two-tank configuration, the energy is stored in the hot tank. When charging or discharging, the storage medium is heated and cooled while the heat transfer medium is being pumped or pushed from one tank to the other.

Latent TES use the phase change, normally between solid and liquid forms, to store large amounts of energy. Examples are ice storage (storing cold) and liquid-solid metal TES (storing heat). In latent TES the storage material is forced to change phase (typically from solid to liquid) by heating the material during charging. When discharging the material is allowed to solidify by removing heat from material. This allows for constant discharging over a long period of time, since phase change will happen at constant temperature. A latent and sensible combination can be achieved by further increasing the temperature of the phase change material (PCM) beyond the melting point, whereafter the storage will behave as sensible heat storage.

Thermo-chemical TES uses reversible chemical reactions to achieve very high energy density. A reversible chemical reaction that generates exothermic heat is used. An example could be the evaporation of water from an inorganic salt while charging. The dried salt can be stored until the energy is required. When discharging, steam is combined with the dried salt to produce a chemical reaction that produces heat that can be extracted by conventional methods from the hydrated salt.

The three fundamental types of thermal energy storage are shown in Figure 7.

Sensible heat storage is the most common, cheapest and most technologically mature solution of the three storage types, with large scale deployment of water-based solutions being used in buildings, district heating and industrial heat application. The current deployment is mainly at temperatures up to 120 °C with sizes ranging from small domestic sized units 50kWh to very large tank-based or pit storages with more than 1000MWh of heat stored. High temperature versions are in the early stage of commercial deployment with large pilot plants being realized, typically for district heating applications or at industrial sites for process heating or heat recovery. Latent heat storages that currently exist are being demonstrated at medium high temperatures (<300 °C) and small scale industrial sizes (<1MWh).

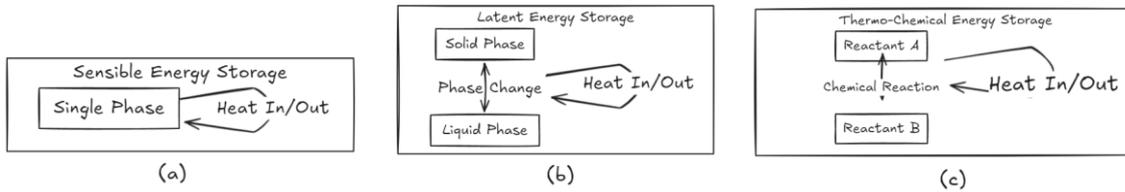


Figure 7 (a) Sensible (b) latent (c) thermochemical energy storage

### Output conversion

In the type of Carnot battery described in this chapter, the stored heat is used to generate steam, which is expanded in a turbine to drive a generator. This process is associated with conversion losses. Carnot batteries with resistive heating, where the only purpose is electricity to electricity storage, are limited to round-trip efficiencies below 40% due to the efficiencies in the turbine-generator set (Danish Energy Agency 2024). These systems have, consequently, had limited success commercially due to the need for e.g., very favorable input energy prices to secure a positive business case (Vandersickel 2023). Instead, commercial actors have shifted their focus from pure power-to-power applications towards co-generation scenarios (e.g. using refurbished co-generation plants) where the excess heat leaving the turbine is used for industrial applications or district heating, allowing for total efficiencies approaching 90% (Danish Energy Agency 2024) Thermal batteries) where the only output is heat, typically in the form of steam for industrial applications, have high conversion efficiencies above 90%.

Carnot batteries can theoretically reach very high efficiencies (Vandersickel 2023)], however this requires the use of heat-pumping technology at the input stages. Such systems are sometimes referred to as pumped thermal energy storage, analogues to pumped hydro storages. However, as mentioned above, the maturity of such systems remains low with key technical complexity to overcome.

### Energy efficiency and losses

As discussed above, the energy efficiency of a Carnot battery depends very much on the intended use case, where extra conversion steps imply extra losses that multiply to reduce overall efficiency. In addition, for the conversion steps, a range of technologies exists with varying maturity depending on the storage medium, the size of the storage and energy form, and the quality requirements. A low-temperature storage with water at atmospheric pressure would have very low thermal losses (<1% per day), however, low-temperature storage has very poor efficiency in the conversion to electricity.

In contrast, a high temperature storage based on molten salts could be used to supply high-pressure steam for a super-critical steam turbine with electrical conversion of >40%: However, the higher temperatures come with higher losses to the environment. Thus, the round-trip efficiency (power-to-power) can end up at less than 30 %.

### Regulation ability and other system services

The regulation ability of Carnot batteries is quite different from other batteries, especially since the battery is capable of simultaneously charging and discharging due to the decoupling of input and output by the

thermal energy storage. In addition, Carnot batteries are commonly designed with non-symmetric charging and discharging capacities with regulation capabilities that are very different.

**Input:** For resistive electric heating, that is commonly used as the main input conversion, the regulation capabilities are very wide ranging and extremely fast in both up and down regulation (if up or down regulation is possible). It is not uncommon for the capability of the input to be regulatable to the full rated capacity in seconds or less by turning on or turning off the system (Danish Energy Agency 2024).

The main limitation is normally in the materials, so that much like a turbine / generator system, the input part of the thermal energy storage would have to be in a hot or ready state in order to ramp up fast. Otherwise, the rapid increase in temperature could cause damage to the materials by e.g. thermal expansion.

**Output:** For a turbine-based system the regulation capabilities are determined by the turbine generator combination provided that the system is well designed with sufficient capacity of the heat exchanger and steam generator. For Carnot batteries with turbine generators for power production, the full range of power systems services are available, e.g., voltage and frequency stabilization, grid forming, inertia, as well as cold-start capabilities. The regulation capabilities of typical steam-based Rankine cycle power plants can be found in the technology catalogue for generation of electricity and district heating (Danish Energy Agency 2024).

### Typical characteristics, capacities and storage periods

Carnot batteries are designed to fill a gap between the fast cycling of electro-chemical batteries and the slower cycling of e.g., seasonal heat storage. A typical range for energy storage capacity is between 4-200 hours of storage. The input and output can often be designed independently of each other and of the energy storage capacity. Normal ranges for first-of-a-kind plants are in the range of 20-100 MW input/output power (thermal) and 200-1000 MWh storage capacity, corresponding to 10-hour storage duration. This duration is useful for e.g., day-to-night shifting of local renewable power generated by solar PV, which is prevalent in southern Europe. It could also be used for night-to-day shifting of cheap electricity from the grid in power systems dominated by wind power, for instance in the Nordic countries.

### Space requirement

Due to the high temperatures used in Carnot batteries, the energy densities are high, leading to low space requirements for the energy storage part of a Carnot battery. In addition, since thermal energy storage tanks can be built high instead of wide, compact designs are possible especially for very large energy storage capacities.

Carnot batteries have auxiliary systems (e.g. cooling, oil) that increase the footprint. For applications where the auxiliary systems are not required by other systems (e.g. in an urban setting for a district heating substation), this will significantly increase the space requirements.

### Advantages/disadvantages

The main advantage of Carnot batteries over other forms of storage is the size and expected price range that makes them suitable for “medium to long duration” storage.

Energy storage systems are typically remunerated for the energy that flows through it. Therefore, to have an acceptable economic outlook, there needs to be a reasonable balance between the number of cycles and the costs of the battery system. For an expensive battery system, you would normally need to have a high cycle

count to achieve a low levelized cost of energy. The LCOS is the (discounted) cost per unit of discharged electrical energy, i.e., more cycles equal lower LCOS. This has led to fast-acting stationary storage system, being used mainly for ancillary service provision or short-term storage, e.g., peak-shifting. Accordingly, storage durations for these battery types rarely exceed four hours of rated capacity, and the systems are designed to be cycled daily or even more often.

In the other end of the spectrum, pit thermal energy storage (See 140 SEASONAL HEAT STORAGE) have found successful application with as little as a single yearly cycle due to the several orders of magnitude reduction in cost for the energy storage part.

By leveraging the cheap storage mediums available to thermal energy storage, e.g., rocks or molten salts, Carnot batteries can offer much higher storage-to-input/output ratios at a cost where it is still possible to achieve reasonable ROI and economic fundamentals. This is particularly true if used in situations where high temperature heat or steam is required and valuable. If low grade excess heat can also be valorized, for instance in the case where district heating networks can absorb the heat, an even better business case is achievable.

The main disadvantage of Carnot batteries of the type described in this chapter is the poor power-to-power efficiency. As discussed previously, the solutions are well suited to be implemented in situations where there is a need for high-temperature heat or steam, e.g. for industrial applications or district heating. This effectively limits the application of the technology to applications like industrial co-generation or combined heat-and-power in population centers with district energy.

### Environment

Carnot batteries based on molten salts, use common materials that are widely available, and where scaling of production capabilities pose few risk and problems. Typical design use non-critical, non-toxic, non-flammable materials for the storage of energy (Hyme (MOSS) 2024), (Heliac 2024) and can be constructed with little or no use of so-called critical raw materials that are increasingly becoming a concern regarding self-sufficiency in a European context (European Commission 2024).

Carnot batteries that use rocks as the storage medium can have an even lower environmental impact and can be constructed using common and safe materials.

### Research and development perspectives

Carnot batteries have been the subject of dramatic increases in interest in the last decade, even if the principles involved have been well understood for decades. The term Carnot batteries gained popularity in the late 2010's and recent years have seen great improvements in the technology overall.

From 2020 to 2023 in the IEA Energy Storage TCP (Technology Collaboration Program), Annex 36 focused on bringing together researchers and practitioners within Carnot batteries. The annex focused on power-to-power applications and was led by the German Aerospace Center (DLR), the annex gathered 15 countries and 47 institutions, and the aim of the work was to gather the state-of-the-art from around the world (Vandersickel 2023).

The work is currently continuing in Task 44 in the IEA Energy Storage TCP, which has adopted a wider scope, including so-called “heat-integrated Carnot batteries”, to reflect that, as previously mentioned, a current limitation for the technology is the poor round-trip efficiency for power-to-power storage.

Current focus of most research and development in molten salts-based systems focus on decreasing costs by scaling towards either larger or more modularized designs, addressing potential corrosion issues that compound with increasing temperatures, and thus reducing the need for expensive nickel-based alloys for e.g. tanks and pipes.

In addition, work is ongoing on novel business models, e.g. storage-as-a-service or co-owned where problems such as allocation of costs and benefits can be challenging.

Input conversion systems have so far focused on resistive heating elements, with commercial variants available in relatively small sizes (<10 MW units) and at low voltage (<690V). To scale up, current research is looking at increasing the voltage levels significantly to directly put plants in medium or high voltage grids without the need for expensive downward transformations steps. (<https://cetpartnership.eu/calls/funded-project/locomosa>, u.d.).

For output conversion, novel heat exchanger designs are being examined to fit to the thermophysical properties of the molten salts. System designs using heat machines other than Rankine and Brayton cycle are also being investigated – however such systems are generally much less mature, in fact most proposed designs, while technically capable of being integrated with a power conversion unit (e.g., turbine generator system), are moving towards heat as being the primary or even sole output.

### **The potential for Carnot batteries as back-up power generation**

As mentioned previously, in the last few years the focus for the developers and researchers within Carnot batteries have shifted towards heat integrated or heat-only solutions. This is analogous to the developments in combined-heat-and-power plants in Denmark, where plants that were previously producing power as the primary output and district heating was a bi-product, are increasingly being replaced by heat only units such as biomass boilers, electric boilers or large heat pumps. Due to an increased number of low price or even negatively priced hours in the electricity markets, the economics of co-generation plants have been under pressure for several years. The situation is similar for a Carnot battery that could in theory be a 1-1 replacement of previous coal-, gas- or biomass-fired co-generation units. Techno-economic analysis of plant economics shows that current prices in the electricity markets alone rarely allow for a reasonable payback time for the capital-heavy plants. Thus, under current market conditions, some form of subsidy or capacity payment is often required. However, since a Carnot battery would be able to cover both extremes of increasingly volatile power prices, (energy arbitrage), this may change in the near future as the volatility is expected to increase significantly with increased penetration of intermittent renewable energy. Expected improvements in the technology, as described previously, are expected to lead to significant reductions in costs, so that future generations of Carnot batteries could play an important role in adequacy of supply and power system stability.

The trend of developers going towards lower temperature ranges to bring down costs for customers in industrial decarbonization scenarios, poses a risk that the technology will not be able to support the power systems to the extent that would be socio-economically optimal. Analysis have shown that Carnot batteries

(Long Duration Energy Storage Council; McKinsey & Company 2021) can significantly decrease overall costs in the energy transition (IEA 2021). As previously discussed, indications from the direction of both R&D and announced projects are that current market conditions will not bring to market Carnot batteries with thermal energy storages that utilize temperatures beyond 400 °C. The implication of this is that the possibility to refurbish existing co-generation plants with thermal energy storages disappears, and thus the risk of mothballed investments and loss of socio-economic value increases.

### Examples of Market Standard Technology

Carnot batteries are currently in a phase where market standards are not well established. The most advanced applications are large pilot and demonstration plants. In addition, due to the tendency of plants to be large (since a key benefit of the technology is that the cost for storage of energy is much less per unit than competing technologies), a high degree of customization is found, to tailor projects to fit well with existing infrastructure.

On the other hand, Carnot batteries are essentially an exercise of system integration of the three major components: Input conversion, thermal energy storage and output conversion. For this reason, commercial development has made great strides in a relatively short period of time since the initial spike of interest in Carnot batteries in the late 2010's.

The major reason for this is that for some parts of the system, especially the input and output conversion, mature technologies are commercially available, thus greatly reducing the technological risk.

#### **Input conversion / charging capacity:**

Resistive electric heating is available at large scale for temperature ranges approaching 600 °C for molten salts and even higher for air-based systems. Typical module sizes are up to 5MW, with the possibility to employ parallel operation of multiple heaters for increased charging capacity. As mentioned in the section on R&D perspectives, current state-of-the-art uses low voltage (up to 690V).

#### **Thermal energy storage**

Thermal energy storage is widely used in industry today, most prominently is the use of tank thermal energy storage in district energy systems. In a very broad definition, such systems could be considered a low temperature version of a Carnot battery. In tank thermal energy storage, the thermal energy is stored in hot water contained in steel tanks (See 141 Large-scale Hot Water Tanks). Pressurized versions allow for higher temperatures and greater energy density but come at greater complexity and higher cost. To reduce costs, mediums other than water are normally considered when higher temperatures are required, in order to stay at atmospheric pressure within the storage system (Pressurized tanks and systems are much more costly to design, build and operate due to the increased need for safety considerations and added strength).

Hot rocks and molten salt are two often used mediums.

Hot rocks have been considered due to their low material cost, thermal stability and high energy storage capacity. With hot rocks, an additional heat transfer medium is required, typically either thermal oil or hot

## 143 Carnot batteries and high temperature thermal energy storage

air (or steam). An example prototype from Danish firm Heliac is shown in Figure 8, and a similar concept from Siemens Gamesa from a pilot plant in Hamburg in Figure 9.

Demonstrator	Input capacity	Storage capacity	Output capacity	Location	Project status	Ref.
Rockstore prototype (Heliac)	-	1 MWh	-	Niverød (DK)	Ongoing	(Ingeniøren .dk 2023)
ETES Pilot plant (Siemens Gamesa)	5.4 MW	130 MWh	5.4 MW	Hamburg-Altenwerder (DE)	Completed	(Siemens Gamesa 2019)
GreenLab Skive (Rondo)	20 MW	100 MWh	7 MW	Skive, DK	Planned	(GreenLab 2024) (Rondo Energy 2024)



Figure 8 Rockstore prototype (Heliac 2024)



Figure 9 ETES Pilot Plant (Siemens Gamesa 2019)

Molten salt as a medium for thermal energy storage has been used in concentrated solar power plants for decades (Fernández 2019) and the use of molten salt as a heat transfer medium in nuclear reactor designs is also very well-established (LeBlanc 2010). However, historically the costs have been prohibitively high to find use outside these niche applications. However, recent years have seen commercial companies develop stand-alone molten salt storage as shown in Figure 10 and Figure 11 from Norwegian Kyoto that uses so-called solar salts, which are nitrate based and Danish Hyme that uses NaOH.

Demonstrator	Input capacity	Storage capacity	Output capacity	Location	Project status	Ref.
MOSS (Hyme, Din Forsyning)	1.3 MW	1 MWh	1.2 MW (steam)	Esbjerg, DK	In progress	(Hyme (MOSS) 2024)
2LIPP (BEOF, Hyme)	5 MW	20 MWh	1 - 5MW	Bornholm, DK	Planned	(Hyme (2LIPP) 2024)
Norbis Park Heatcube (Aalborg forsyning, Kyoto)	5 MW	18 MWh	4 MW	Aalborg, DK	Completed	(Kyoto Group 2023)
KALL Ingredients Heatcube (KALL, Kyoto)	10 MW	56 MWh	7 MW	Tiszapüspöki, HU	In progress	(Kyoto Group 2024)



Figure 10 Norbis Park Heatcube (Kyoto Group 2023)



Figure 11 Molten Salt Energy Storage (MOSS Project)

**Output conversion / discharge capacity**

Output conversion is perhaps the most well-established part of Carnot batteries, where existing turbine generators can be used for electricity generation and heat exchangers are commercially available for the temperature ranges and most heat transfer mediums.

**Prediction of performance and cost Uncertainty**

In Figure 12, the technological maturity of the components of a Carnot battery is shown.

Carnot batteries are systems of components that are technologically mature (Dansk Center for energilagring 2023), except for the thermal energy storage component. The construction and operation of Carnot batteries as an integrated system is however still new. This leads to uncertainty both current and future costs. Since Carnot batteries as a system are novel, they are expected to exhibit learning curves for their overall costs as can be seen in Figure 12 (Long Duration Energy Storage Council, McKinsey & Co. 2022). Together this implies that the overall cost of Carnot batteries will likely be significantly lower in coming years as the accumulated production increases – this will be more pronounced for the energy storage component. For the energy storage component, technological breakthroughs allowing for better handling of e.g. corrosion risks at high temperatures are also expected to have a major impact on costs, since less and cheaper materials can be used as corrosion mechanism and mitigation develop.

Increasing to higher temperatures in the storage and in applications also suggests lower maturity and corresponding higher uncertainty and current costs. In a similar manner, for high temperature applications, these are expected to have a more pronounced learning effect for the near term costs compared to lower temperature versions (Long Duration Energy Storage Council, McKinsey & Co. 2022).

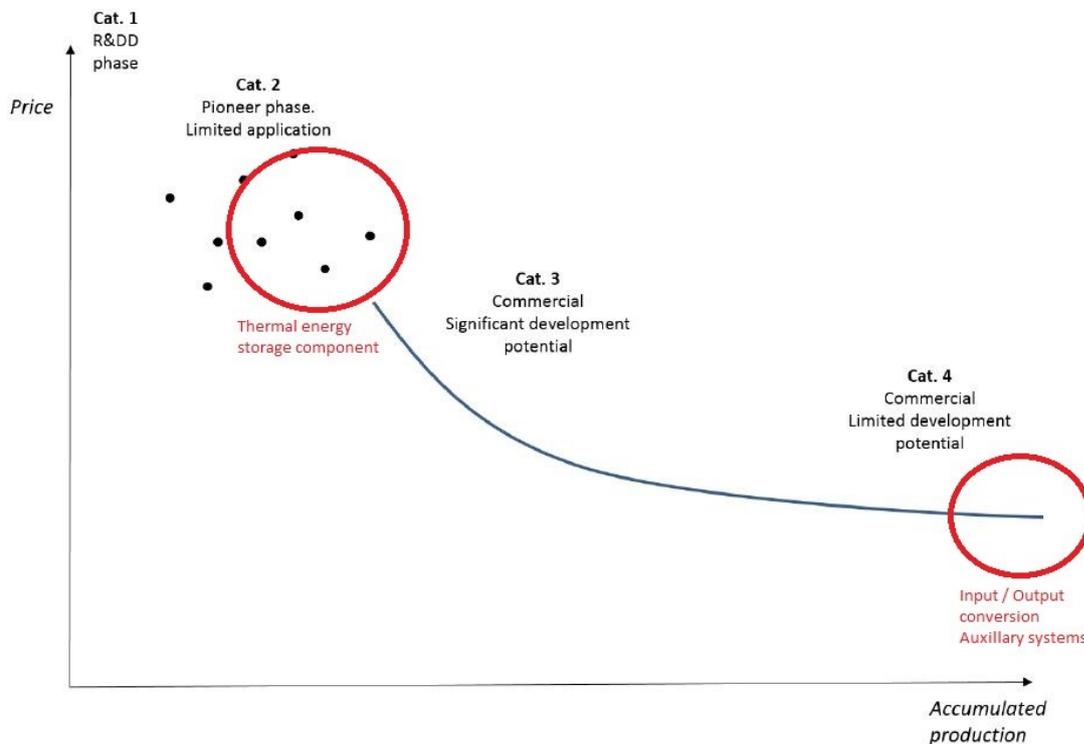


Figure 12 Technological development phase of Carnot batteries

For prediction of performance, the main uncertainty pertains to energy losses to the environment and lifetime. In general, larger installations in big tanks reduce losses, while increasing temperatures will tend to increase them. However, these kinds of losses are largely controlled by adding sufficient insulation to the tanks and pipes. Depending on the expected storage period, this becomes an optimization parameter for a particular installation and is thus rather site specific. Losses from pumping of heat transfer fluids are well known, however for some of the more unusual salts, e.g. NaOH, systematic peer-reviewed results to confirm simulation studies are still needed and thus the uncertainty here is relatively greater compared to the case of air or thermal oils used in rock-based systems.

Uncertainty regarding costs is mainly on the thermal energy storages themselves, where initial cost estimates still need to be verified when going to large scale commercial deployment, and thus the cost estimates for these should be considered as subject to significant uncertainty. In contrast, most of the supporting (Danish Energy Agency 2024) systems, as well as input and output conversion, are very mature where costs are known to a high degree of certainty.

### Quantitative description

There is a great deal of flexibility in the design and sizing of the three main components of a Carnot battery, and these can be dimensioned independently to fit a specific site or use case. The input power can be scaled so that charging times are suited for e.g., local renewable energy production from solar PV. In such cases the charging capacity can be chosen to fill the storage in 6-8 hours while maintaining constant output of process steam 24/7. In other cases, the process steam might only be required during daytime, but cheap electricity is available during the night (in areas with high penetration of wind-power).

For this reason, for many of the technical inputs, ranges are given, and the capital costs have been split into parts describing the input conversion given as cost per input power; the thermal storage given as cost per storage capacity and output conversion given as cost per output power.

To interpret the data provided in the technology catalogue correctly, an example is provided: for an industrial site, a continuous production of 15MW of process steam for a daily production of 8 hours, requiring a daily output of 120MWh. With an input power of 10MW this can be accomplished in 12 hours of daily charging. Depending on the kind of electricity available, the storage component can be sized accordingly, a storage capacity of 240MWh would allow to use the 24 cheapest hours of electricity in a 48-hour period and could thus provide significant cost savings. The same steam could be delivered by a very different type of Carnot battery with 5 times the input power of 50MW allowing full charging for a 48-hour period in only 5 hours. Such a Carnot battery would be more expensive to build but would be much better at capturing value in an electricity market with higher volatility in electricity prices (Trevisan 2022).

See excel sheet for specific data.

### References

Danish Energy Agency. 2024. *Energistyrelsen.dk*. 05 22. Accessed 05 22, 2024. <https://ens.dk/>.

- Danish Energy Agency. 2024. *Technology Data Catalogue for Electricity and district heating production - Updated April 2024*. DEA.
- Dansk Center for energilagring. 2023. *State of the nation - danske styrker energilagring*. DaCES.
- DEA. 2022. *Test*. Cph: Danish Energy Agency.
- European Commision. 2024. *Critical Raw Materials*. Accessed 10 10, 2024. [https://single-market-economy.ec.europa.eu/sectors/raw-materials/areas-specific-interest/critical-raw-materials\\_en](https://single-market-economy.ec.europa.eu/sectors/raw-materials/areas-specific-interest/critical-raw-materials_en).
- GreenLab. 2024. *Greenlab.dk*. 06 27. Accessed 11 12, 2024. <https://www.greenlab.dk/knowledge/greenlab-will-replace-natural-gas-with-green-heat/>.
- Heliac. 2024. *Heliac.dk*. 11 12. Accessed 11 12, 2024. <https://heliac.dk/solutions/rockstore/>.
- Hyme (2LIPP). 2024. *hyme.energy*. Accessed 11 12, 2024. <https://www.hyme.energy/project/foak>.
- Hyme (MOSS). 2024. *hyme.energy*. Accessed 11 12, 2024. <https://www.hyme.energy/project/moss>.
- IEA HPT TCP. 2023. *Annex 58 High-temperature Heat Pumps; Task 1 - Technologies*. Final Report, International Energy Agency Technology Collaboration Programme on Heat Pumping Technologies.
2023. *Ingeniøren.dk*. 10 11. Accessed 11 12, 2024. <https://ing.dk/artikel/staalcyindre-granitskaerver-og-olie-i-niveroed-gaar-de-efter-billig-varmelagring>.
- Kyoto Group. 2023. *Kyotogroup.no*. Accessed 11 12, 2024. <https://www.kyotogroup.no/projects/norbispark>.
- . 2024. *Kyotogroup.no*. Accessed 11 12, 2024. <https://www.kyotogroup.no/projects/kall-ingredients>.
- Long Duration Energy Storage Council, McKinsey & Co. 2022. *Net zero heat*. LDES Council, Mckinsey.
- Long Duration Energy Storage Council; McKinsey & Company. 2021. *Net-zero power - Long duration energy storage for a renewable grid*. LDES Council.
- Rondo Energy. 2024. *Rondo.com*. Accessed 11 12, 2024. <https://rondo.com/products>.
- Siemens Gamesa. 2019. *Siemens.com*. Accessed 11 12, 2024. <https://assets.new.siemens.com/siemens/assets/api/uuid:6f83e987-b0b8-4663-8a19-cd011682f9a0/3-schumacher-benefits-of-energy-transition-for-thermal-power-pla.pdf>.
- Trevisan, Silvia. 2022. "Power-to-heat for the industrial sector: Techno-economic assessment of a molten salt-based solution." *Energy Conversion and Management* (Elsevier).
- Vandersickel, Annelies. 2023. *Energy Storage TCP Task 36 Carnot Batteries - Final report*. IEA TCP Final Report, International Energy Agency Technology Collaboration Programme.

### 150 UNDERGROUND STORAGE OF GAS

This chapter has been moved from the previous Technology Data Catalogue for Electricity and district heating production from May 2012. Therefore, the text and data sheets do not follow the same guidelines as the remainder of the catalogue.

#### Brief technology description

Large volumes of gas may be stored in underground reservoirs or as liquefied gas in tanks (e.g. LNG - liquefied natural gas). This technology element is about underground storage, of which there are three principal types:

**Depleted gas reservoirs** are the most prominent and common form of underground storage. They are the reservoir formations of natural gas fields that have produced all their economically recoverable gas. The depleted reservoir formation is readily capable of holding injected natural gas. Using such a facility is economically attractive because it allows the re-use, with suitable modification, of the extraction and distribution infrastructure remaining from the productive life of the gas field which reduces the start-up costs. Depleted reservoirs are also attractive because their geological and physical characteristics have already been studied by geologists and petroleum engineers and are usually well known. Consequently, depleted reservoirs are generally the cheapest and easiest to develop, operate, and maintain of the three types of underground storage.

However, off-shore depleted gas fields are generally quite expensive.

**Aquifer reservoirs** are underground, porous and permeable rock formations that act as natural water reservoirs. In some cases they can be used for natural gas storage. Usually these facilities are operated on a single annual cycle as with depleted reservoirs. The geological and physical characteristics of aquifer formation are not known ahead of time and a significant investment has to go into investigating these and evaluating the aquifer's suitability for natural gas storage.

**Salt caverns** allow no gas to escape from storage. The walls of a salt cavern are strong and impervious to gas over the lifespan of the storage facility. Once a suitable salt feature is discovered and found to be suitable for the development of a gas storage facility a cavern is created within the salt feature. This is done by the process of cavern leaching. Fresh water is pumped down a borehole into the salt. Some of the salt is dissolved leaving a void and the water, now saline, is pumped back to the surface. The process continues until the cavern is the desired size. Once created, a salt cavern offers an underground natural gas storage vessel with very high deliverability. Cushion gas requirements are low, typically about 33 percent of total gas capacity.

### Input

Underground storage is primarily used for natural gas (almost pure methane, CH<sub>4</sub>), but other gasses may also be stored underground.

That may include hydrogen (H<sub>2</sub>), but the surface facilities need be designed differently, as hydrogen is much more explosive and also aggressive towards steel structures. The costs of storing hydrogen would be larger, since the heating value per volume is about three times less (cf. Technology element 42).

If biogas (approx. 65 % CH<sub>4</sub> and 35 % CO<sub>2</sub>) is to be stored underground, it would be instrumental to remove the CO<sub>2</sub> before storage. This is because stores are always wet, i.e. containing some water, and CO<sub>2</sub> in contact with water becomes acidic, posing potential problems for the surface facilities. Also, the energy density will be increased, when the CO<sub>2</sub> is removed.

### Output

Same as input gas, but it will have to be cleaned before usage, e.g. water has to be removed.

### Typical capacities

The characteristics of gas storage differ depending on the geological properties of the reservoir, which in turn define their use [2]:

	Depleted field	Aquifer	Salt cavern
Working gas volume <sup>5</sup>	High	High	Relatively low
Cushion gas	~50 %	~80 %	~30 %
Injection rate*	Low	Low	High
Withdrawal rate*	Low	Low	High

\*as compared to working gas volume

Working gas is the volume of gas that can be extracted during an operation of a facility.

Cushion gas (or base gas) is the share of residual gas that needs to be maintained to ensure appropriate reservoir pressurization.

Using highly sophisticated technology, depths of up to 3,000 m are made accessible and cavern diameters of 60 to 100 m, heights of several hundred meters, and geometrical volumes of 800,000 m<sup>3</sup> and more can be realized today [1].

### Regulation ability

The short-term regulation characteristics of an underground gas store are not relevant for the overall gas system, as the gas transmission and distribution pipelines normally have substantial storage capacity (so-called line pack). If, for example, a power plant wishes to start up from zero to full load in a moment, the

---

<sup>5</sup> A depleted field is often above 1 billion m<sup>3</sup>, an aquifer store from around 0.3 – 0.4 to above 1 billion m<sup>3</sup>, and salt caverns about 35 – 100 million m<sup>3</sup> per cavern. There are several caverns in one store.

required gas volume is ready by the gate. The gas pressure in the pipeline will drop a little, much within the operational limits, and the pressure will soon rebuild by drawing gas from other parts of the system, incl. underground stores.

The primary regulation values of underground gas stores are as seasonal stores (gas production is fairly constant, while summer demand is much lower than winter demand) and as back-up supply-security in cases of emergency.

### Examples of best available technology

The total gas storage capacity in Europe is around 67 billion m<sup>3</sup>. Of 125 storage facilities analyzed by Gas Storage Europe, 64 % were depleted fields, 26 % salt caverns, 8 % aquifers and 2 % LNG peak shaving [3].

Example, aquifer reservoir: Stenlille, Denmark. Gas is stored in porous water-saturated sandstone approx. 1.5 km below surface. Total gas volume 1.5 billion m<sup>3</sup>, working gas 0.6 billion m<sup>3</sup>.

Example, salt caverns: Lille Torup, Denmark. Gas is stored in 7 caverns 1-1.7 km below ground. Each cavern is 200-300 metres high and 40-60 metres in diameter. Total gas volume 0.7 billion m<sup>3</sup>, working gas 0.44 billion m<sup>3</sup>. The store can extract 8 million m<sup>3</sup>/day and inject about half this flow.

### References

- [8] Deep Underground Engineering ([www.deep.de](http://www.deep.de)).
- [9] "Underground Natural Gas Storage: ensuring a secure and flexible gas supply", presentation by Jean-Marc Leroy, President of Gas Storage Europe (a sub-division of Gas Infrastructure Europe; [www.gie.eu.com](http://www.gie.eu.com)), January 2011.
- [10] Gas Storage Europe's "Investment Database", February 2010 ([www.gie.eu/maps\\_data/GSE/database/index.asp](http://www.gie.eu/maps_data/GSE/database/index.asp)).

## Data sheet

### Cavern leaching

Plant for cavern leaching	Mill. €
Total	9.9

### Establishment of one cavern, 100 million Nm<sup>3</sup> (approx. 1.1 TWh)

	Mill. €
Construction and equipment	22
Cushion gas for one cavern (40% of total)	14
Total cost, 100 mio Nm <sup>3</sup> active volume	36

### Process equipment; injection 200,000 Nm<sup>3</sup>/hour (approx. 2200 MW), withdrawal 600,000 nM<sup>3</sup>/hour (approx. 6600 MW)

	Mill. €
Construction work	2.8
Compressors, incl. auxiliaries	30
Udtrækstog	13
Withdrawal equipment	4.5
Connections, transformer, regulation, and instruments	13
Total investment cost	63

A new greenfield store, equivalent to Lille Torup in Denmark, would require one leaching plant, 5 caverns, and one process plant.

Total investment cost 254 mill. €

### Operation and maintenance, salt cavern, 400-500 million m<sup>3</sup> working gas

	Mill. € per year
Electricity	0.7 - 1.1
Gas consumption to reheat extracted gas	0.13
Total, incl. administration	6.5

### 151 HYDROGEN STORAGE

#### Contact information

Jacob Hjerrild Zeuthen Danish Energy Agency

#### Authors:

Rasmus Rode Mosbæk, Hybrid Greentech ApS

Megha Rao, Hybrid Greentech ApS

Chronis Chochlidakis

Erasmus Rothuizen, Hybrid Greentech ApS

#### Publication date

January 2020

#### Amendments after publication date

Date	Description
2.01.2020	New chapter published. The old brief description of hydrogen storage has been deleted

#### Brief technology description

##### Hydrogen as an energy carrier

Hydrogen is currently being used in a wide range of applications, mainly for industrial purposes in chemical production and refining. Today, more than 95% of its production globally (96% in 2008, [1]) comes from hydrocarbons and mainly from reforming of methane. However, hydrogen has been seen as a mean for energy storage of renewable energy surplus since the 1920s [2]. It has recently drawn a lot of attention due to the rapid spreading of the renewable energy industry all around the world and due to the steady growth of the hydrogen fuel cells industry. Large scale hydrogen production from surplus of renewable energy sources is believed to help sector coupling in the energy-supply system with power-to-gas and power-to-fuel technologies [1]. Moreover, technologies running on hydrogen (applications in the transportation sector, energy production sector etc.) will be a significant part for the green energy transition.

Hydrogen is the most abundant element in the universe, making up for more than 90% of all known matter. It is also the simplest element, consisting of only one proton and one electron, making it the smallest and lightest element of the periodic table. Its small size and its properties make hydrogen difficult to store in large quantities. Typically, hydrogen is stored as hydrogen gas (H<sub>2</sub>). Hydrogen is also a suitable storage medium owing to its high gravimetric energy density of 120 MJ/kg or 33.33 kWh/kg [3]. This can be further seen in Figure 1. Different storage technologies are compared based on storage capacities and timescales. For a large-scale storage, in particular, hydrogen can serve valuable while batteries are more suitable for small scale storage. However, due to its molecule size, its volumetric energy density is comparatively low at 2.8-4.7 MJ/L or 0.78-1.31 kWh/L [4] when it is pressurized between 350-700 bar. At atmospheric pressure the energy density is only 0.012 MJ/L or 0.003 kWh/L and for this reason hydrogen must be pressurized for energy

storage purposes. This low volumetric energy density has pushed the industry to develop different methods and technologies for small, medium and large-scale hydrogen energy storage which will be explained in the following sections.

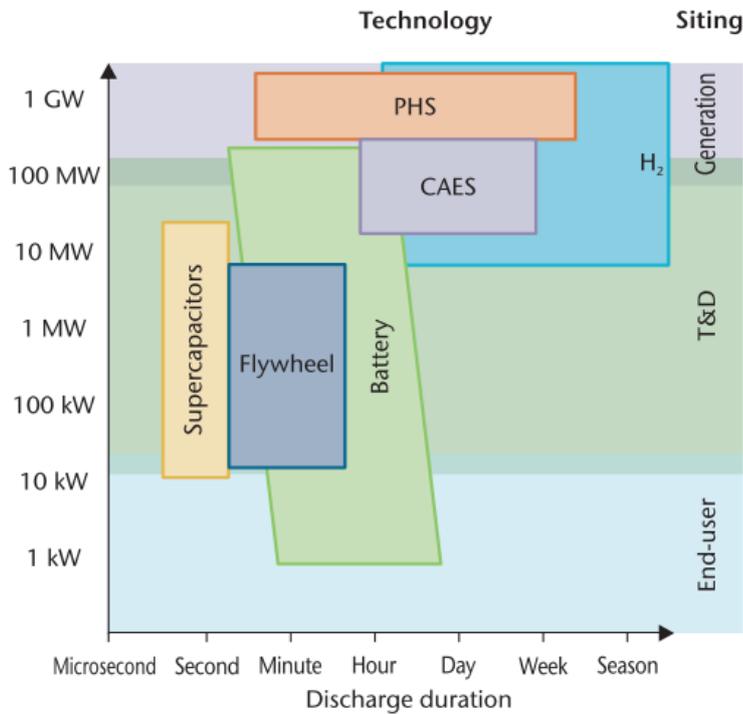


Figure 13: Electricity storage technologies [5]

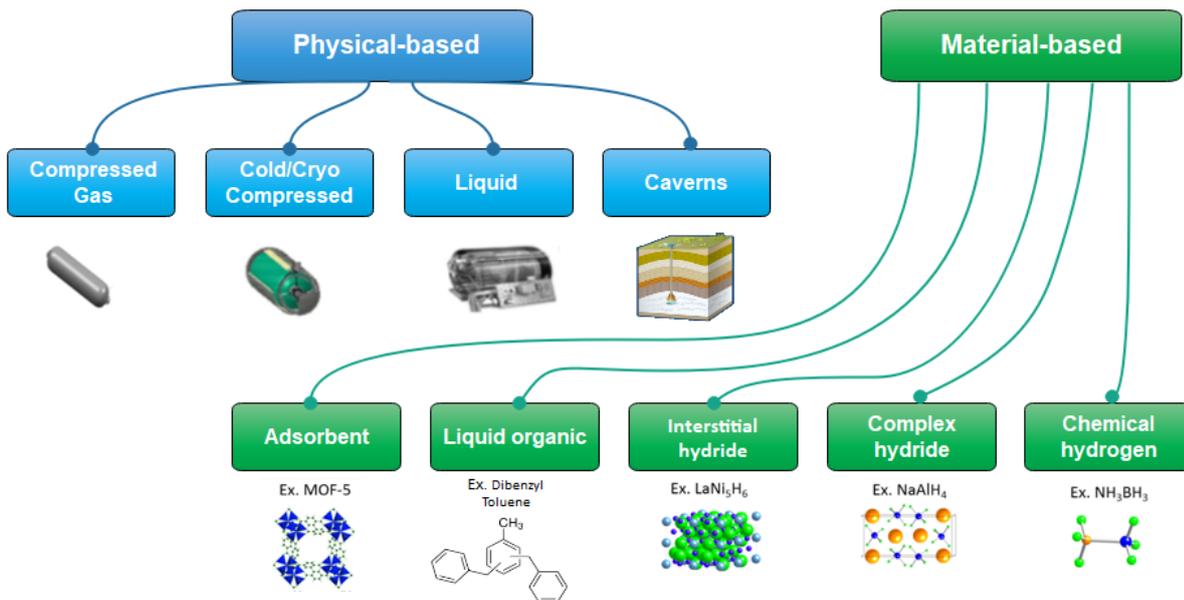


Figure 14: Hydrogen storage categories (icons from [6])

### How can hydrogen be stored?

State-of-the-art technology for hydrogen storage in bulk is observed in the form of hydrogen tanks. For instance, hydrogen is used mainly in chemical industries and specifically in steel making where the pressurized hydrogen stored in tanks is utilized. Caverns are useful for long-term large-scale storage. However, only a few caverns for hydrogen storage exist currently.

The most important hydrogen storage methods and technologies can be divided into two main categories: Physical-based and Material-based hydrogen storage, with each having different technologies as shown in Figure 2. Some of them are industrialized, reliable and proven over lengthy periods of time, while others are promising state-of-the-art experimental technologies.

### Physical-based hydrogen storage

Physical-based hydrogen storage technologies include methods based on compression cooling or a combination of the two for storing the hydrogen into some form of vessels [7]. These vessels can be either man-made pressurized tanks and salt caverns or naturally occurring aquifers. The principle behind all the different forms of physical storage relies on storing compressed/cooled hydrogen in gaseous or liquid form in a vessel-like contraption.

In the case of *hydrogen gas*, it is being compressed and stored either at low pressure (up to 45 bar), at medium pressure (up to 500 bar) or at high pressure (up to 1,000 bar or even more) into hydrogen storage vessels. For the pressure ranges medium and high, there is a temperature gradient inside the vessel due to the heat of compression and the hydrogen may need to be cooled to prevent the failure of the materials of the vessels. This is typically observed in hydrogen fueling stations for hydrogen fuel cell cars. For hydrogen storage in the fueling stations, many low-pressure tanks operating at ambient temperatures are utilized. The hydrogen stored as such is then compressed to high pressure and stored in tanks. This pressurized hydrogen is used for fueling at cooler temperatures to reach the desired pressure levels [8]. The pressurized vessels or hydrogen tanks are usually made from seamless steel or composite wrapping with steel or polymer (plastic) liners. The materials of the hydrogen tanks are selected in accordance with application, tank complexity and cost. The cost usually rises in proportion to the nominal working pressure.

Other means of storing hydrogen gas is in caverns (underground storage). Underground storage can include salt caverns, exhausted oil and gas fields. Aquifers have also been investigated in this respect, but the uncertainty and cost of H<sub>2</sub> storage is a major drawback. These underground cavities provide enough space for large scale gaseous hydrogen storage as well as natural thick and low-permeation materials to surround the stored hydrogen. In present day, only a few locations in the USA and Europe are utilizing this type of hydrogen storage[7].

In the case of *liquid hydrogen* or cryogenic hydrogen storage, the hydrogen is liquefied at a temperature of -253°C in cryogenic refrigeration plants and with high cost. The hydrogen tanks used in this case are heavily insulated special cryogenic tanks and are used mainly in space travel.

From the aforementioned technologies in the physical-based storage methods, the ones that are going to be examined in this report are the compressed/cold compressed hydrogen storage and the salt caverns for hydrogen storage.

### **Material-based hydrogen storage**

Material-based hydrogen storage technologies is an alternative to the physical-based storage technologies. They are based on storing hydrogen either in solids or liquids or on material surfaces. It should be noted that most of these material-based storage technologies are still on an experimental level and only a few are commercialized. The material-based storage can be divided into 3 sub-categories, namely, hydride storage systems, liquid hydrogen carriers and surface storage systems (sorbents)[7].

In the case of *hydride storage* systems using metal hydrides, the hydrogen is adsorbed on the metal surface and on a later stage incorporated in elemental form into the metallic lattice with an output of heat. The hydrogen is then retrieved with an input of heat from the metal hydride. Examples of metals that can store hydrogen are palladium and magnesium, along with light metals such as aluminum or certain alloys [7].

*Liquid hydrogen carriers* or Liquid Organic Hydrogen Carriers (LOHCs), a chemical means of hydrogen storage, is another upcoming material-based hydrogen storage technology. The LOHCs are usually organic chemical compounds with hydrogen adsorbing capabilities. The hydrogen is, for example, covalently bound to the LOHC in a process called hydrogenation and then unloaded from it (dehydrogenation) when it needs to be used. The LOHCs are compounds with similar properties to oil based liquids which provides them with all the advantages of easy transportation and handling with the existing infrastructure [9].

*Surface based* storage systems or sorbents can store hydrogen as a sorbate by adsorption on high specific surface area materials such as microporous organometallic framework compounds and microscopic carbon nanotubes. All of these materials can facilitate high volumetric storage densities but are still in experimental levels [6].

In addition, hydrogen can also be stored and transported as chemicals such as ammonia and formic acid. It is accompanied by the advantage of having a high molar fraction of H<sub>2</sub> storage. This will, however, not be discussed in this catalogue.

In summary, each hydrogen storage media is accompanied by its own advantages and disadvantages, depending on the application for which the stored hydrogen is intended. In this regard, pressurized tanks are used for mobile transport of hydrogen and on a small-scale level. The advantages of such a technology are the high discharge rate and efficiencies in the order of 99%, which makes it a suitable candidate of small-scale hydrogen storage for the purpose of readily available feedstock. On the other hand, LOHCs are accompanied by the advantage of large-scale shipping of H<sub>2</sub>, especially if the distance of more than 1,500 km needs to be achieved for cost-effective hydrogen shipment. Salt caverns for hydrogen storage, are useful in the context of large-scale and long-term stationary storage to balance seasonal fluctuations. This option is, in addition, cost-effective [10].

### Compressed hydrogen in pressurized storage tanks

#### Introduction

In this section, the first technology of the physical-based hydrogen storage, the compressed hydrogen in pressurized tanks, is described.

Pressurized hydrogen storage is the only storage method currently in use on a significant scale worldwide [11]. The technology and the materials of the hydrogen vessels have seen improvements as the demand of hydrogen storage is growing. However, hydrogen storage in pressurized tanks is a means of small and medium scale storage. Due to the limitations regarding material properties and operating costs, large scale storage on volumetric terms in pressurized tanks exceeding 200 bar at ambient temperature is not feasible, as the desired volumetric densities for a large scale storage cannot be achieved [12]. Nonetheless, there are technologies in development [13] that allow for a large scale pressurized hydrogen storage up to 40 g/L, but being the exception and not the rule of the industry, they were not examined in this report. For small and medium-scale pressurized hydrogen storage, there are many different pressurized tank technologies used for different purposes and applications. These tank technologies are described in this chapter. The technology, however, that is described more in detail in this chapter is the more frequently used medium-scale hydrogen storage tanks for short to medium term. This technology fits the purpose of storage of hydrogen in a sustainable energy sector, i.e. production and storage of hydrogen gas from renewable energy production in large scale electrolyzers.

#### Technology description

The purpose of a low, medium or high-pressure hydrogen tank is to be able to store as much hydrogen inside it as the volume containing the hydrogen as possible. There are three main problems when trying to compress and store hydrogen in a tank.

Firstly, the main concern is the integrity of the materials when subjected to high pressures and temperatures. The pressure tanks need to withstand pressures from 50 bar to 1000 bar for hydrogen storage, over many cycles where they are being filled and emptied. As a result, different materials are used to support the tank and make its mechanical strength higher. Moreover, due to the heat of compression [14], the temperature while compressing the hydrogen inside the tank rises. This causes the material of the tank to heat from inside out and be critically damaged if the temperature exceeds certain levels. For this reason, the hydrogen is pre-cooled in systems that use high-pressure hydrogen storage like in the automotive industry and in hydrogen fueling stations. Hydrogen is cooled prior to compression with two methods: either cooled-compression or cryo-compression. For cryo-compression, a temperature in the order of 50 K has been reported while for cooled compression the temperature of approximately 288 K is utilized. Cooled and cryo-compression are used for performing fast and high volumetric compression for automotive purposes [15]. Therefore, for hydrogen storage at ambient temperature (temperature without pre-cooling of hydrogen), as mentioned earlier, maximum 200 bar of pressure is used.

Secondly, the case of hydrogen embrittlement causes problems. Hydrogen embrittlement is the process in which metals like steel react with hydrogen, making them brittle and susceptible to cracking [16]. This is

commonly observed in tanks with metallic liners and less in the ones with polymer liners. Hydrogen embrittlement happens over long periods of time and it is usually one of the main factors that determines the tank's lifetime from the manufacturer.

Thirdly, the phenomenon called hydrogen permeation can cause problems. Hydrogen permeation occurs when hydrogen molecules, due to their small size, tend to go through the walls or interstices of a container to its piping or interface material [14] and, in the case of pressurized tanks, this results in pressure drop inside the tank as well as a decrease of the mass and thereby the state of charge of the stored hydrogen in the tank. This is a more common problem for materials like polymers and less common for metallic materials.

### Pressure tanks categories

To overcome the challenges of pressurized hydrogen storage, different materials are chosen for different purposes. Hydrogen pressure tanks are divided into 4 types [17] according to the materials they utilize: Type I, II, III and IV, as it is seen in Figure 3. The four different types of tanks have all undergone durability and safety tests which includes: 5500 cycle tests to 125% of nominal working pressure, drop test, surface damage and chemical exposure tests and a burst test at more than 180 % of nominal working pressure. Permeability test has also been performed to make sure the tanks does not exceed the safety limits for use in vehicles for personal transportation [18].

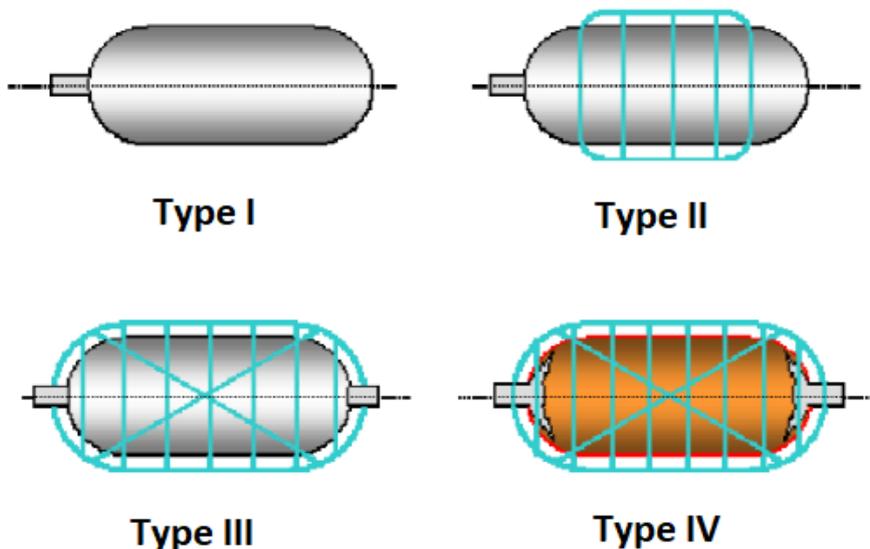


Figure 15: Schematic of different hydrogen pressure tank types[18]

**Type I:** These types of tanks are seamless steel or aluminum tanks. They are bulky and heavy with thick walls. They are designed for pressures up to 250 bar and are resistant to hydrogen permeation but not hydrogen embrittlement. They are commonly used as a cheap solution for stationary applications.

**Type II:** These types of tanks are seamless metallic (aluminum) tanks with filament windings like glass fiber/aramid or carbon fiber around the metallic cylinder. They are also heavy and are designed for pressures from 450 to 800 bar. They are cost competitive due to the relatively low amount of fibers used for the wrapping.

## 151 Hydrogen Storage

**Type III:** These types of tanks are made from seamless or welded aluminum liners fully wrapped with fiber resin composite. They are lighter and have thinner walls compared to Type I and II tanks. Their materials are also less susceptible to hydrogen embrittlement and they are designed for pressures from 300 to 700 bar. They are more expensive due to the high amount of fibers used for the wrapping.

**Type IV:** These types of tanks are the state of the art when it comes to high-pressure hydrogen tanks and are made completely from carbon fiber with a polymer (thermoplastic) liner. The carbon fiber wrapping provides enough strength to withstand pressures up to 1000 bar while the thermoplastic liner acts as a permeation barrier, however, it is less resistant to permeation than steel or aluminum. They are the lightest and the most expensive tanks today and are used (along with Type III tanks) mainly in the automotive industry for short term storage.

A collective overview table with the technical characteristics of each type of tank can be seen in Table 1.

**Table 2: Technical characteristics of pressurized hydrogen tanks**

Type	Working Pressure (bar)	Materials	Usage	Permeation [mol/s/m/MPa <sup>1/2</sup> ]	Typical Storage Period [months]	Average cost [€/kg <sub>H2</sub> stored]	Ref.
Type I	< 250	Seamless steel or aluminum	Stationary applications	$2.84 \times 10^{-27}$	years	500	[19] [18]
Type II	450-800	Seamless steel/aluminum with filament windings like glass fiber/aramid or carbon fiber wrap	Stationary applications or short transportation (tube trucks)	$2.84 \times 10^{-27}$	years	900	[20] [18]
Type III	300-700	Seamless or welded aluminum liners fully wrapped with fiber resin composite	Stationary and automotive applications. Used also in hydrogen fueling industry	$2.84 \times 10^{-27}$	days to months	1,100	[21] [18]
Type IV	350-1000	Fully carbon fiber casing with a polymer (thermoplastic) liner	Automotive and other fuel cell applications (cars, trucks, drones etc.) but also short-medium term stationary storage (state of the art)	$5.55 \times 10^{-15}$	days to months	1,200	[21] [18] [19]

### Input/output

The input and the output of the pressurized hydrogen tanks of all types is hydrogen gas and energy for its compression, respectively. Hydrogen is generated from electrolysis or steam reforming of hydrogen rich hydrocarbons (mainly from methane by 'SMR', Steam Methane Reforming) and then compressed by compressors into the storage tanks. The hydrogen can be retrieved when needed usually, to produce electric power through fuel cells.

### Components in pressurized tanks storage systems

In this section, the components of a pressurized storage system are analyzed and described.

In the industry, storage systems vary a lot depending on the application. Given this, it is difficult to select one type of storage system to investigate variables such as the type of the tank used, size of the tank, pressure class, compressor size etc., which are often customized for each application's purpose.

In an effort to describe a typical pressurized storage system for a stationary application, the following assumptions have been made:

- The system is a stationary storage system that is receiving hydrogen produced in low pressures (atmospheric or low-pressure output, typically the case for alkaline electrolyzers). It should be noted that PEM already delivers H<sub>2</sub> at elevated pressure, typically 30 bars, and that systems at higher pressures are in R&D stage. It is worth mentioning that high pressure AEC is also on its way to the market currently.
- The system should be pressurizing the hydrogen gas for effective but also economic storage based in 2019 already existing and proven systems.
- Storage time is medium term as large scale pressurized tanks hydrogen storage is not applicable nor feasible today.

Based on the above assumptions, an overview of a simple pressurized tanks storage system can be seen in Figure 4.

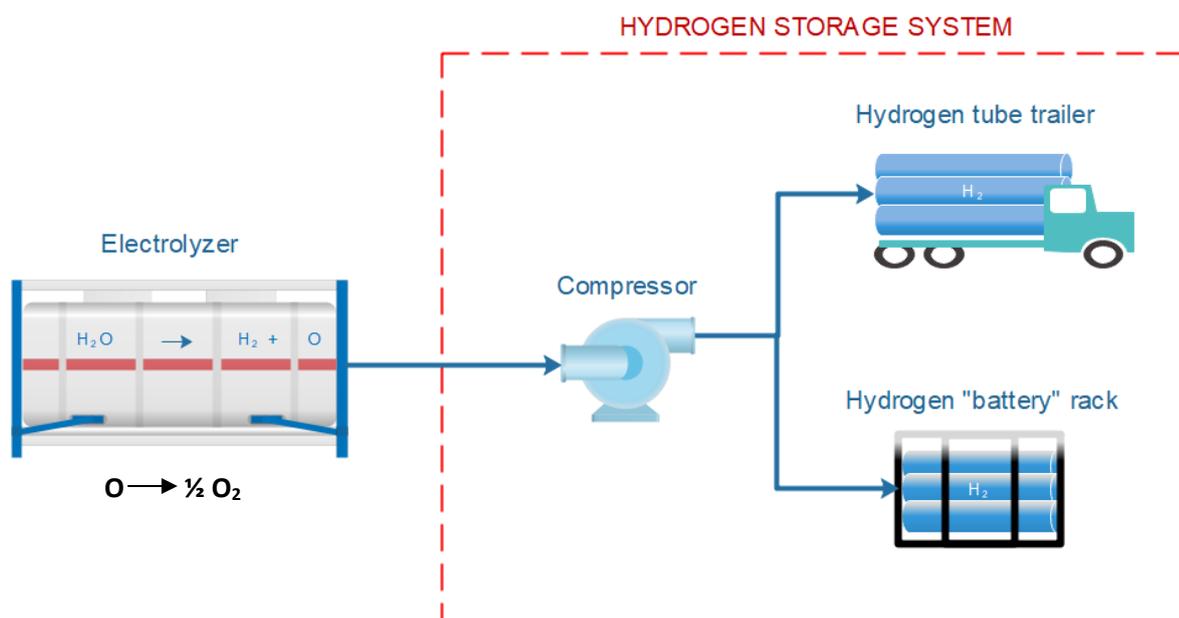


Figure 16: Typical pressurized tank storage system

**Compressor.** This system component is responsible for raising the pressure from the atmospheric (or low) pressure input to the desired pressure output in the pressurized tanks. It can include one compressor or many compressors in series, depending on the desired pressure output. Compressor sizes and specifications may vary according to the application, however, only a limited variety of compressors can work with hydrogen due to its molecular size and weight. The compressors energy requirement contributes a significant amount to the cost and the efficiency of the system as described in the subsequent “Energy efficiency and losses” section. The compressor that was used in the system that is analyzed in the data sheet is a typical 5-stage, 100 kW compressor that can compress 1 kg<sub>H2</sub>/min at 200 bar with an energy consumption of 4 kWh/kg<sub>H2</sub> compressed [19], [22].

**Type I or II tanks.** The type of tanks that can be chosen for such a system are either Type I steel tanks or Type II steel tanks with partial composite wrapping. These tanks are most suitable for low-pressure stationary hydrogen storage due to their durability, low permeation characteristics and low cost. The industry uses both tank technologies for stationary applications, with Type II tanks providing relatively higher-pressure range and more hydrogen capacity than Type I with less steel, albeit at higher costs. An image of Type I & II tanks can be seen in Figure 5.



Type I



Type II

Figure 17: (left) Type I steel cylinder, (right) Type II steel cylinder with composite wrap [23]

These tanks are either placed on **hydrogen tube trailers** for transportation purposes or in racks called **hydrogen batteries**, for stationary storage and usage. A picture of both the systems can be seen in Figure 6. For the specific system analyzed in the data sheet, 15 Type I tanks in a hydrogen battery rack, operating at 200 bar with a collective storage capacity of 500 kg<sub>H<sub>2</sub></sub> are seen.



Hydrogen battery



Hydrogen tube truck/trailer

Figure 18: (left) Hydrogen battery of Type I steel tanks, (right) Hydrogen tube truck with Type I steel tanks [24], [25]

### Energy efficiency and losses

The losses for a pressurized hydrogen tank can be divided into operational losses and standby losses. Furthermore, the energy efficiency is described. It should be mentioned that unlike a battery storage system, in which energy storage and energy conversion are within the same system/medium, pressurized hydrogen storage system only store the energy. The energy conversion is done by electrolysis for producing hydrogen from electricity produced by renewable energy sources such as wind and solar, and a fuel cell system, for instance, can thereafter be utilized to generate electricity after storing the hydrogen. Hence, only the efficiency for storing the hydrogen is considered in this technology catalogue. Comparing different energy storage technologies, one needs to take the complete round-trip-efficiency into account from electricity to electricity or from energy source to energy end use.

### Operational losses

The operational losses of pressurized hydrogen tanks are affiliated primarily with the energy losses of the compression and secondarily with energy losses caused by the pressure losses in the valves and tubes during filling and retrieving of gas. Energy losses associated with pressure losses in a complex system as in i.e. a hydrogen fueling station system operating in 900+ bar of pressures are summing up a total of <5% with the majority of them happening in components that connect the station and the car [8]. Based on this, it is safe to assume that in a simple system like the one described in the “Components in pressurized tanks storage systems” section, where operating pressures are up to 200 bar, there are no heat exchangers etc., the pressure losses due to valves, tubing etc. are <1% and therefore negligible.

### Standby losses

The standby losses mainly occur due to hydrogen permeation. Type I, II and III tanks have metallic casing or liner, and therefore have almost negligible permeability. Type IV tanks, however, have higher permeability because of their polymer liner. For reference, aluminum permeability is  $2.84 \times 10^{-27}$  mol/s/m/MPa<sup>1/2</sup> at ambient temperature and a polymer like Noryl™ has a permeability of  $5.55 \times 10^{-15}$  mol/s/m/MPa<sup>1/2</sup> at ambient temperature which is 12 orders of magnitude larger [18]. For the system under study, the usage of Type I steel tanks makes these standby losses negligible.

### Energy Efficiency

Energy efficiency or roundtrip efficiency of the hydrogen storage system described is given by Equation (1).

$$\eta_{roundtrip} = \frac{E_{hydrogen\ out}}{E_{hydrogen\ in} + E_{compression} + E_{permeated\ hydrogen}} \times 100\% \quad (1)$$

The roundtrip efficiency of the storage system assumes that the electricity for the compression can be translated into a 1:1 loss in the energy content of the hydrogen.

For such a system, the the  $E_{hydrogen\ out}$  of the system is its capacity of 500kg multiplied by 33.33 kWh/kg, similar to the amount of  $E_{hydrogen\ in}$ . The energy consumed by the compressor for the compression of 1 kg to 200 bar is approximately 4 kWh/kg [19], [22]. The energy losses due to permeation and pressure losses were negligible. In the calculations however, a collective 1% will be assigned to them to indicate a margin of error and uncertainty. Given this, the Equation (1) can be calculated as follows:

$$\begin{aligned} \eta_{roundtrip} &= \frac{16.67MWh}{16.67MWh + 2MWh + \sim 0 + \sim 0} \times 100\% \\ &= 89\% - 1\%_{perm.\&press.} = 88\% \end{aligned}$$

### Typical characteristics and capacities

Pressure tanks come in various sizes, depending on the application. A summary with some typical characteristic capacities can be seen in the Table 2.

Table 3: Characteristics of pressurized hydrogen tanks

Manufacturer	Type	Diameter (cm)	Length (cm)	Tank weight (kg)	Water volume (L)	Nominal working pressure (bar)	Hydrogen capacity (kg)	Purpose
Doosan mobility [26]	IV	22.5	56.5	4.3	10.8	350	0.28	Fuel cell drone
Hexagon [27]	IV	44.0	105.0	59	76	700	3.1	Automotive
Mahytec [28]	IV	49.0	307	260	300	500	9.5	Fueling stations, transportation
Hexagon	IV	65.3	441.9	267	1,170	250	21	Fueling stations
SteelHead [29]	III	43.5	261.6	178	270	350	6.2	Automotive
FIBAtch [30]	II	55.9	290	1,082	213	930	10	Fueling stations
FIBAtch [31]	I	55.9	1,100	2,740	2,254	200	33	Fueling stations, Transportation

### Typical storage period

Hydrogen can be stored in compressed hydrogen tanks practically indefinitely[19]. The exact amount of storage time comes down to the materials of the tanks and how susceptible they are to hydrogen permeation and embrittlement. Hydrogen tanks have a lifetime expectancy that is determined from the manufacturer, and when this time expires the tank needs to be replaced as there is no guarantee for storing hydrogen safely without any leakages any longer.

For example, there is no significant pressure drop in steel tanks (that would indicate leaks) in laboratories even after 3 years of dormancy. It is important to note that a long-term hydrogen storage in pressurized tanks is always performed in ambient temperature. If a cooled compression in a tank is followed by an exposure for a long term in ambient temperature, a pressure drop along with the lowering of the volumetric density will be observed. Gaseous hydrogen, if not in use in a laboratory environment, tends to be used relatively fast after its production. Existing hydrogen fueling stations for example replenish their bulk hydrogen stock

via on-site hydrogen electrolysis or with hydrogen tube truck delivery. This bulk hydrogen supply can be stored in ambient temperatures and up to 200 bar of pressure for months, even years. Inspection of the low-pressure steel tanks is done once a year to ensure the safe usage of these tanks.

**Space requirements**

A typical low-pressure stationary hydrogen storage system as shown in Figure 4 has a footprint that is summarized in Table 3.

Table 4: Storage system space requirements

System component	Length [m]	Width [m]	Height [m]	H <sub>2</sub> Capacity [kg]	Footprint [m <sup>2</sup> ]	Ref.
Compressor	3.5	2	2.5	-	7	[19], [32]
Hydrogen battery	12.3	2.4	~2	500	29.5	[33]
Overall system	15.8	4.4	2.5	500	~40 - 50 (including piping, power electronics)	

**Advantages/disadvantages**

Storing hydrogen in pressurized hydrogen tanks can have advantages and disadvantages which are described briefly in this section.

**Advantages**

1. Long-term energy storage: Depending on the materials of the tank, hydrogen can be stored for relatively long periods of time without losing significant energy content (see section “Typical storage period”).
2. Widespread and proven technology: As it was mentioned, it is the only technology that is used in any significant scale for hydrogen storage to date [11].
3. Cost-efficient in comparison with other industrialized storage methods: The materials of the tanks, especially when composite support is not used significantly (i.e. Type I&II tanks), are the most cost-efficient leading to a decrease in storage costs.

**Disadvantages**

1. Not easily transportable in large quantities. In order to store and transport large amounts of hydrogen gas today means that trucks carrying pressure tanks must be employed. The cost of this procedure and the relatively small amount of hydrogen transported at a time inhibits the transportation of hydrogen gas in large quantities over large distances.
2. Cost of materials and compression. Even though compressed hydrogen storage is the most cost-effective storage method today, the costs of materials of high pressure tanks as well as the energy input to compress hydrogen to store it in significant quantities is still an issue.
3. Safety issues. Hydrogen is an explosive gas when in contact with air in significant concentrations i.e., 4% (LEL) and 59% (UEL). Therefore extreme caution should be exercised when handling high pressure hydrogen storage systems.

### Environment

Hydrogen gas itself does not pose any significant environmental threats as its large-scale use is still in its infancy. When larger amounts of gaseous hydrogen are used then, its potential accumulated leakage towards the atmosphere could speed up the ozone layer destruction faster than conventional pollutants. This is, however, an assumption of scientists that is based on the widespread use of hydrogen as a fuel and the environmental impact would still be very depending on the human factor [34].


### Safety

Hydrogen is, like all the other combustible fuels, flammable and explosive when mixed with air within a certain concentration interval. The flammability range is from 4% to 75% hydrogen in air. The premise for fire or explosion is that there is air presents with hydrogen, which is not the case during operation as the hydrogen system is closed. Another risk specifically related to handling high pressure hydrogen is the pressure burst which can occur under high pressure if a component malfunctions. When handling hydrogen, a lot of safety equipment has to be installed in order to shut down the system if it detects hydrogen leakages. Hydrogen storage vessels has, as described in the section “pressure tank categories”, undergone a large test for both lifecycle performance, overpressure and collision/drop tests to secure the use of them in vehicles and for storage. Typically, hydrogen storage vessels would be installed in open air and a leak would only become dangerous if an ignition occurs, otherwise the leak would empty the system into the atmosphere. Even if the leak is ignited it would burn in a straight flame upwards as hydrogens is lighter than air. The worst-case scenario is a pressure burst followed by an explosion or fire. In this context, it is worth mentioning the incident which took place at a hydrogen filling station in Kjørbo, Norway in 2019. An explosion was caused due to an error in assembling a plug in a hydrogen storage tank, which was a part of the high-pressure storage unit. This lead to hydrogen leakage which thereafter reacted with air causing ignition. Additionally, the leak was in large quantity which may have resulted in ignition scenarios due to the fact that the fail safe did not respond as it was supposed to [35].

### Research and development perspectives

Type IV tanks are the cutting edge, impactful technology for medium-high pressure short- and medium-term storage technology for pressurized hydrogen. The materials and technology used in this type of tanks are researched and optimized by the industry as it is the most promising for applications that use portable

hydrogen storage (automotive industry). A schematic of the Type IV tank components can be seen in Figure 4.

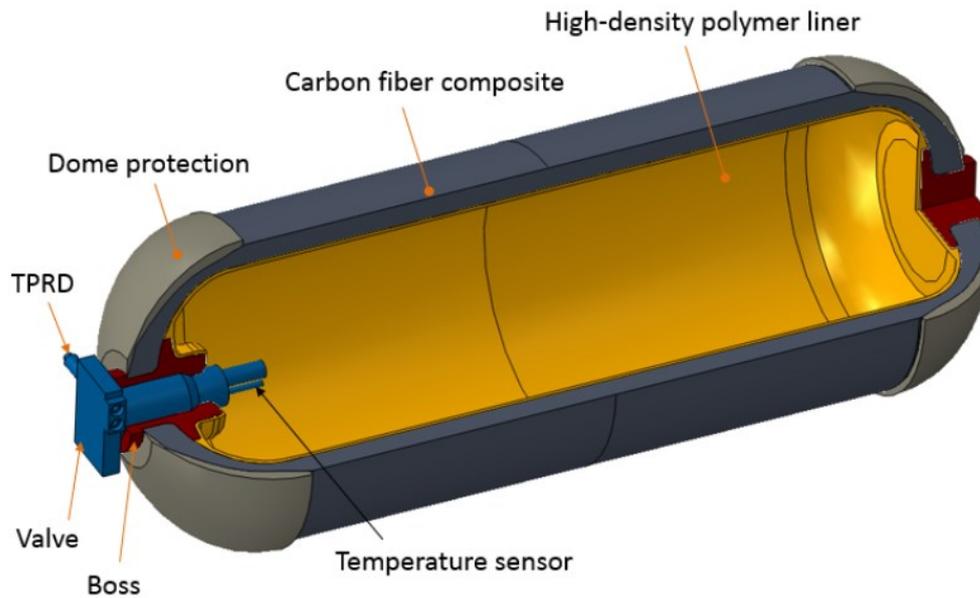

TPRD = Thermally Activated Pressure Relief Device

*Credit: Process Modeling Group, Nuclear Engineering Division, Argonne National Laboratory (ANL)*

Figure 19: Components of a Type IV hydrogen pressure tank [36]

The components of the Type IV tank contain:

**Carbon fiber composite wrapping**, which provides the shell of the tank with the necessary mechanical strength to withstand the high pressures of the compressed hydrogen in it.

**High-density polymer liner**, which serves as a gas diffusion barrier and prevents hydrogen permeation through it.

**Dome protection**, usually from foam for resistance from impact, usually used in the automotive industry. Some Type IV tanks do not use this foam dome.

**Temperature sensor** close to the inlet of the hydrogen for monitoring the temperature development during filling and unloading of hydrogen gas.

**Valve and boss (protruding feature on a work-piece)** for filling and retrieving hydrogen from the tank.

**Pressure relief device** that also can be thermally activated, to control and limit the pressure of the tank.

Other technologies such as multifunctional layered stationary hydrogen storage vessels are being developed in an effort to maximize the hydrogen stored and minimize the cost of the materials [37].

In general, pressurized tanks manufacturing companies are investing in optimizing their products in order to achieve lightweight and low-cost bulk transportation high pressure gaseous hydrogen vessels. This is done mainly by improving the durability of components in contact with high pressure hydrogen while ensuring operational safety. However, due to the nature of this physical storage method, radical improvements are

not foreseen for the short-term future as they are dependent mainly on the materials used which are unchanged for many years.

Considering the pressurized hydrogen storage as a system, there is currently research on manufacturing specialized hydrogen compressors to optimize the compression characteristics and increase the mass flow rate for hydrogen [38]. Special hydrogen compressors are not commonplace yet. However, Linde has recently developed a ionic-liquid compressor aimed at hydrogen fueling stations [39]. Nevertheless, expensive high-power piston-compressors are utilized for compressing hydrogen gas to the desired pressures for storage.

### Examples of market standard technology

The gas industry uses currently a high variety of pressurized tanks for hydrogen storage, depending in the applications that hydrogen is used for. In the Table 4, a list of examples of various uses of hydrogen tanks and their purpose is presented.

### Prediction of performance and cost

Performance-wise (storage capacity), the Type I tanks that were used in the system defined in the “Components in pressurized tanks storage systems” section are not foreseen to have significant, if any, performance improvement over the years. This is because their capabilities of storing hydrogen is directly proportional to their pressure limits which are improved only by adding more material (steel) to make them withstand higher pressures. For Type II & III tanks, the situation is similar, but they have more potential for improvement in performance with the improvement in the durability of some composite materials. Type IV tanks have the biggest performance potential as US Department of Energy (DOE) has set goals for their improvement in storage capacity in the future to help with commercialization of fuel cell vehicles [11]. These performance goals are seen in Table 4. As for the cost of the tanks themselves, it is highly dependent on the upscaling of the hydrogen storage industry. For Type I tanks where the only variable of their cost is the amount of steel used and its cost development in the next years. Projections from the hydrogen industry state that costs of Type I tanks can fall to half of the current price by 2050 [19]. The rest of the tank types will follow a similar trend according to their area of implementation in the hydrogen storage industry with Type IV to have significant cost reductions due to their increasing demand from the automotive industry. Type IV cost targets from DOE are see in in Table 5.

Table 5: Examples of market standard technology and applications

Image	Location	Usage	Year	Specs.	Technology provider	Ref.
-------	----------	-------	------	--------	---------------------	------

	<p>Elancourt, France</p>	<p>Stationary storage of energy used in telecommunication application RHYTA-RENESTA</p>	<p>2016</p>	<p>3x850L@ 30bar Type IV tanks, 7 kgH<sub>2</sub></p>	<p>MAHYTEC</p>	<p>[40]</p>
	<p>HyBalance Hobro, Denmark</p>	<p>Stationary and transport ready storage of hydrogen from electrolyzer output.</p>	<p>2018</p>	<p>18 Type IV tanks @450 bar, 500 kgH<sub>2</sub></p>	<p>Air Liquide</p>	<p>[41]</p>
	<p>Denver, USA</p>	<p><b>Stationary storage for hydrogen fueling station for research purposes</b></p>	<p>2016</p>	<p>Multiple Type I tanks @ 200 bar + Type II tanks @850 bar, 310 kgH<sub>2</sub></p>	<p>Air Products</p>	<p>[42]</p>

The compressors used in the storage system are projected to have a significant performance in technology, maybe even change the existing technology altogether. Today’s compressor technology is projected to increase in performance around 20% over the next 30 years, as an estimate. The costs of the compressors for compressed hydrogen storage however, depending on the industry’s growth, can go down to half even one-fourth of today’s costs.

Table 6: Technical System Targets: Onboard Hydrogen Storage for Light-Duty Fuel Cell Vehicles by DOE [43]

Storage Parameter	Units	2020	2025	Ultimate
-------------------	-------	------	------	----------

<b>Usable, specific energy from H<sub>2</sub> (net useful energy/max system mass)</b>	kWh/kg	1.5	1.8	2.2
	(kg H <sub>2</sub> /kg system)	(0.045)	(0.055)	(0.065)
Usable energy density from H <sub>2</sub> (net useful energy/max system volume)	kWh/L	1.0	1.3	1.7
	(kg H <sub>2</sub> /L system)	(0.030)	(0.040)	(0.050)
Storage system cost	\$/kWh net	10	9	8
	(\$/kg H <sub>2</sub> )	(333)	(300)	(266)

### Uncertainty

The biggest contributor to the uncertainty of the cost projections is the growth of the hydrogen storage industry. Storage in the case of pressurized hydrogen gas is almost always connected with the short-term utilization of hydrogen in either fueling stations, natural gas enrichment etc. Given this, it is hard to predict the growth of the pressurized hydrogen storage industry itself without having to consider the industries that utilize this technology and their growth. As explained in the “Prediction of performance and cost” section, the cost of the pressurized tanks component in the system (Type I tanks) can go down to half of today’s cost price by 2050. However, assuming the price to be higher than half of the current price is a conservative option if the industry does not develop as predicted or if another type of pressurized hydrogen gas tank technology is chosen over Type I. The same is the case for the compressor component of the system which can go down in costs to one-fourth of today’s cost price by 2050 if the hydrogen fueling industry follows the current growth predictions or half if the growth of the industry is more conservative. Also the compressors’ performance projection has a high level of uncertainty due to the new technologies being developed to fit the needs of hydrogen compression specifically [19].

### Cost examples

The cost data of the hydrogen storage system described in the “Components in pressurized tanks storage systems” section was retrieved either from manufacturers, or from companies running such or similar systems. The average cost of individual components is described in Table 6:

**Table 7: Cost of individual components for Hydrogen storage system**

System component	Average [€/unit]	Cost	Average Operational Cost [€/year]	Lifetime [years]	Ref.
Compressor	500,000		6,000	25	[19], [32]

## 151 Hydrogen Storage

---

<b>Hydrogen battery</b>	600 €/kg	1.250	25	[33]
<b>Piping, power electronics, manhours</b>	~150,000/system	~1,000/system	25	[19]
<b>Overall system for 500kg<sub>H2</sub></b>	950,000	8,250	25	

---

### Acknowledgements

Special thanks to all the people who had the time to have a phone conversation with Hybrid Greentech ApS from Nel Hydrogen (Joshua Adams), Air Liquide Denmark/HyBalance (Rasmus Vejle).

# 151 Hydrogen Storage

## Data sheet

Technology	Pressurized hydrogen gas storage system (Compressor & Type I tanks @ 200bar)											
	2019	2020	2030	2040	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref	Explanation
<b>Energy/technical data</b>						Lower	Upper	Lower	Upper			
Form of energy stored	Hydrogen gas											Electricity, heat or gas  System or local (if electricity specify also if power-intensive or energy-intensive)
Application	Stationary short-medium term storage after production from an electrolyzer											
Energy storage capacity for one unit (MWh)	16,7	16,7	16,7	16,7	16,7	16,7	16,7	16,7	16,7		1	
Output capacity for one unit (MW)	-	-	-	-	-	-	-	-	-	A		
Input capacity for one unit (MW)	0,1	0,095	0,09	0,08	0,08	0,1	0,99	0,085	0,08	B	12	
Round trip efficiency (%)	88%	88%	89%	90%	90%	88%	88%	90%	90%	C	1	
- Charge efficiency (%)	88%	88%	89%	90%	90%	88%	88%	90%	90%	D		
- Discharge efficiency (%)	~100	~100	~100	~100	~100	~100	~100	~100	~100	E		
Energy losses during storage (%/ period)	<1	<1	<1	<1	<1	<1	<1	<1	<1	F		
Auxiliary electricity consumption (% of output)	<1	<1	<1	<1	<1	<1	<1	<1	<1	J		
Forced outage (%)	0	0	0	0	0	0	0	0	0	I		
Planned outage (weeks per year)	3	3	2	15	1	3	3	15	0,5	G	3	
Technical lifetime (years)	25	25	30	30	30	25	25	30	30			
Construction time (years)	0,5	0,5	0,4	0,4	0,3	0,5	0,5	0,3	0,2		3	
<b>Regulation ability</b>												Only for electricity storage
Primary regulation (% per 30 sec)	3,3	3,3	3,3	3,3	3,3	3,3	3,3	3,3	3,3	H	3	
Secondary regulation (% per minute)	6,7	6,7	6,7	6,7	6,7	6,7	6,7	6,7	6,7	H	3	
<b>Financial data</b>												See table in the specific section
Specific investment (M€2015 per MWh)	0,057	0,057	0,045	0,027	0,021	0,057	0,057	0,035	0,021		1	
Compressor component (M€2015 per MWh)	0,030	0,030	0,023	0,011	0,008	0,030	0,030	0,015	0,008		1	
Type I tanks component (M€2015 per MWh)	0,018	0,018	0,015	0,010	0,009	0,018	0,018	0,014	0,009		1	
Installation, equipment, manhours (M€2015 per MWh)	0,009	0,009	0,007	0,006	0,005	0,009	0,009	0,007	0,005		1	
Fixed O&M (€2015/MW/year)	600	600	500	500	400	600	600	450	300		1	
Variable O&M (€2015/MWh)	-	-	-	-	-	-	-	-	-			
<b>Technology specific data</b>												
Gravimetric energy density (kWh/kg)	33,3	33,3	33,3	33,3	33,3	33,3	33,3	33,3	33,3			
Volumetric energy density @0°C and 1atm pressure (kWh/m <sup>3</sup> )	0,09	0,09	0,09	0,09	0,09	0,09	0,09	0,09	0,09			
Permeation characteristics for Type I tanks (mol/s/m/MPa <sup>1/2</sup> )	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>	2.84×10 <sup>-27</sup>		4	

### Notes:

- A Cannot be defined since there is no conversion of hydrogen back to electricity in the form of a fuel cell in the system
- B The only power input that is considered is the input for the compressor and does not include power needs for the electrolyzer that is making the hydrogen as described in the system definition. Compressor power input decrease of 5% every 10 years
- C Calculated in the "Energy Efficiency" section. Compressor efficiency linearly improved by 20% until 2050.  
The charge efficiency is practically the roundtrip efficiency itself as there are almost no losses in the discharge process (See note E)
- E Almost no losses during discharge as it is a physical discharge for a pressurized gas from a valve.
- F Permeation characteristics are negligible for Type I tanks, see also Technology specific data.
- G System O&M includes maintenance of the compressor and periodic check of the tanks integrity.
- H System complies with the frequency regulation requirements from Energinet
- I No hydrogen storage systems are known to have time of forced outage.
- J Compressor consumption is not considered auxiliary. Rest of losses that can be translated into energy losses and consequently more electricity consumption are negligible.

## Hydrogen storage in Liquid Organic Hydrogen Carrier (LOHC) compounds

### Introduction

In this section, a material-based hydrogen storage technology, the liquid organic hydrogen carrier technology is described.

Energy carrying compounds are chemical substances that are in an energy rich state. If this energy rich state is achieved through hydrogenation (addition of hydrogen to the compound) of a liquid organic compound, then it is characterized as a Liquid Organic Hydrogen Carrier, or a LOHC [44].

These chemical compounds were first studied in the 1980s and extensive examination of LOHC systems started in the early 2000s [9]. The principles of the hydrogenation and dehydrogenation (retrieval of hydrogen from a hydrogenated LOHC) have been accessed in depth up until today and the LOHC substances are well known.

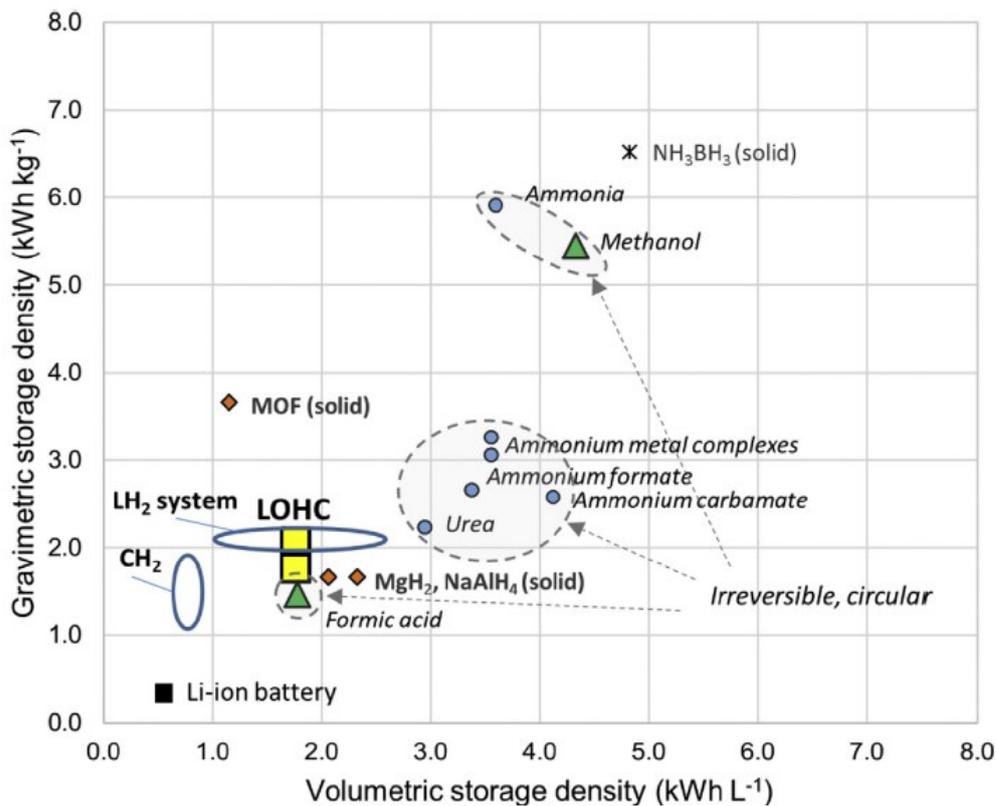


Figure 20: Properties of different hydrogen storage technologies [45]

LOHC storage systems are fairly similar to conventional fuels, as they are stored in a liquid form in atmospheric pressure and environmental temperature until needed. Due to their high volumetric energy density compared to the compressed hydrogen gas, they are considered a viable alternative fuel not only for energy transport, and automotive purposes [9] but for stationary applications as well. In Figure 8, the energy density of LOHC system as compared with chemicals such as methanol and ammonia, as well as Li-ion batteries is clearly represented. It has an advantage of significantly higher gravimetric and volumetric density as compared to Li-ion batteries, making it a suitable candidate for storage.

Due to the existence of high amount of LOHC compounds, some of them will be briefly described in the “Technology description” section and only one of them will be chosen to represent the LOHC in the hydrogen storage system that will be described in the “Components in LOHC storage system” and in the Data Sheet.

### Technology description

LOHCs essentially are liquids or solids which are accompanied by the reversible hydrogenation and dehydrogenation at elevated temperatures with the help of catalysts. The organic compound retains its initial structure upon dehydrogenation. LOHC operation on small scale is accompanied by challenges with new process for hydrogen implementation regarding catalysts. The advantages lie in the compatibility of blending with the existing fuel infrastructure since the initial LOHC structure after hydrogen release remains the same. Especially, for transporting hydrogen over 1500 km, shipping hydrogen as LOHC is cost-effective. Furthermore, no storage losses during transportation of hydrogen, as well as in a high hydrogen purity [45]. Additionally, LOHCs are characterized by the ease of transportation. This, however, is impeded by the process of hydrogen liberation prior to use which is energy and cost consuming. A comparison of LOHC with ammonia and liquid hydrogen is displayed in Table 7.

Transporting hydrogen in the form of LOHC involves loading and extracting hydrogen at the destination and can be transported as a liquid. However, the energy requirement for conversion and reconversion are in the orders of 35-40%. Furthermore, LOHC molecules need to be shipped back to the origin which makes the whole process expensive[10].

The concept behind LOHC hydrogen storage and the chemical principles that define it are simple. It can be divided in 4 steps for the process, as a whole. These steps are the hydrogen production, hydrogenation of the LOHC, storage of the LOHC and dehydrogenation of the LOHC for hydrogen use. These steps will be described below.

- I. **Hydrogen production.** Similar to the case of the pressurized tanks hydrogen storage method, LOHC storage will help in the energy industry as means of energy storage from excess renewable energy production, for instance. As it will be described in the hydrogenation process, because it is realized in a higher than atmospheric pressure level, the hydrogen from the electrolyzer system must come already in an elevated pressure, which is the case for industrial electrolyzers [19]. The hydrogen is then ready to go through the hydrogenation process.
- II. **Hydrogenation.** This is the exothermic process of chemically binding hydrogen to the LOHC. This process is done at elevated temperatures implying that hydrogen and LOHC (and solvents if there

are any) need to be heated up for the reaction to take place in the temperature range of 50-250°C [9]. Also, an elevated pressure is needed ranging from 10-70 bar depending on the LOHC. Reaction conditions of some LOHCs can be seen in Table 8.

Table 8: Extent of maturity for LOHC compared to ammonia and liquid hydrogen [10]

Selected properties of hydrogen carriers				
		Liquid hydrogen	Ammonia	LOHC (MCH)
Process and technology maturity*	Conversion	Small scale: High Large scale: Low	High	Medium
	Tank storage	High	High	High
	Transport	Ship: Low Pipeline: High Truck: High	Ship: High Pipeline: High Truck: High	Ship: High Pipeline: High Truck: High
	Reconversion	High	Medium	Medium
	Supply chain integration	Medium/high	High	Medium
		Liquid hydrogen	Ammonia	LOHC (MCH)
Hazards**		Flammable; no smell or flame visibility	Flammable; acute toxicity; precursor to air pollution; corrosive	Toluene: flammable; moderate toxicity. Other LOHCs can be safer.
Conversion and reconversion energy required***		Current: 25–35% Potential: 18%	Conversion: 7–18% Reconversion: < 20%	Current: 35–40% Potential: 25%
Technology improvements and scale-up needs		Production plant efficiency; boil-off management	Integration with flexible electrolyzers; improved conversion efficiency; H <sub>2</sub> purification	Utilisation of conversion heat; reconversion efficiency
Selected organisations developing supply chain		HySTRA; CSIRO; Fortescue Metals Group; Air Liquide	Green Ammonia consortium; IHI Corporation; US Department of Energy	AHEAD; Chiyoda; Hydrogenious; Framatome; Clariant
* High = proven and commercial; Medium = prototype demonstrated; Low = validated or under development; Small scale = < 5 tonnes per day; Large scale = > 100 tonnes per day.				
** Toxicity criteria based on inhalation.				
*** Given as a percentage of lower heating value of hydrogen; values are for hydrogen that could be used in fuel cells; lower-purity hydrogen would require less energy.				
Sources: Aakko-Saksaa et al. (2018), "Liquid organic hydrogen carriers for transportation and storing of renewable energy – Review and discussion", <i>Journal of Power Sources</i> ; Bartels, (2008), "A feasibility study of implementing an Ammonia Economy", Iowa State University; Brown, (2017), "Round-trip efficiency of ammonia as a renewable energy transportation media", <i>Ammonia Energy</i> ; Gidday (2017), "Ammonia as a renewable energy transportation media", <i>ACS Sust. Chem. Eng.</i> ; Hansen (2017), "Solid oxide cell enabled ammonia synthesis and ammonia based power production"; Reuß et al. (2017), "Seasonal storage and alternative carriers: A flexible hydrogen supply chain model", <i>Applied Energy</i> ; Wulf and Zapp, (2018), "Assessment of system variations for hydrogen transport by liquid organic hydrogen carriers", <i>International Journal of Hydrogen Energy</i> .				

In the hydrogenation reactor and with the presence of a catalyst, the LOHC is loaded with hydrogen up to a specific degree. Moreover, to ensure that all hydrogen that can be bound to the LOHC, recirculation of the hydrogen in the reactor might be used [9]. The chemical reaction of an LOHC hydrogenation is described in Equation (2) [46]:




Table 9: Reaction conditions for different LOHCs [46]

Hydrogenation						
	Temp. [°C]	Pressure [bar]	Loading [%]	STY [ $\text{g}_{\text{H}_2}\text{LOHC L}^{-1} \text{h}^{-1}$ ]	RE [ $\text{kJ mol}_{\text{H}_2}^{-1}$ ]	Solvents
NEC	150	50	100	388.2	-53.2	None
DBT	150	50	100	278.8	-65.4	None
AB	80	10	95	77.5	-35.9	THF <sup>a</sup>
FA	50	40	100	7.7	-31.2	Water <sup>b</sup>
MET	250	50	26.4	220.0	-16.5	None
NAP	200	69	100	218.2	-66.3	TOL <sup>c</sup>
TOL	200	20	100	466.6	-68.3	None
Dehydrogenation						
	Temp. [°C]	Pressure [bar]	Conversion [%]	STY [ $\text{g}_{\text{H}_2} \text{L}^{-1} \text{h}^{-1}$ ]	RE [ $\text{kJ mol}_{\text{H}_2}^{-1}$ ]	Solvents
NEC	270	1	90	163.1	53.2	None
DBT	310	1	97	27.5	65.4	None
AB	80	1	99	27.0	35.9	THF <sup>a</sup>
FA	60	1	100	0.2	31.2	Water <sup>b</sup>
MET	420	1	100	44.8	16.5	Water <sup>d</sup>
NAP	280	1	99	16.1	66.3	TOL <sup>c</sup>
TOL	320	1	95	61.5	68.3	None

<sup>a</sup> 434  $\text{g}_{\text{AB}} \text{L}^{-1}$ . <sup>b</sup> Final FA-concentration 1.53 M. <sup>c</sup> 910  $\text{g}_{\text{NAP}} \text{L}^{-1}$ . <sup>d</sup> Water/methanol ratio 1.5 mol mol<sup>-1</sup>.

- I. **LOHC storage.** Right after the hydrogenation process, the loaded LOHC is then cooled and decompressed to be stored in ambient conditions. Due to the high hydrogen saturation from the elevated pressure environment of the hydrogenation process, some hydrogen is lost during decompression, but this is typically limited to below 0.1 weight% hydrogen weight. The loaded LOHC can be stored or transported in containers designated for fuels i.e. oil barrels or tankers as it has the properties of a conventional liquid fuel. Loaded LOHCs can store hydrogen for at least 60 days to be economically advantageous over pressurized tanks, for instance [46]. The storage time for hydrogen in LOHCs is unlimited. Furthermore, hydrogen is not lost during storage making it an attractive form of hydrogen storage.
- II. **Dehydrogenation & usage.** This is the endothermic process of unbinding hydrogen from the LOHC. To state simply, it is the reverse process of hydrogenation. During this process, the hydrogen in the loaded LOHC gets separated from it in a reactor by providing energy in the form of heat and in the presence of a catalyst. The unloaded LOHC is then stored for further cycling. For some LOHCs, the hydrogen obtained from the dehydrogenation process is not pure for uses in i.e. fuel cells and needs further purification. This would require modification to the existing infrastructure. An example of the whole LOHC process is displayed in Figure 9. Here, the LOHC is N-ethylcarbazole. The reaction of hydrogenation is exothermic in nature while dehydrogenation is endothermic in nature. The reaction pressure and temperatures also differ as depicted.

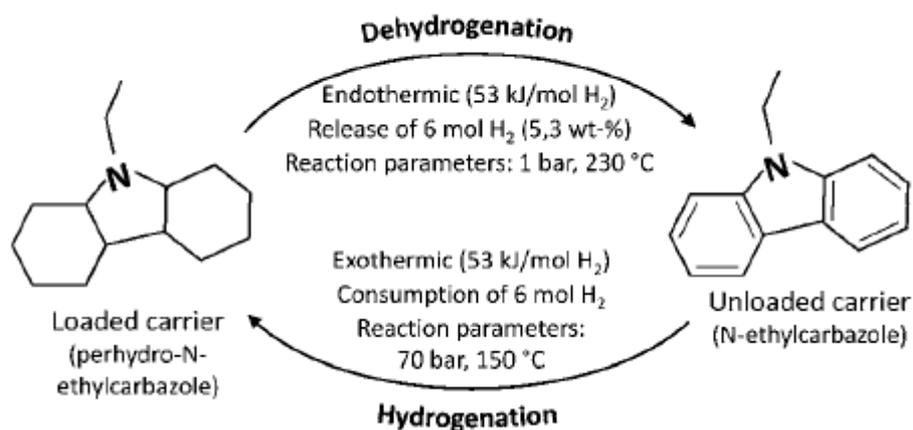


Figure 21: Basic configuration of hydrogenation and dehydrogenation in LOHCs [47]

### Typical Liquid Organic Hydrogen Carriers

There are many compounds that can store hydrogen in their molecules and many characteristics to consider when evaluating them for possible real-life applications. Some of those characteristics include storage capacity, availability of the compound/material, toxicity, energy demand and dehydrogenation temperatures, material handling, stability of the compound during the processes and storage and more [46]. Describing in detail the characteristics and chemistries of those compounds is outside of the scope of this report. However, in Table 9, a list with some LOHC compounds, their characteristics and the reason of why they could be used in storage applications or not can be seen. Some of the LOHCs are reusable while the others are not.

### Input/output

The input and the output of the LOHC storage systems is gaseous hydrogen. There is also a small amount of energy input during the hydrogenation process and a larger amount of energy input for the dehydrogenation process as explained in the “Technology description” section. Hydrogen is being bound to the LOHC in the hydrogenation process; the loaded LOHC is then stored in ambient temperature and pressure as liquid fuel and then used during dehydrogenation to unload the hydrogen from it to be used, usually, to create electric power through fuel cells.

Table 10: Possible Liquid Organic Hydrogen Carriers (LOHCs)[48]

LOHC	Reason for further consideration
N-ethylcarbazole	Well-studied nitrogenous LOHC
Dibenzyltoluene	Already existing application as LOHC; safe and convenient handling
1,2-dihydro-1,2-azaborine	Unique characteristics through integration of boron and nitrogen
Formic acid	Safe and convenient handling
Methanol	Very high storage density
Naphthalene	Well-studied cycloalkane; high storage density
Toluene	Well-studied cycloalkane; planned application as LOHC
Phenazine	Promising stability and sustainable raw material production
LOHC	Reason for no further consideration
Benzyltoluene	Similar to dibenzyltoluene, however, more toxic
3-Methyl-1,2-BN-cyclopentan	Energy intensive regeneration and trimerization
2-Aminoethanol	Low selectivity, long storage cycles
Benzene	High process temperatures (400–450 °C) and very toxic
Indoline	Low gravimetric and volumetric energy density
Chinoline	De-hydrogenation of only one ring possible, thus low storage capacity
Fluorene	Slow de-hydrogenation
4-Aminopyridine	Low selectivity
Bicyclohexyl	Low selectivity
1,2,4-Triazolidin	Unstable at room temperature
Lithiated Primary Amine	To date no successful hydrogenation
2-Methyl-1,2,3,4-tetra-hydroquinoline	Low selectivity
Perhydro-dibenzofuran	Low selectivity
2,6-Dimehtyldecahydro-1,5-naphthyridin	Low selectivity
N-ethylindole	Similar to N-ethylcarbazole, but less studied
N-propylcarbazole	Similar to N-ethylcarbazole, but less studied

### Components in LOHC storage systems

LOHC hydrogen storage takes place under ambient conditions. One of the matured LOHC oils in use, dibenzyltoluene (DBT), facilitates high density in the order of  $630 \text{ (Nm}^3 \text{ H}_2\text{)}/(\text{m}^3 \text{ LOHC})$ , non-flammable transport of hydrogen. Storage using LOHC typically consist of a storage and release unit for hydrogenation and dehydrogenation. In this section, data is taken from an existing catalogue on DBT based LOHC system by the company Hydrogenious[49].

The reaction for hydrogenation, which takes place in the storage unit, is exothermic. The desired conditions for the reaction consist of a pressure of 30 bar and temperature higher than 200 °C, which in turn leads to the generation of  $9 \text{ kWh}_{\text{th}}/\text{kg}_{\text{H}_2}$  heat. On the other hand, the dehydrogenation reaction taking place in the release unit requires a temperature higher than 300 °C. Since dehydrogenation is endothermic, heat requirement is in the order of  $12 \text{ kWh}_{\text{th}}/\text{kg}_{\text{H}_2}$ .

The system being analyzed in this catalogue has the following specifications:

1. The LOHC oil under analysis is dibenzyltoluene, due to its non-toxic nature.
2. The LOHC system is stationary.
3. The footprint for installation and operation are predefined.

The specifications of the storage and release unit are described in Table 10.

Table11: LOHC system specifications

	Storage Unit	Release Unit
Hydrogen capacity	5 t/d // 210 kgH <sub>2</sub> /h	1.5 t/d // 65 kgH <sub>2</sub> /h
LOHC production/demand	4,500 l/h	1,300 l/h
Heat production/demand	1,900 kWth	780 kWth
Footprint	Skid based (based on consumer's requirement)	Skid based (based on consumer's requirement)

### Energy efficiency and losses

During hydrogen storage as LOHCs, hydrogen storage losses are negligible. Storage time itself is unlimited. However, losses due to the hydrogenation and dehydrogenation in the form of heat are worth considering for determining the efficiency of the LOHC system. Literature studies have reported the efficiency of DBT-based LOHC system to be approximately 48-54%. The efficiency can be increased using Solid Oxide cells to 86% before end use. Thermal efficiencies in the order of 60% and electrical efficiency in the order of 40% has been reported [45]. An example of the process chain using LOHCs is displayed in Figure 10. It clearly depicts the possibility of storing large scale hydrogen for transport while using the existing infrastructure. During hydrogen storage in the form of LOHC, no other substance is bound or released into the atmosphere. Dehydrogenation results in obtaining pure H<sub>2</sub> after condensation. LOHC compounds can be stored for long-term without losses using energy transport infrastructure for liquid fuels such as pipelines, ships, trucks etc. This facilitates a feasible transition to the hydrogen economy [50].

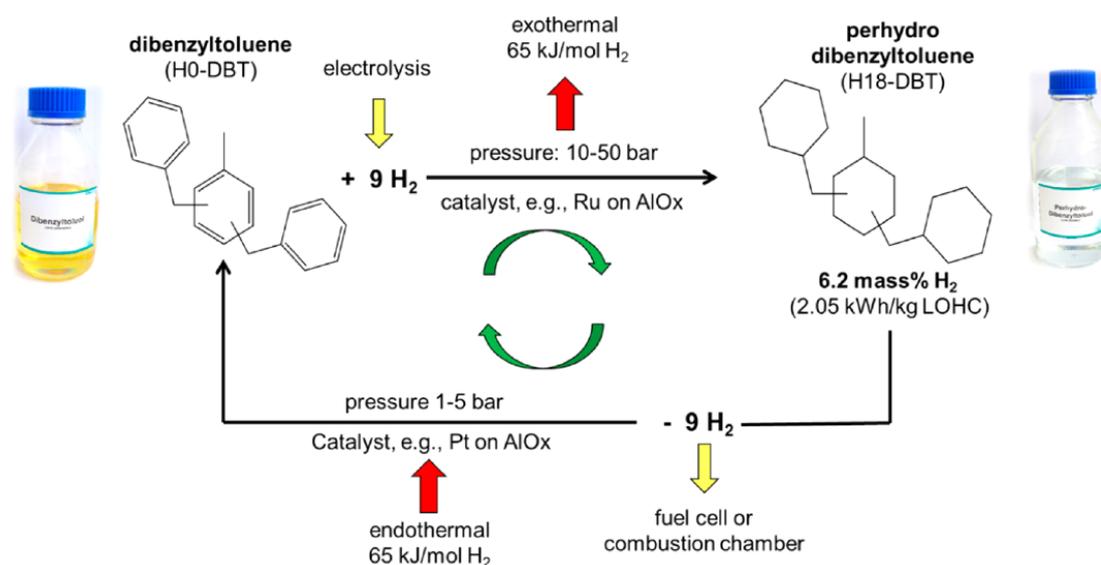


Figure 22: Hydrogen storage using DBT-LOHC system[50]

### Operational losses

During the hydrogenation reaction, heat is released due to its exothermic nature. When the heat is not recirculated, as is done in practice, the heat during storage is considered as a net energy loss. Additionally, during the reaction 0.1 weight % loss of catalyst is assumed per cycle [9]. Major loss in the order of 22% due to conversion and transportation has been reported in literature [45].

### Standby losses

During storage, no noticeable energy loss has been previously mentioned. No significant boil off or other hydrogen losses are reported [46]. Additionally, during long distance transport with pipelines, trucks, ships etc. no significant energy losses using LOHCs have been observed [50].

### Energy Efficiency

Energy efficiency of hydrogen binding and unbinding on LOHCs can be defined according to Equation (3):

$$\eta_{\text{roundtrip}} = \frac{E_{\text{hydrogen out}}}{E_{\text{hydrogen in}} + E_{\text{transport losses}} + E_{\text{heat loss}} + E_{\text{heat Endothermic}}} \times 100\% \quad (3)$$

For such a system, the  $E_{\text{hydrogen out}}$  of the system is its capacity of 210 kg multiplied by 33.33 kWh/kg, which is the same as  $E_{\text{hydrogen in}}$ .  $E_{\text{heat loss}}$  is in the order of 30% due to the endothermic reaction heat, not being utilized. Total transport losses are taken as 10% of the total capacity. Given this, the Equation (3) can be calculated as follows:

$$\eta_{\text{roundtrip}} = \frac{7MWh}{7MWh + 2MWh + 1MWh} \times 100\% = 70\%$$

### Typical characteristics and capacities

LOHCs are relatively new in the market. For this reason, the catalogue obtained from Hydrogenious is utilized to outline different sizes and capacities of LOHC storage and release system, as displayed in Tables 11 and 12.

Table 12: LOHC storage system characteristics [49]

Characteristics	StorageBOX 10	StorageBOX 120	StoragePLANT 5tpd	StoragePLANT 12tpd
Hydrogen capacity	10 Nm <sup>3</sup> /h // 0.9 kgH <sub>2</sub> /h	120 Nm <sup>3</sup> /h // 11 kgH <sub>2</sub> /h	5 t/d // 210 kgH <sub>2</sub> /h	12 t/d // 500 kgH <sub>2</sub> /h
LOHC production	20 l/h	240 l/h	4,500 l/h	11,000 l/h
Heat production	8 kWth	100 kWth	1,900 kWth	4,500 kWth
Footprint	20 foot container	20 foot container	Skid based	Skid based

Table 13: LOHC release system characteristics [49]

Characteristics	ReleaseBOX 10	ReleaseBOX60	ReleaseBOX120	StoragePLANT 1.5tpd
Hydrogen capacity	10 Nm <sup>3</sup> /h // 0.9 kgH <sub>2</sub> /h	60 Nm <sup>3</sup> /h // 5.5 kgH <sub>2</sub> /h	120 Nm <sup>3</sup> /h // 11 kgH <sub>2</sub> /h	1.5 t/d // 65 kgH <sub>2</sub> /h
LOHC demand	18 l/h	110 l/h	1300 l/h	1300 l/h
Heat demand	11kWth	66kWth	760 kWth	780 kWth
Footprint	30 foot container	30 foot container	40 foot container	Skid based

### Typical storage period

Typically, LOHCs can store hydrogen indefinitely and the loss of hydrogen during storage is negligible. Economically, 60 days is an optimum time span for storage when compared to compressed hydrogen storage [46]. Long-term storage under ambient pressure is one of the advantages of using LOHCs [51]. A comparison of storage in terms of volumetric and gravimetric storage capacities for different H<sub>2</sub> storage technologies is displayed. They are clearly superior to Li-ion batteries in such terms, as shown in Figure 8 earlier.

### Space requirement

The space requirement for the LOHC technology depends on the size of the chosen system. Typically, medium to large-scale storage systems are in use. As seen in Tables 10 and 11, the smallest size is in the order of a 20-foot container for storage, while in the order of a 30-foot container for release. It is important to note

that, skid-based large-scale systems are economically more attractive and can be easily installed. They are significantly larger in size.

### Advantages/disadvantages

LOHCs are still upcoming in the market and only a few systems have been built so far. Given the option of matured carriers such as DBT, this technology has the probability of facilitation of large-scale hydrogen transport. In this section, advantages and disadvantages accompanied with LOHC technology are listed [44], [49].

Advantages:

1. It is an ideal way to store hydrogen on a large-scale, which further find use in transport applications.
2. LOHCs are designed for long-life operations with low maintenance, easy installation and low footprint.
3. They are very safe for such a high storage capacity i.e., no leakage prospects.

Disadvantages:

1. Strict assessment on toxicity of LOHCs need to be performed.
2. Heat integration for hydrogenation and dehydrogenation needs to be improved. Hydrogenation and dehydrogenation also consume power which is related to the efficiency of the compressor.

In addition, the pros and cons for DBT-LOHC in terms of energy density, transport limitations and cost effectiveness are shown in Table 13.

**Table 14: Summary of advantages and disadvantages of DBT-LOHC [45]**

Pros and cons for compressed and liquid hydrogen, circular methanol and DBT-LOHC as hydrogen storages. Plus sign (+) means strength and a minus sign (-) a weakness. <sup>a</sup>

	CH <sub>2</sub> (700 bar)	LH <sub>2</sub> (-253 °C)	Circular methanol	DBT-LOHC
Energy density	- Appr. 5.0 MJ L <sup>-1</sup>	+ Appr. 8.5 MJ L <sup>-1</sup>	++ Appr. 15.9 MJ L <sup>-1</sup>	+ Appr. 7.4 MJ kg <sup>-1</sup>
Reversibility	Not relevant	Not relevant	-- No	++ Good
Maturity of technologies	+ Existing	+ Existing	++ Good	+ Existing
Infrastructure compatibility	-- No	-- No	+++ Excellent	+++ Excellent
Transportation configuration	- Special (gas truck up to 1000 kg H <sub>2</sub> )	- Special (tube trailer, tanker 4000 kg H <sub>2</sub> )	+++ Ordinary truck (equiv. 4000 kg H <sub>2</sub> )	+++ Ordinary truck (1800 kg H <sub>2</sub> )
Transportation size, distance	- Limited (short distances, low demand)	- Limited (long distances, high demand)	+++ Unlimited	+++ Unlimited
Storage time (stability)	- Limited	--- Losses	+++ Unlimited	+++ Unlimited
Safety	- Concerns	- Concerns	± As gasoline	+++ Excellent
Biodegradability	Not relevant	Not relevant	+++ Excellent	-- Poor
Operability in dynamic use	+ Feasible	+ Feasible	+++ Excellent	± Limited today
Efficiency loss in conversion and transportation	± Appr. 6-15%	-- Appr. 30% plus boil-off	- Appr. 19%	- Appr. 22%
Costs of transportation	-- Transportation \$0.1-4 <sup>b</sup> & distribution \$1.1-1.8 <sup>c</sup> per kg H <sub>2</sub>	-- Transportation \$0.1-4 <sup>b</sup> & distribution \$1.1-1.8 <sup>c</sup> per kg H <sub>2</sub>	--- 3.1 € per kg H <sub>2</sub> (energy equiv. hydrogen <sup>d</sup> )	- 0.4 € per kg H <sub>2</sub> <sup>d</sup> (limited information)

<sup>a</sup> References in Sections 5.1-5.9.

<sup>b</sup> Compression, liquefaction, storage, transportation.

<sup>c</sup> To refuelling stations without costs of stations.

<sup>d</sup> Hydrogenation, dehydrogenation, transportation.

<sup>e</sup> Production (conversion of hydrogen to methanol).

### Environment

Many LOHC compounds are uncharged organics like conventional fuels as gasoline and petrol, thus volatile, flammable and lipophilic. Despite the risks, the world has been using conventional fuels with great success for many years now [51]. This, however, does not mean that LOHCs should follow the same pattern as there are compounds which have different characteristics in flammability, toxicity etc.

Toxicity studies have not been performed for all kinds of LOHCs but for promising ones for commercialization or for ones already in use, studies show that they are less toxic and in general more environmentally friendly.

One of the most mature LOHC compounds, DBT, has a low toxicity along with low flammability. Other LOHCs which are heterocyclic in nature, have similar risks of toxicity as diesel and gasoline. Additionally, nitrogen containing LOHC compounds also displayed better biodegradability in case of a spillover, similar to aromatics [45].

### Research and development perspectives

One of the challenges with LOHC technology is the limited market wing to an early phase. Furthermore, decentralized hydrogenation needs to be optimized. As mentioned earlier, catalyst costs can be a challenge and needs to be further investigated. Different combinations of LOHC compounds can lead to cost effective and large-scale solutions. Additionally, heat generated during hydrogenation needs to be recycled and used for system energy optimization [45]. An illustration of transport using LOHCs while integrating with the grid is displayed in Figure 11. Research in this field can facilitate heat integration to decrease the losses along with blending LOHCs in the existing feedstock.

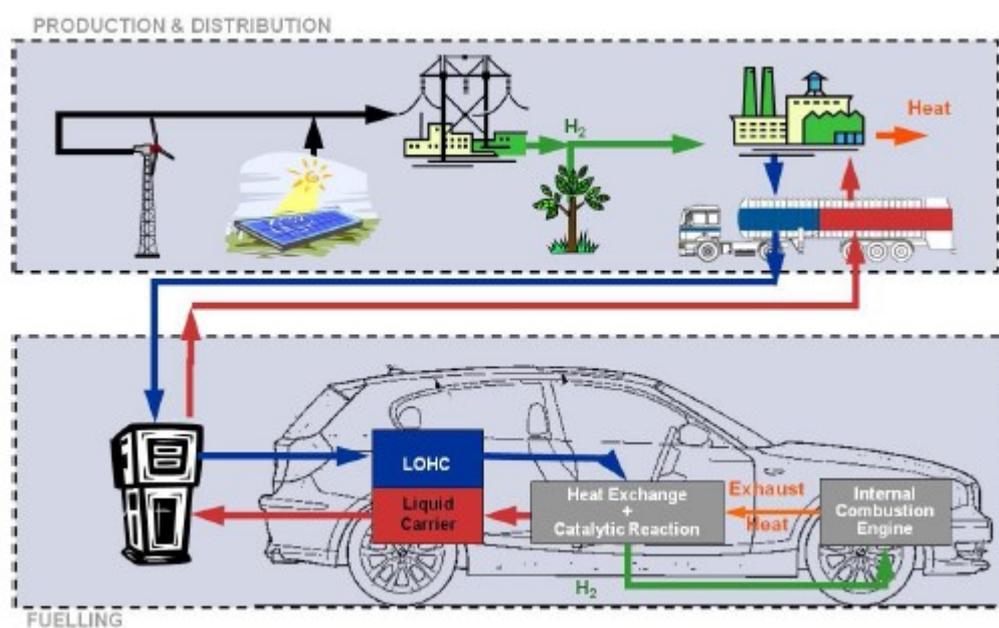


Figure 23: Prospective use of LOHCs in H<sub>2</sub> economy [53]

**Examples of market standard technology**

In this section, systems available in market are specified with their application and capacities. This is summarized in Table 14.

**Prediction of performance and cost**

LOHC storage is a relatively new technology as compared to pressurized tanks. Prediction of cost for the aforementioned system analyzed in this catalogue was performed using data collected from the company Hydrogenious. The assumption for economics relies on the fact that the storage is large-scale, and scalability leads to decrease in component cost and is thereby favorable. The cost analysis was performed on numbers predicted for an optimum size of 5,500 tons/day of H<sub>2</sub> storage, which is yet to be realized. The prices are uncertain, and market is volatile regarding LOHCs and data on the use of DBT-based LOHC system with solar power in Erlangen has been observed to result in H<sub>2</sub> delivery cost of €5 to €55 euros per kg H<sub>2</sub>. Additionally, H<sub>2</sub> transport is more economical than conversion into electricity. For short distances, LOHCs are not economical [45].

Table 15: LOHC systems available in the market

Image	Usage	Year	Specs.	Technology provider	Ref.
	Mid to large-scale transport and stationary applications.	2016	hydrogenate capacity: 792 Nm <sup>3</sup> hydrogen / day	Hydrogenious	[49]
	Stationary system connected with electrolyzer and fuel cell for smart grid applications	2018	hydrogenate capacity: 94 Nm <sup>3</sup> hydrogen / day	Covalion	[54]

**Uncertainty**

The uncertainty in cost prediction arises from the size of ships utilizing H<sub>2</sub> from LOHCs. For this technology to be economic, a large-scale production of H<sub>2</sub> is assumed. Currently, Hydrogenious is working on a future

## 151 Hydrogen Storage

---

capacity of 5,500 ton/day of H<sub>2</sub>. Furthermore, heat integration could lead to increase in efficiency and thereby a cost reduction.

**Table 16: Cost of LOHC technology**

Hydrogen cost	1 \$/kg
Storage	0.15 \$/kg
Transport (30 days one-way)	0.44 \$/kg
On site storage and release	1.31 \$/kg
Total cost of ownership	2.9 \$/kg

### Cost examples

The cost data for LOHC system includes the system cost for a storage and release unit. Since this technology is new in the market, the data for cost of hydrogen supply, transport in addition are listed in Table 15, as received from Hydrogenious.

### Acknowledgement

A sincere thanks to Dr. Cornelius von der Heydt from Hydrogenious LOHC technologies for his insights which significantly helped in the completion of this report.

# 151 Hydrogen Storage

## Data sheet

Technology	name / description										Note	Ref	Explanation	
	2015	2020	2030	2040	2050	Uncertainty (2020)		Uncertainty (2050)						
<b>Energy/technical data</b>														
Form of energy stored	Hydrogen gas													
Application	Large-scale liquid organic hydrogen carrier for transport													
Energy storage capacity for one unit (MWh)	7	7	7	7	7	7	7	7	7	7	A			
Output capacity for one unit (MW)	0.1	2	5	10	50	-	-	-	-	-				
Input capacity for one unit (MW)	0.3	7	34	70	300	2	2	50	500		B			
Round trip efficiency (%)	72%	72%	74%	75%	75%	75%	75%	75%	75%		C	47		
- Charge efficiency (%)	72%	72%	74%	75%	75%									
- Discharge efficiency (%)	~100	~100	~100	~100	~100	~100	~100	~100	~100			47	Input and Output efficiency are exactly the other way round (i.e. output at 72%)	
Energy losses during storage (%/ period)	<1	<1	<1	<1	<1	<1	<1	<1	<1		9		Loss is time independent!	
Auxiliary electricity consumption (% of output)	<1	<1	<1	<1	<1	<1	<1	<1	<1				Expressed only for heat and gas storages	
Forced outage (%)	0	0	0	0	0	0	0	0	0					
Planned outage (weeks per year)	2	2	2	2	2	2	2	2	2			47		
Technical lifetime (years)	20	20	20	20	20	20	20	20	20			47		
Construction time (years)	-	-	-	-	-	-	-	-	-					
<b>Regulation ability</b>														
Primary regulation (% per 30 sec)	-	-	-	-	-							D		
Secondary regulation (% per minute)	-	-	-	-	-									
<b>Financial data</b>														
Specific investment (M€015 per MWh)	0.00084	0.00084	0.0005	0.00045	0.0004	0.00084	0.00084	0.0004	0.0003		E		Investment per MWh is not a relevant factor for the LOHC technology as MW and MWh are fully independent, thus the full investment per MWh depends on the specific case. Therefore I also cannot follow / understand your numbers.	
- hereof equipment (M€015 per MWh)	0.0005	0.0005	0.0003	0.00027	0.00024	0.0005	0.0005	0.00024	0.00018		F			
- hereof installation (M€015 per MWh)	0.00034	0.00034	0.0002	0.00018	0.00016	0.00034	0.00034	0.00016	0.00012		F			
Fixed O&M (€015/MWh/year)	0.0000336	0.0000336	0.00002	0.000018	0.000016	0.0000336	0.0000336	0.000016	0.000012		G			
Variable O&M (€015/MWh)	0.0000084	0.0000084	0.000005	0.0000045	0.000004	0.0000084	0.0000084	0.000004	0.000003		H			
<b>Technology specific data</b>														
Specific energy (Wh/kg)	2080	2080	2080	2080	2080	2080	2080	2080	2080			43	See table in the specific section	
Energy density (kWh/m3)	1900	1900	1900	1900	1900	1900	1900	1900	1900			43		

### Notes:

- A Calculated based on techno-economic data of 12tpd plant from Hydrogenious
- B Losses during hydrogenation
- C Efficiency as received from Hydrogenious
- D LOHC uptake does not change with part load operation
- E Investment cost on the lines of 5500 tpd scenario.
- F Assuming 60% as equipment cost and 40% as installation cost
- G Fixed O&M is treated at 4% of CAPEX (Data obtained from hydrogenious)
- H Variable O&M is treated as 1% of CAPEX

### Hydrogen storage in caverns

#### Technology description

In this section, underground storage of hydrogen will be addressed. This is accompanied by the possibility of high-volume storage on long-term basis. Conventionally, natural gas storage in salt caverns has been performed for decades [55]. This is particularly useful dealing with intermittent energy power production through solar and wind, since large quantities of methane can be used for grid balancing. Given an infrastructure facilitating hydrogen, hydrogen can be used for storage instead of natural gas or methane. Furthermore, a pressure of 20 MPa is recommended for efficient hydrogen storage but also varies depending on the cavern size [56].

The following underground hydrogen storage options have been investigated previously [57]:

- Aquifers: porous storage
- Depleted hydrocarbon deposits
- Salt caverns

In this chapter, the focus is on hydrogen storage in salt caverns. Salt formations are already existing and can be developed into gas storage depending on the suitability of the salt feature. For this, water is pumped into the formation and salt is dissolved herewith leaving behind a void. Thereafter, saline water is pumped back and the process is repeated until the required gas storage size is attained [58]. The advantages of such storages compared to other underground storage technologies are presented in Table 16.

It is of particular interest to discuss the details of salt caverns for storage since the storage is more controlled and gas tight over a long-term period, as compared to hydrogen tanks [59]. Additionally, it is the most economical way to implement large scale electricity storage in the form of hydrogen or methane [59], [60].

Particularly, in the case of Denmark, 7 existing salt caverns are being used for natural gas storage at Lille Torup and several in Hvornum for brine production. The natural gas caverns can be converted into hydrogen gas storage by facilitating a hydrogen infrastructure. For this, the caverns are flooded in order to displace methane while maintaining a high pressure in the cavern. This leads to leaching of the cavern. Once the natural gas is displaced, hydrogen can be stored in the cavern by gas compression.

#### Input/output

The input for salt caverns is in the form of hydrogen gas, which is produced through electrolysis of water or steam methane reforming. The stored hydrogen is compressed up to 20 MPa and stored in a gas tight cavern. Gas injection systems are employed. For releasing the hydrogen gas, gas withdrawal units are employed, and hydrogen can in turn be used for combustion in a gas turbine or a fuel cell, in case of electricity production.

Table 17: Comparison of underground storage for hydrogen [57]

Relevant geological, technical, environmental, health and cost aspects of various options for underground hydrogen storage.

	Deep aquifers	Depleted oil and gas fields	Salt caverns
<b>Occurrence</b>	Prevalence in all sedimentary basins	Traps accumulating hydrocarbons	Prevalence in many sedimentary basins
<b>The depth of deposits</b>	Various depths, optimally up to 2000 m	Various depths, optimally up to 2000 m	Various depths, optimally up to 1500 m
<b>Lithology of site storage and caprock</b>	Reservoir rocks with high porosity and high permeability, roof rocks providing seal, not cracked	Reservoir rocks with high porosity and high permeability, roof rocks providing seal, not cracked	Thick salt deposits; salt beds seem most appropriate
<b>Recognition</b>	Low. Recently recognised in Europe in the context of assessing the potential for CCS	Geology well recognised	Well recognised salt formations in Europe
<b>Storage capacity</b>	Very high and high	High and very high. Close to the quantity of exploited gas	High. Corresponding to the volume of a cavern or a group of cavern
<b>Geological tightness</b>	The tightness of aquifer initially unknown, a low risk of gas leakage	The existence of gas deposits confirms their tightness	The tightness is assured by favorable properties of the salt rock
<b>Required research</b>	Possible leakage paths (geophysical surveys, exploratory borehole and borehole tests, laboratory testing of rock samples). Chemical, mineralogical and biological reactivity between hydrogen and the rock formation and its sealing overburden; tightness of gaprocks for hydrogen permeation. Monitoring of the tightness and controlling of reservoir pressure. Detailed characteristics of the storage site and creation of a digital model	Monitoring of the tightness and controlling of reservoir pressure. Chemical, mineralogical and biological reactivity between hydrogen and reservoir rocks and its sealing overburden; tightness of caprock for hydrogen permeation. Detailed characteristics of the storage site and creation of a digital model	Geophysical surveys of salt caverns during cavern leaching. Periodic surveys of changes in the cavern during operation. Detailed characteristics of the site storage and creation of a digital model
<b>Recent experience throughout the world</b>	No experience with storage of pure hydrogen. Numerous underground stores of natural gas working successfully	No experience with storage of pure hydrogen. Numerous underground stores of natural gas working successfully	Positive experience with storage of hydrogen and other gases
<b>Availability of geological structures and existing infrastructure</b>	Availability of deep aquifer with sufficiently recognised favorable geological conditions, usually close to end users. No infrastructure on deposits	Availability of deposits (natural geological traps) with recognised favorable geological and mining conditions. The existing infrastructure on a deposit could be adapted for gas storage	Availability of salt deposits with sufficiently recognised favorable geological and mining conditions. No infrastructure on deposits
<b>Injection and withdrawal cycles</b>	One, maximum two cycles of injection and withdrawal per year	One, maximum two cycles of injection and withdrawal per year	Possibility of multiple (up to 10) cycles of injection and withdrawal of gas per year
<b>Number of boreholes</b>	A few boreholes for injection and withdrawal of gas; additional observational boreholes required	A few boreholes for injection and withdrawal of gas; additional observational boreholes required	One borehole per cavern
<b>Technical tightness</b>	Boreholes (necessity of liquidation or sealing those already existing, borehole new ones, resistant to hydrogen)	Boreholes (necessity of liquidation or sealing those already existing, borehole new ones, resistant to hydrogen)	Boreholes (necessity of liquidation or sealing those already existing, borehole new ones, resistant to hydrogen)
<b>Flexibility of cycling</b>	Used for seasonal storage	Used for seasonal storage	Possible use for storage more frequent than seasonal
<b>Impurities in withdrawn gas</b>	Undesirable reactions producing gases such as H <sub>2</sub> S and CH <sub>4</sub> with loss of hydrogen	Undesirable reactions producing gases such as H <sub>2</sub> S and CH <sub>4</sub> with loss of hydrogen, mixing of residual hydrocarbons with hydrogen in the case of depleted oil fields	Impurities caused by undesirable reactions between hydrogen and interbeddings other than rock salt
<b>Limitations</b>	Adaptation of existing boreholes for hydrogen storage may not be feasible. The availability of suitable technology and equipment for the construction and operation of the storage system	Adaptation of existing boreholes for hydrogen storage may not be feasible. The availability of suitable technology and equipment for the construction and operation of the storage system. Reactivity of hydrogen with liquid hydrocarbons limiting the usefulness of depleted oil fields	Convergence causing clamping of the cavern. The availability of suitable technology and equipment for the construction and operation of the storage system. The availability of water for cavern leaching
<b>Cost of construction and operation</b>	The costs higher than the cost of storage in salt caverns or hydrocarbon deposits	The lowest storage costs for the use of depleted natural gas deposits, higher for oil fields	Higher than in depleted hydrocarbon fields

## Components in hydrogen caverns storage systems

Through renewable energy power production sources such as wind turbines or photovoltaic modules, the excess electricity is in turn converted to hydrogen using electrolyzers. Hydrogen could, however, also be produced from natural gas. Then the hydrogen gas is compressed into the cavern. During the release of hydrogen, it is supplied to gas turbines or fuel cells for power production,

*The properties of the salt cavern which will be analyzed in this report to serve as a storage option for hydrogen is presented in Table 17. This data is an average of the range of data acquired from literature and the existing infrastructure for gas storage in caverns.*

Table 18: Description of salt cavern for hydrogen storage analysis

Parameters	Salt cavern (Undergroundstorage)	Reference
Diameter	100 m	[59]
Gas volume	500,000 m <sup>3</sup>	[57], [59]
Gas depth	1,000 m	[56], [57], [59]
Gas pressure	100 bar	[56], [57], [59]
Duration	50 years	[60]

### Energy efficiency and losses

A typical operation of hydrogen storage in salt caverns relies on the pressure. Compression and expansion of hydrogen between minimum and maximum pressure limit dictates the functioning. In practice, initial formation pressure at the desired depth is taken as a reference. Following this, 80% of this initial pressure is the recommended maximum pressure. Furthermore, 30% of the maximum pressure is the recommended minimum pressure [61].

For instance, in the case of 1,000 m deep salt cavern with a volume of approximately 500,000 m<sup>3</sup>, the required working gas is in the order of 4,300 tons. After achieving the minimum pressure, the gas cavern volume, known as the cushion gas, would be in the order of 2,150 tons of hydrogen gas. Maximum flowrates in the boreholes govern the filling and emptying of the cavern. Maximum withdrawal rates are in the order of 10 % of the storage capacity per day [61]. A schematic of withdrawal and injection of H<sub>2</sub> in salt caverns while integrating in the existing grid using renewables for power production is shown in Figure 12.

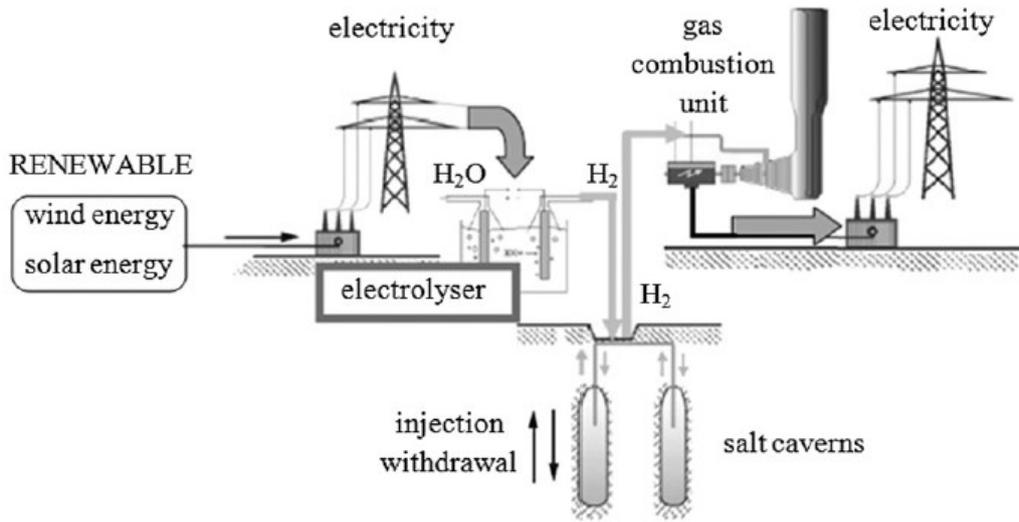


Figure 24: An illustration of H<sub>2</sub> storage in salt caverns. As an example it is shown that the hydrogen can be used for power generation. [56]

### Operational losses

Losses during injection of hydrogen into the cavern needs to be considered. Furthermore, compression of gas up to 200 bars will lead to power consumption. During extraction, no losses are considered due to over pressure of hydrogen stored in the caverns.

### Standby losses

During storage, undesirable reactions may lead to impurities in the salt caverns. Furthermore, the integrity of the permeability of the rock salt is of importance. Usually, salt caverns are leak tight and insignificant storage losses are assumed.

### Energy Efficiency

Energy efficiency of hydrogen compression in caverns.

Energy efficiency or roundtrip efficiency of the hydrogen storage system described is given by Equation (4)

$$\eta_{roundtrip} = \frac{E_{hydrogen\ out}}{E_{hydrogen\ in} + E_{compression} + E_{pressure\ losses}} \times 100\% \quad (4)$$

For such a system, the the  $E_{hydrogen\ out}$  of the system is its capacity of 500 kg, based on volume and density of hydrogen stored, multiplied by 33.33 kWh/kg, similar to the amount of  $E_{hydrogen\ in}$ . The energy consumed by the compressor for the compression of 1 kg to 200 bar is approximately 4 kWh/kg [19], [22]. The energy losses due to permeation and pressure losses are negligible. In the calculations however, a collective 0.01% will be assigned to them to indicate a margin of error and uncertainty for compression. Given this, the Equation (4) can be calculated as follows:

$$\eta_{roundtrip} = \frac{150000MWh}{150000MWh + 1500MWh + \sim 0} \times 100\% = 99\%$$

The roundtrip efficiency of the storage system assumes that the electricity for the compression can be translated into a 1:1 loss in the energy content of the hydrogen.

**Typical characteristics and capacities**

In this section, characteristics of pre-existing salt caverns used for hydrogen storage are described, as concisely presented in Table 18. Since salt caverns is a mature technology, these characteristics serve as a guide for hydrogen storage capacities.

Table 19: Existing salt caverns with their characteristics [62]

Characteristics	Teeside	Cheshire Basin	East Yorkshire	East Irish Sea
Size (volume m <sup>3</sup> )	70,000	300,000	300,000	300,000
Depth (m)	370	680	1,800	680
Operating pressure (bar)	45	105	270	105

**Typical storage period**

Typical storage period has been mentioned in the literature as 50 years or more [60]. Since the underground storage already exists, it can be used for long periods of time. The disadvantages of reactivity of hydrogen with rock material has been mentioned previously. Hydrogen permeability might be an issue shortening the storage period. The preferential timescales and capacities intended at applications is shown in Figure 13. Clearly H<sub>2</sub> storage has a large scale and long-term storage potential.

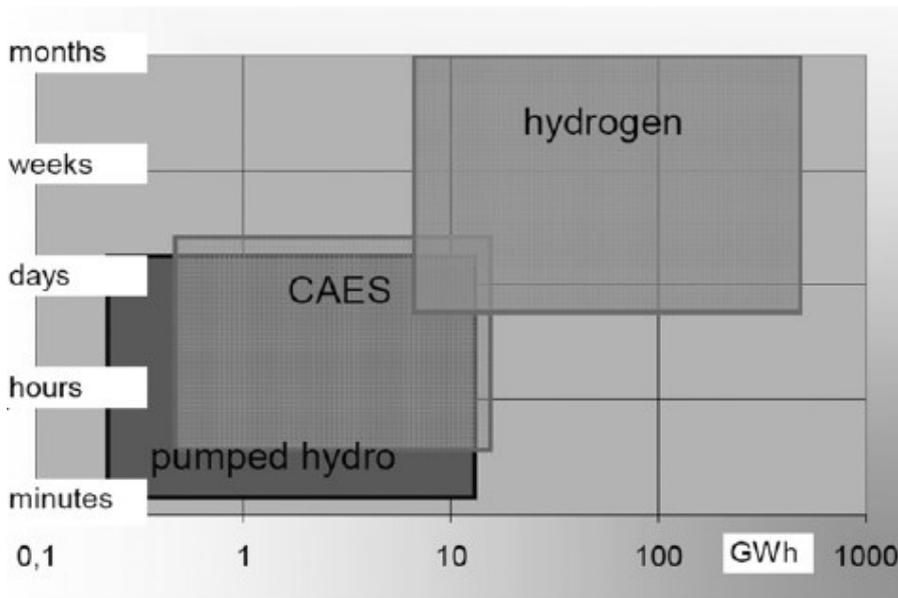


Figure 25: Timescale of storage technologies [61]

### Space requirement

Since salt formations are already existing, some of them can be leached in order to store hydrogen and additional infrastructure is not required. Usually, salt caverns have a very high storage capacity in the order of 500,000 m<sup>3</sup>. As explained in technology description, the specifications of the cavern are significantly higher than LOHCs and tank storage, discussed earlier in this catalogue.

### Advantages/disadvantages

Currently only a few salt caverns are operational as H<sub>2</sub> storage facilities. Due to the large-scale storage, the investment cost is low when an already existing natural gas cavern needs to be converted for hydrogen storage. Availability of desired geology is a disadvantage with this technology currently. In this section, the advantages and disadvantages are listed.

Advantages:

1. Large volume storage-useful for grid balancing and supply/demand balance.
2. Long-term storage solution with unlimited lifetime and low footprint.
3. Suitable for short-term peak shaving operations [59].
4. Much lower investment costs per storage unit than hydrogen tanks.

Disadvantages:

1. Low energy density as compared to oil stored in salt caverns.
2. Limited salt structures

### Environment

Storage of hydrogen in salt caverns usually leads to low losses. Strength of the cavern determines the extent of hydrogen leakage, which is usually not a big issue but is still under investigation [56]. Since the technology is mature, the only damage can be due to the blow-off of the cavern head due to excess pressure leading to a gas leak. To avoid this, safety valves are in place and automatically close the head [61].

### Research and development perspectives

The issue relating to permeability is of utmost importance. Investigation into undesirable reactions leading to hydrogen embrittlement and loss of wall integrity are in progress [56]. Progress in the field of compression technology is also being investigated. Tightness during underground storage along with selection of geological structure to facilitate it need to be further investigated [57]. Research in the field of market mobility and cost of hydrogen production will also determine the potential of large scale storage using salt caverns [60].

### Examples of market standard technology

In this section, the 4 pre-existing gas caverns for hydrogen storage are addressed again. Since the technology is only in use in 3 places, the details of the caverns are described in Table 19. One of them consists of three small single caverns in operation in Teeside, UK which can store 1,000 ton of H<sub>2</sub>. The other one is in operation in Texas, USA which is the largest storage system which can store H<sub>2</sub> for 30 days i.e., 10,000-20,000 tonnes of H<sub>2</sub>. [56]. The third one is a demonstration project planned for operation in 2023 in Germany which is aimed at 3,500 tonnes of H<sub>2</sub> storage [10].

Table 20: Market technology for hydrogen storage in the form of salt caverns [56]

<b>Table 2 – Brief information of underground hydrogen gas storage facilities [5,31–33].</b>		
Location	Teesside-UK	Chevron, Texas-USA
Storage type	Salt cavern	Salt cavern
Storage volume	3 × 150,000 m <sup>3</sup>	580,000 m <sup>3</sup>
Storage depth	≈ 370 m	850–1150 m
Gas Pressure	45 bar <sup>a</sup> (constant)	70–135 bar <sup>a</sup>
Energy	24.4 GWh	83.3 GWh

a 10bar ≈ 1 MPa.

### Prediction of performance and cost

The prediction of cost for the caverns depends on the compression of gas into the pre-existing rock salt structure. For this, operating pressure for hydrogen injection is a significant parameter. For improving the

cycle efficiency, the stress and over pressure limits can be optimized for the salt cavern [63]. The cost also depends on the leak tightness and embrittlement. Economically, it is the cheapest large-scale hydrogen storage technology. Furthermore, it is a mature technology and the state-of-the-art cost analysis is a good indicator of realizing this technology.

### Uncertainty

The uncertainty in economics of large-scale hydrogen storage using gas caverns arises from the potential of hydrogen production infrastructure such as electrolysis for cost reduction. Furthermore, improvement in compressor quality, gas injection mechanisms and rock permeability studies can ensure leak tight and long-term safe storage.

### Cost examples

Examples of pre-existing salt caverns for hydrogen storage from literature are presented in Table 20. A comparison between onshore and offshore caverns is also presented. Maximum cost is incurred during the installation and low maintenance costs are associated with this technology.

Table 21: Pre-existing salt caverns for storage-cost breakdown

		Onshore			Offshore
		Teesside	Cheshire Basin	East Yorkshire	East Irish Sea
Salt Cavern storage size	m <sup>3</sup>	70,000	300,000	300,000	300,000
Salt cavern depth	m	370	680	1800	680
Salt cavern operating pressure	bara	45	105	270	105
Number of cavern required for weekly operational mode and with combined storage		21	3	1	3
Water / Brine pipeline length	km	5	61	5	1
Costs					
Jack-up drilling rig hiring cost	Million £	-	-	-	5.2
Specialist drilling equipment hiring cost	Million £	-	-	-	1.2
Geological survey cost	Million £	3.0	3.0	3.0	6.0
Salt cavern construction cost	Million £	128.5	39.3	26.8	39.3
Water pipeline cost	Million £	2.7	33.2	2.7	0.5
Brine pipeline cost	Million £	2.7	33.2	2.7	0.5
Costs of a 4 legged tower 'Jacket' structure	Million £	-	-	-	18.8
Install cost of topside and above ground facility	Million £	97.1	130.2	205.9	350.8
Land costs (5%)	Million £	11.7	11.9	12.1	20.8
Owners costs (10%)	Million £	23.4	23.9	24.1	41.6
Contingency (25%)	Million £	58.5	59.7	60.3	104.0
Cost of production of cushion gas	Million £	1.4	1.8	2.2	1.8
Total project cost	Million £	329.0	336.4	339.9	590.5

**Acknowledgement**

A sincere thanks to Tine Lindgren and Rune H. Gjermundbo from Gas storage Denmark for their insights into salt cavern economics and limitations.

# 151 Hydrogen Storage

## Data sheet

Technology	name / description										Note	Ref	Explanation
	2015	2020	2030	2040	2050	Uncertainty (2020)		Uncertainty (2050)					
Energy/technical data	Hydrogen gas					Lower	Upper	Lower	Upper				
Form of energy stored	Hydrogen gas												Electricity, heat or gas System or local (if electricity specify also if power-intensive or energy-intensive)
Application	Large-scale stationary hydrogen production												
Energy storage capacity for one unit (MWh)	150000	150000	150000	150000	150000	150000	150000	150000	150000	A	54-57		
Output capacity for one unit (MW)	-	-	-	-	-	-	-	-	-				
Input capacity for one unit (MW)	180	175	170	160	150	150	150	150	150	B	54-57		
Round trip efficiency (%)	99%	99%	99%	99%	99%	99%	99%	99%	99%		54-57		
- Charge efficiency (%)	99%	99%	99%	99%	99%	98%	99%	99%	99%		54-57		
- Discharge efficiency (%)	~100	~100	~100	~100	~100	~100	~100	~100	~100		54-57		
Energy losses during storage (% / period)	<1	<1	<1	<1	<1	<1	<1	<1	<1	C			
Auxiliary electricity consumption (% of output)	<1	<1	<1	<1	<1	<1	<1	<1	<1			Expressed only for heat and gas storages	
Forced outage (%)	0	0	0	0	0	0	0	0	0				
Planned outage (weeks per year)	-	-	-	-	-	-	-	-	-	D			
Technical lifetime (years)	100	100	100	100	100	100	100	100	100		57		
Construction time (years)	-	-	-	-	-	-	-	-	-	E			
<b>Regulation ability</b>													Only for electricity storage
Primary regulation (% per 30 sec)	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	F			
Secondary regulation (% per minute)	6.7	6.7	6.7	6.7	6.7	6.7	6.7	6.7	6.7				
<b>Financial data</b>													See table in the specific section
Specific investment (M€0.5 per MWh)	0.003	0.003	0.002	0.0015	0.0012	0.003	0.003	0.0015	0.001		59		
- hereof equipment (M€0.5 per MWh)	0.0009	0.0009	0.0006	0.0005	0.0004	0.0009	0.0009	0.0009	0.0009		59		
- hereof installation (M€0.5 per MWh)	0.0018	0.0018	0.0012	0.0009	0.0007	0.0018	0.0018	0.0018	0.0018		59		
Fixed O&M (€0.15/MW/year)	0.00006	0.00006	0.00004	0.00003	0.000024	0.00006	0.00006	0.000036	0.00002	G	57		
Variable O&M (€0.15/MWh)	0.00003	0.00003	0.00002	0.000015	0.000012	0.00003	0.00003	0.000018	0.00001	H			
<b>Technology specific data</b>													
Gravimetric energy density (Wh/kg)	33.3	33.3	33.3	33.3	33.3	33.3	33.3	33.3	33.3	I			
Volumetric energy density @0°C and 1atm											I		
Permeation characteristics (mol/s/m/M Pa <sup>1/2</sup> )	-	-	-	-	-	-	-	-	-	J			

### Notes:

- A Calculated based on techno-economic data of 12tpd plant from Hydrogenious
- B Losses during hydrogenation
- C Efficiency as received from Hydrogenious
- D LOHC uptake does not change with part load operation
- E Investment cost on the lines of 5500 tpd scenario.
- F Assuming 60% as equipment cost and 40% as installation cost
- G Fixed O&M is treated at 4% of CAPEX (Data obtained from hydrogenious)
- H Variable O&M is treated as 1% of CAPEX

### References

- [1] M. Kraglund, "Alkaline membrane water electrolysis with non-noble catalysts," Technical University of Denmark, 2017.
- [2] J. Jonas, "THE HISTORY OF HYDROGEN." .
- [3] N. T. Stetson, S. McWhorter, and C. C. Ahn, *Introduction to hydrogen storage*, vol. 2006. Elsevier Ltd., 2015.
- [4] N. T. Stetson, S. McWhorter, and C. C. Ahn, *Introduction to hydrogen storage*, vol. 2006. Elsevier Ltd., 2015.
- [5] M. van der Hoeven, *Technology Roadmap Hydrogen and Fuel Cells*. International Energy Agency, 2015.
- [6] HydrogenEurope, "Hydrogen storage." [Online]. Available: <https://hydrogeneurope.eu/hydrogen-storage>.
- [7] HydrogenEurope, "Hydrogen storage." .
- [8] C. G. Chochlidakis, "Hydrogen Fueling Methods," Technical University of Denmark, 2018.
- [9] M. Niermann, S. Drünert, M. Kaltschmitt, and K. Bonhoff, "Liquid organic hydrogen carriers (LOHCs)-techno-economic analysis of LOHCs in a defined process chain," *Energy Environ. Sci.*, vol. 12, no. 1, pp. 290–307, 2019.
- [10] "The Future of Hydrogen," *Futur. Hydrog.*, no. June, 2019.
- [11] B. D. James and C. Houchins, "2017 DOE Hydrogen and Fuel Cells Program review," *Annual Merit Review Proceedings*, no. June. 2017.
- [12] J. Andersson and S. Grönkvist, "Large-scale storage of hydrogen," *Int. J. Hydrogen Energy*, vol. 44, no. 23, pp. 11901–11919, 2019.
- [13] J. Zheng, X. Liu, P. Xu, P. Liu, Y. Zhao, and J. Yang, "Development of high pressure gaseous hydrogen storage technologies," *Int. J. Hydrogen Energy*, vol. 37, no. 1, pp. 1048–1057, 2012.
- [14] E. D. Rothuizen, "Hydrogen Fuelling Stations: A Thermodynamic Analysis of Fuelling Hydrogen Vehicles for Personal Transportation," Technical University of Denmark, 2013.
- [15] "Technical Assessment of Cryo-Compressed Hydrogen Storage Tank Systems for Automotive Applications Nuclear Engineering Division."
- [16] A. Léon, *Hydrogen Technology*, vol. 53, no. 9. 2013.
- [17] H. Dagdougui, R. Sacile, C. Bersani, and A. Ouammi, "Hydrogen Storage and Distribution: Implementation Scenarios," in *Hydrogen Infrastructure for Energy Applications*, no. Atex 137, 2018, pp. 37–52.
- [18] S. Tretsiakova-McNally, "LECTURE - Safety of hydrogen storage," *HyResponse*, 2016.
- [19] "Telephone conversation with Nel Hydrogen- Joshua Adams." Herning, Jul 15, 2019.

- [20] C. Red, "Pressure vessels for alternative fuels, 2014-2023." [Online]. Available: <https://www.compositesworld.com/articles/pressure-vessels-for-alternative-fuels-2014-2023>.
- [21] C. Red, "Pressure vessels for alternative fuels, 2014-2023." .
- [22] "Telephone conversation with a researcher in DTU- E.Rothuizen", Jul 15, 2019.
- [23] H. Barthélémy, "HYDROGEN STORAGE – RECENT IMPROVEMENTS AND INDUSTRIAL PROSPECTIVES."
- [24] NelHydrogen, "Hydrogen Supply Storage." [Online]. Available: <https://nelhydrogen.com/product/hydrogen-supply-storage-ss001/>.
- [25] CMW, "City Machine & Welding Inc. Tube trailer specs." [Online]. Available: <https://cmwelding.com/configuration/hydrogen-h2-tube-trailer-9-tubes-dot-3aax-2400psi-40-ft>.
- [26] Doosan, "Product specs." [Online]. Available: <https://store.doosanmobility.com/innovationoffice/app/goods/detailGoods/412/action.do>.
- [27] Hexagon, "Hydrogen Storage and Transportation flyer by Hexagon." p. 2, 2019.
- [28] Mahytec, "COMPRESSED HYDROGEN STORAGE." [Online]. Available: <http://www.mahytec.com/en/products/compressed-hydrogen-storage/>.
- [29] SteelHead, "Type 3 tanks specifications." [Online]. Available: <https://steelheadcomposites.com/h2-specifications/?iframe=true>.
- [30] FIBAtch, "Type II specifications." [Online]. Available: <https://www.fibatech.com/wp-content/uploads/2018/02/Type-2-Vessel.pdf>.
- [31] FIBAtch, "Type II specifications." .
- [32] "Telephone conversation with HyBalance Project." Hobro, 2019.
- [33] NelHydrogen, "Hydrogen Supply Storage." .
- [34] D. Jovana and S. Svetlana, "Review on Compressed Hydrogen as Contemporary Renewable Energy Resource," *Univers. J. Manag.*, vol. 5, no. 7, pp. 313–319, 2017.
- [35] N. Asa, G. Vislie, V. P. Consulting, and J. Andr, "Nel ASA : Status update # 5 regarding incident at Kjørbo," pp. 1–2, 2019.
- [36] U.S. Department of Energy, "Physical Hydrogen Storage." [Online]. Available: <https://www.energy.gov/eere/fuelcells/physical-hydrogen-storage>.
- [37] J. Zheng, X. Liu, P. Xu, P. Liu, Y. Zhao, and J. Yang, "Development of high pressure gaseous hydrogen storage technologies," *Int. J. Hydrogen Energy*, vol. 37, no. 1, pp. 1048–1057, 2012.
- [38] NelHydrogen, "Press Release: Nel proposed for a \$ 2 million award on project regarding fueling of heavy-duty hydrogen vehicles," 2019. .
- [39] "Linde's ionic compressor \_ Linde." [Online]. Available: <https://whyhydrogen.linde.com/lindes-ionic-compressor/>.
- [40] Mahytec, "LARGE VOLUME STORAGE SOLUTION MAHYTEC." [Online]. Available: <http://www.mahytec.com/en/large-volume-hydrogen-storage-solution-mahytec/>.

- [41] HyBalance, "HyBalance Homepage." [Online]. Available: <http://hybalance.eu>.
- [42] K. H. Pi, J. Martin, M. Peters, O. Smith, and D. Terlip, "Overview of an Integrated Research Facility for Advancing Hydrogen Infrastructure Project," 2016.
- [43] DOE, "DOE Technical Targets for Onboard Hydrogen Storage for Light-Duty Vehicles." [Online]. Available: <https://www.energy.gov/eere/fuelcells/doe-technical-targets-onboard-hydrogen-storage-light-duty-vehicles>.
- [44] D. Teichmann, W. Arlt, P. Wasserscheid, and R. Freymann, "A future energy supply based on Liquid Organic Hydrogen Carriers (LOHC)," *Energy Environ. Sci.*, vol. 4, no. 8, pp. 2767–2773, 2011.
- [45] P. T. Aakko-Saksa, C. Cook, J. Kiviaho, and T. Repo, "Liquid organic hydrogen carriers for transportation and storing of renewable energy – Review and discussion," *J. Power Sources*, vol. 396, no. April, pp. 803–823, 2018.
- [46] M. Niermann, A. Beckendorff, M. Kaltschmitt, and K. Bonhoff, "Liquid Organic Hydrogen Carrier (LOHC) – Assessment based on chemical and economic properties," *Int. J. Hydrogen Energy*, vol. 44, no. 13, pp. 6631–6654, 2019.
- [47] D. Teichmann, K. Stark, K. Müller, G. Zöttl, P. Wasserscheid, and W. Arlt, "Energy storage in residential and commercial buildings via Liquid Organic Hydrogen Carriers (LOHC)," *Energy Environ. Sci.*, vol. 5, no. 10, pp. 9044–9054, 2012.
- [48] M. Niermann, A. Beckendorff, M. Kaltschmitt, and K. Bonhoff, "Liquid Organic Hydrogen Carrier (LOHC) – Assessment based on chemical and economic properties," *Int. J. Hydrogen Energy*, vol. 44, no. 13, pp. 6631–6654, 2019.
- [49] Hydrogenious, "Infrastructure Solutions." [Online]. Available: <https://www.hydrogenious.net/wp-content/uploads/2018/08/Hydrogenious-LOHC-Technologies-Product-Brochure.pdf>
- [50] P. Preuster, C. Papp, and P. Wasserscheid, "Liquid organic hydrogen carriers (LOHCs): Toward a hydrogen-free hydrogen economy," *Acc. Chem. Res.*, vol. 50, no. 1, pp. 74–85, 2017.
- [51] M. Markiewicz *et al.*, "Environmental and health impact assessment of Liquid Organic Hydrogen Carrier (LOHC) systems-challenges and preliminary results," *Energy Environ. Sci.*, vol. 8, no. 3, pp. 1035–1045, 2015.
- [52] A. Seidel, "Refuelling of fuel cell vehicles by hydrogen from the LOHC process," no. 1, pp. 2–8, 2019.
- [53] W. E. Tegrotenhuis, P. Humble, and P. Northwest, "Liquid Organic Hydrogen Carriers ( LOHC ): An Auspicious Alternative to Liquid Organic Hydrogen Carriers ( LOHC ): An auspicious alternative to conventional hydrogen storage technologies," no. January 2010, 2015.
- [54] Covalion, "LOHC Systems: Energy storage with liquid organic hydrogen carriers."
- [55] P. Breeze, "CHAPTER 8 Hydrogen Energy Storage," in *Power System Energy Storage Technologies*, Academic Press, 2018.
- [56] A. Ozarlan, "Large-scale hydrogen energy storage in salt caverns," *Int. J. Hydrogen Energy*, vol. 37, no. 19, pp. 14265–14277, 2012.
- [57] R. Tarkowski, "Underground hydrogen storage: Characteristics and prospects," *Renew. Sustain. Energy Rev.*, vol. 105, no. February 2017, pp. 86–94, 2019.

- [58] Energistyrelsen, "Technology Data: Energy Storage", ver 5, 2018.
- [59] J. Michalski *et al.*, "Hydrogen generation by electrolysis and storage in salt caverns: Potentials, economics and systems aspects with regard to the German energy transition," *Int. J. Hydrogen Energy*, vol. 42, no. 19, pp. 13427–13443, 2017.
- [60] A. Le Duigou, A. G. Bader, J. C. Lanoix, and L. Nadau, "Relevance and costs of large scale underground hydrogen storage in France," *Int. J. Hydrogen Energy*, vol. 42, no. 36, pp. 22987–23003, 2017.
- [61] F. Crotonino, S. Donadei, U. Bünger, and H. Landinger, "Large-Scale Hydrogen Underground Storage for Securing Future Energy Supplies," *18th World Hydrog. Energy Conf. 2010 - WHEC 2010 Parallel Sess. B. 4 Storage Syst. / Policy Perspect. Initiat. Co-operations*, vol. 78, p. 10, 2010.
- [62] "Hydrogen The role of hydrogen storage in a clean responsive power system."
- [63] H. B. J. Stone, I. V. O. Veldhuis, and R. N. Richardson, "Underground hydrogen storage in the UK Underground hydrogen storage in the UK," 2013.

### 160 PUMPED HYDRO STORAGE

This chapter has been moved from the previous Technology Data Catalogue for Electricity and district heating production from May 2012. Therefore, the text and data sheets do not follow the same guidelines as the remainder of the catalogue.

#### Brief technology description

For bulk electricity storage in utility grids, pumped hydro power plants dominate, with approximately 100 GW in service around the globe [2].

A typical pumped hydro store (PHS) consists of two water reservoirs (lakes), tunnels that convey water from one reservoir to another, a reversible pump-turbine, a motor-generator, transformers, and transmission connection. The amount of stored electricity is proportional to the product of the volume of water and the height between the reservoirs. As an example, storing 1,000 MWh requires an elevation change of 300 m and a water volume of about 1.4 million m<sup>3</sup>.

A new PHS, including dams, has high capital expenditures and a long construction time. If an existing hydro plant is extended to also be a PHS, the investment per installed MW is significantly lower and the construction time between 2 and 3 years.

With this technology electricity is basically stored as potential energy. Others ways of storing electricity as potential energy may have similar characteristics.

#### Input

Electricity

#### Output

Electricity

#### Typical capacities

PHS facilities are dependent on local geography and currently have capacities up to 1,000 MW. In addition to large variations in capacities PHS is also very diverse regarding characteristics such as the discharge time, which is ranging from several hours to a few days. Efficiency typically is in the range of 70 % to 80 %, due to the losses in the process of pumping water up into the reservoirs.

#### Regulation ability

The primary intent of PHS is to provide peaking energy each day. However, their duty can be expanded to include ancillary service functions, such as frequency regulation in the generation mode. A variable-speed system design allows providing ancillary service capability in the pumping mode as well, which increases overall plant efficiency [2].

#### Advantages/disadvantages

The advantage of PHS is the large volumes compared to other storages e.g. various batteries. In addition PHS does not use fossil fuel such as e.g. CAES.

A disadvantage with PHS is the need for differences in height between the two reservoirs. When a new PHS is not built in connection with an existing hydropower plant there are also environmental concerns in flooding large areas.

### Research and development

In the 1890's PHS was first used in Italy and Switzerland. After over 100 years of development PHS is considered to be a mature technology. New developments include seawater pumped hydro storage that was built in Japan in 1999 (Yanbaru, 30 MW). It is also technically possible to have a pumped underground storage by using flooded mine shafts or other cavities.

A new (2009) Danish concept is storing electricity as potential energy by elevating sand. The sand is lifted by pumping water into a balloon underneath the sand, and then lowered by taking the water out through the pump, now acting as a turbine.

### Additional remarks

There are frequently several hydro power plants on the same river, and the operation of these plants is to some degree interlinked. The benefits of a new PHS therefore depend also on the existing hydropower infrastructure.

For new large hydropower plants in OECD countries, capital costs are about 2400 USD/kW and generating costs around 0.03-0.04 USD/kWh. The cost of pumped storage systems depends on their configuration and use. They may be up to twice as expensive as an equivalent unpumped hydropower system. Depending on cycling rates, their generating costs may be similar to those of unpumped systems [1].

### References

- [1] "Energy technology perspectives 2008", International Energy Agency, 2008.
- [2] "Capturing Power Grid", IEEE Power & Energy Magazine, July/August 2009, <http://www.electricitystorage.org/images/uploads/docs/captureGrid.pdf>

## Data sheet

Technology	Pumped hydro storage					
	2015	2020	2030	2050	Note	Ref
<b>Energy/technical data</b>						
Generating capacity for one unit (MW)	10-1000	10-1000	10-1000	10-1000	A	2
Total efficiency (%) net	70 - 80	70 - 80	70 - 80	70 - 80	A	1
Technical lifetime (years)	50	50	50	50	A	1
Construction time (years)	2-3	2-3	2-3	2-3	A	
<b>Financial data</b>						
Investment, pump part (M€/MW)	0.6	0.6	0.6	0.6	B;C;A	1&2
Investment, total, greenfield plant (M€/MW)	< 4	< 4	< 4	< 4	D;A	4
Fixed O&M (€/MW/year) - 1-2% of investment	6-12,000	6-12,000	6-12,000	6-12,000	B;A	3
Variable O&M (€/MWh)	Depends on power price					

**References:**

- 1 BKK, presentation on Nygard Pumpekraftverk
- 2 Tonstad Pumpekraftverk, Sira-Kvina kraftselskap, 2002
- 3 BKK and Sira-Kvina
- 4 "Energy technology perspectives 2008", International Energy Agency, 2008.

**Notes:**

- A No significant technology advance or cost decrease is expected, since hydropower and water pumping are established technologies.
- B Based on the September 2004 exchange rate of 1NOK = 0,12€
- C Cost data are the same as in the 2005 catalogue, however inflated from price level 2002 to 2011 by multiplying with a general inflation factor 1.2306
- D Cf. paragraph 'Additional remarks' above.

### 161 COMPRESSED AIR ENERGY STORAGE

#### Contact information

Danish Energy Agency: Thomas Mandal Østergaard

Energinet.dk: Rune Duban Grandal

Author: Allan Schrøder Pedersen, DTU, Department of Energy Conversion and Storage

#### Publication date

November 2018

#### Amendments after publication date

Date	Ref.	Description
December 2018		Formatting and internal references fixed

### Brief Technology Description

#### Compression/expansion

Compressed Air Energy Storage (CAES) is a way of storing electrical energy mechanically and thus the input is electricity to drive a compression. In the most basic form of CAES electrical energy is used to compress air, which can subsequently be stored in pressure tanks or in huge amounts in underground formations, where such suitable formations are available. When release of the stored energy is required, the compressed air is used to drive a turbine able to generate electricity. The expansion of air is associated with a temperature drop.

When air is compressed, heat is released and constitutes a loss of energy during the storage operation because it dissipates to the external environment. However, if the heat may be stored intermediately (e.g. sensibly in ceramic material), the heat may be reinjected during the expansion process and thus it is not lost. This has an impact on the overall efficiency (electricity to electricity). This form of CAES is usually called Adiabatic CAES, A-CAES (or sometimes Advanced Adiabatic CAES, AA-CAES) because of the lack of exchange of heat between the storage system and the external environment. Additional forms of CAES have been proposed, such as isothermal CAES. For these additional forms of CAES there are currently no commercial installations and we will only consider CAES and AA-CAES here.

Presently CAES technology is used in combination with gas turbine combustion, which can be said to compensate for the temperature drop. Therefore CO<sub>2</sub> is released in traditional CAES.

Although the concept of CAES has been considered favorable for energy storage for many years for storing variable, renewable energy only two plants have been realized until now, the first in Huntorf, Germany, in 1978 and the second in McIntosh, Alabama, USA, in 1991. Interestingly, the Huntorf storage facility was constructed to balance nuclear power so that the nuclear generation could be run in an optimal way and the CAES facility could handle the differences between production and demand for electricity. None of the realized facilities are based on A-CAES, but only on CAES, meaning that the round trip efficiencies are

relatively low. Both plants have been operated with use of natural gas turbines to compensate for the lost heat (cf above).

Several excellent and more exhaustive technical descriptions of Compressed Air Energy Storage (CAES) and Adiabatic Compressed Air Energy Storage (A-CAES) are available in literature. Figure illustrates a plant diagram of two different CAES plants – see also further references in the “References” section.

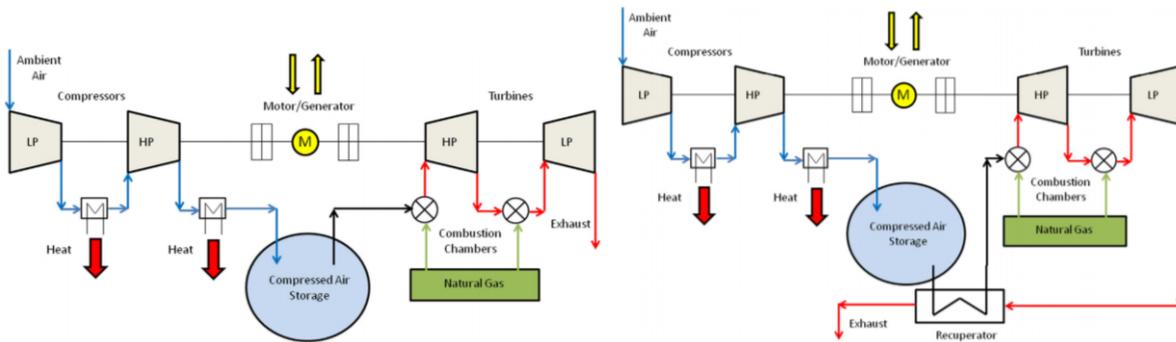


Figure 1: Operating principle of the CAES plant Huntorf (left) and the McIntosh (right) [1]

Table gives key data for the same two plants. The Huntorf plant uses 0.8 kWh of electricity and 1.6 kWh of gas to produce 1 kWh of electricity and was the world’s first CAES plant when it was commissioned in 1978 [2]. The newer McIntosh plant includes a recuperator which recycles waste heat from the exhaust stream and uses 0.69 kWh of electricity and 1.17 kWh of gas to produce 1kWh of electricity [2].

Type	Simple CAES process, two-stage NG combustors	2 <sup>nd</sup> generation CAES, recuperator, two-stage NG combustors
Location	Huntorf, Niedersachsen	McIntosh, Alabama
Commissioning	1978	1991
Turbine power	320 MW <sub>el</sub>	110 MW <sub>el</sub>
Generation capacity	~1 GWh	2.6 GWh
Thermal round trip efficiency	~42 %	~52 %
Specific cost	320 DM/kW <sub>el</sub>	\$591/kW <sub>el</sub>
Turbine start-up time	>9 min.	14 min.

Table 1: Data for the Huntorf and the McIntosh traditional CAES plants [3].

For A-CAES (a technology, which has not yet been realized) storage of heat has been proposed in ceramic materials like rocks or bricks at elevated temperatures (say 600 °C).

It is questionable how many traditional CAES plants will actually be built in the future. Many optimistic studies have been performed - particularly in the US - during the past 25 years, however it remains a fact that none have been built. In Denmark the preparation of new salt caverns is associated with environmental problems, as heavy metals are dissolved together with the salt as the cavern is solution-mined.

**Air storage volumes**

CAES depends completely on a connection to suitable storage volumes. Small units may utilize high pressure gas cylinders (surface level), but to allow for large amounts of energy (hundreds of MWh) CAES is usually planned and established in connection with large underground formations able to hold significant amounts of compressed air. Such formations could be depleted oil or gas fields, aquifers, salt caverns, lined rock caverns and abandoned mines [4]. An illustration of some of the storage principles is shown in Figure 2.

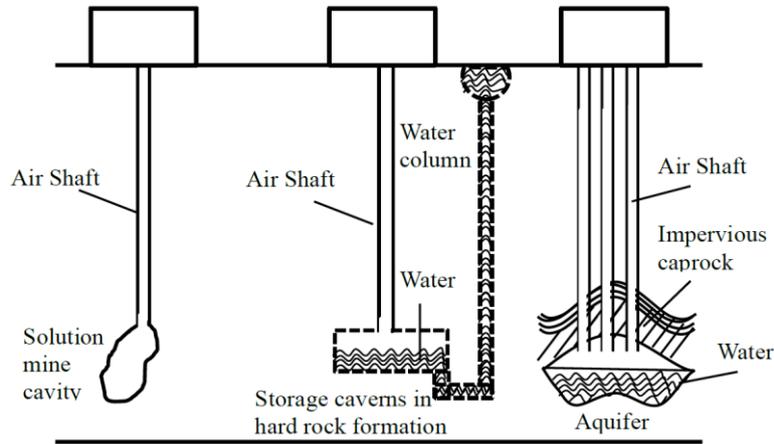


Figure 2: Various Geological Formations for Underground Storage [5]

The two existing CAES plants are connected to solution-mined caverns in salt domes. Such caverns are relatively cheaply and easily developed and suitable salt deposits are found in many places all over the world. However, the preparation of caverns may be restricted due to potential environmental issues and political opposition. Figure 3 shows the coincidence of large wind power potentials and salt deposits suitable for cavern excavation.

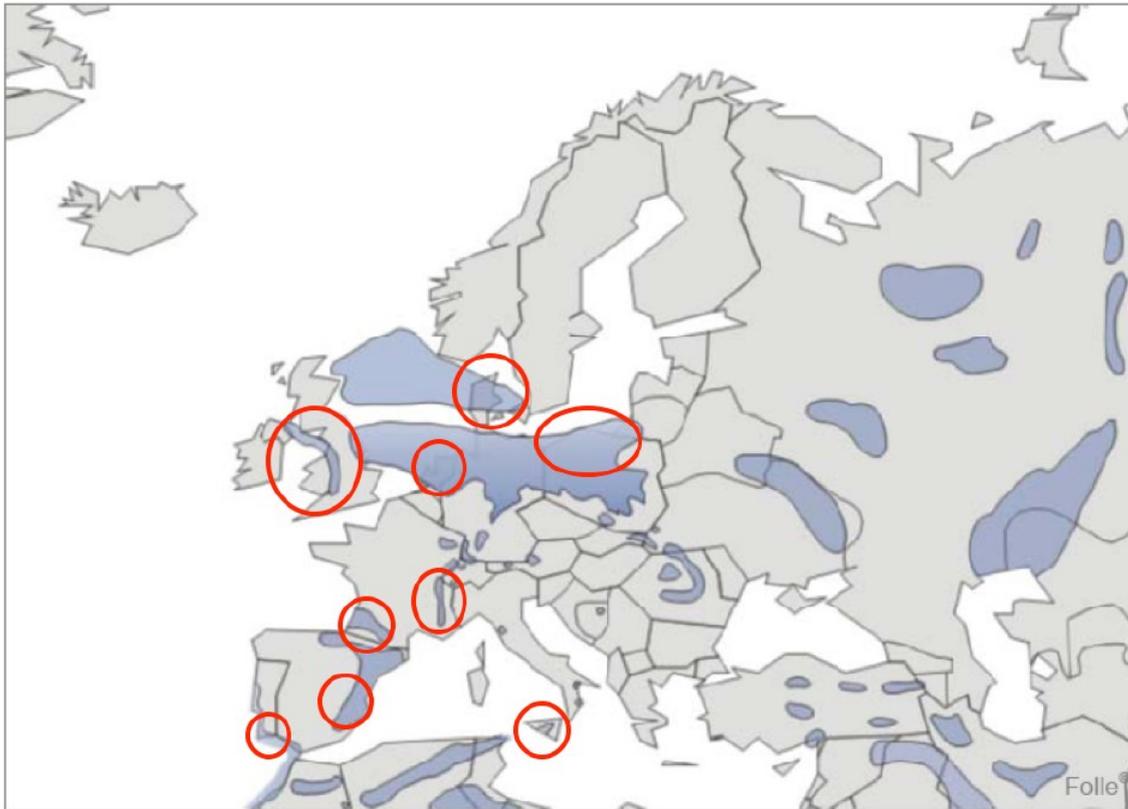


Figure 3: Coincidence of high wind potential (red circles) and salt domes in Europe (blue areas) [6]

### Input/output

The input for CAES is electricity. For traditional CAES input of some fuel (usually natural gas) is required in the electricity output phase. For Adiabatic Compressed Air Energy Storage fuel is not required (see below).

The output for CAES is electricity. Traditional CAES also generates heat in the compression phase, whereas ACAES stores this heat and thus does not generate heat to the external environment.

### Energy efficiency and losses

Figure 4 illustrates details of the energy lost by using CAES in the compression stage and in the expansion stage. The numbers which can be derived are a charging efficiency of about 80 % and a discharge efficiency of about 70 % leading to a round cycle efficiency of approx. 55 % (electricity to electricity). However, input of chemical fuel in this calculation complicates the calculation since the electricity that could have been produced from the fuel should be subtracted. Setting the electrical efficiency of chemical fuel to 35 % (see note A in

Quantitative description) the output efficiency in Figure 4 would be 44 % leading to a round cycle efficiency of 44 %.

*Energy transfer of CAES plants:*

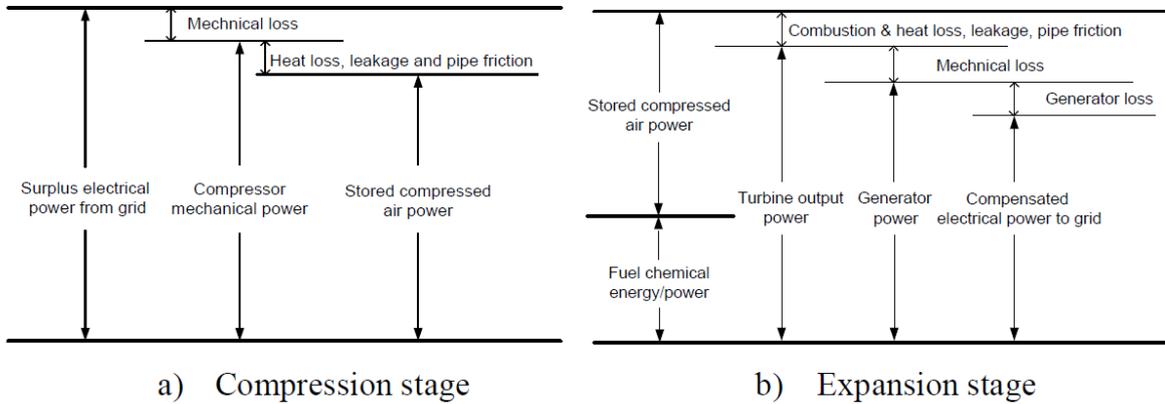


Figure 4: Energy transfer of a conventional CAES plant [7]. The source does not quote numbers but only graphics.

**Regulation ability and other system services**

Startup times of about 10 minutes are described in the literature for CAES [8]. This allows several ancillary services and thus both black starts, secondary reserves and reactive power system services are possible. Furthermore the technology is perfectly suited for load shifting (the original purpose of the Huntorf plant) within the limits of available storage and power capacity.

**Typical characteristics and capacities**

As mentioned above only two CAES plants have been realized until now and consequently it does not really make sense to state typical performance characteristics and capacities. The characteristics of the two existing plants can be seen in Table 2.

	Huntorf (1978) Germany	McIntosh (1991) USA
		
Turbine Power / Discharge time	Old 290 MW / 2 hrs New 320 MW / ~3 hrs	110 MW / 24 hrs
Compression Power / Charging time	60 MW / 8 hrs	50 MW / 38 hrs
Power ratio	0.19	0.45
Charge / Discharge time Ratio	2.7	1.6
Cavern Pressure	46 – 72 bara	45 – 74 bara
Efficiency	42%	54%
Heat Rate	6700 BTU/kWh (without heat Recuperator)	4100 BTU/kWh (with heat recuperator)
Availability	➤ 90 %	➤ 90 %
Reliability	➤ 97 %	➤ 97 %
Start-up reliability	➤ 95 %	➤ 95 %
Cavern	2 x 150'000 m <sup>3</sup> (Salt Cavern)	538'000 m <sup>3</sup> (Salt Cavern)

**Table 2: Supplementary descriptive data for the Huntorf and McIntosh facilities. The indicated heat rates (thermal energy in over electrical energy out) can be recalculated to 1.96 kWh/kWh for Huntorf and 1.20 kWh/kWh for McIntosh [9].**

As can be seen the CAES plants have been built for up to 50-60 MW charging power and 100-300 MW discharging power.

Based on the numbers shown in the above table the energy storage capacities of the plants are 480 MWh for Huntorf and 1,900 MWh for McIntosh.

The energy density of compressed air naturally depends on the pressure difference between upper and lower limit of the pressure variation. For the Huntorf facility the energy density is approximately 0.3 kWh/m<sup>3</sup>. For the McIntosh the number is about the same since the same pressure range is used. However, the energy densities (kWh/m<sup>3</sup> and kWh/kg) associated with CAES is not considered relevant, one reason being that the technology is stationary.

It is interesting to note that both plants are utilizing salt domes as storage facility for the compressed air. Other proposed storage facilities are abandoned mines and aquifers, but these types have not yet been realized.

Figure 2 in the Electricity Storage chapter shows a comparison between CAES and several other energy storage technologies concerning discharge time and power rating. Clearly CAES is a bulk storage technology in class with pumped hydro and power to gas (not shown).

### Typical storage period

The practical span of storage periods for CAES can be estimated from Figure 5 showing the number of starts per year for the Huntorf plant in the period from 1978 to 2000. In course numbers the numbers of starts vary

in the range 50-200 with outliers up to 400 and down to about 25. This shows that practical storage periods range between hours and days. However, these storage periods reflect the facility’s actual use pattern rather than the capability. Since air is stored in underground caverns in salt domes, which are very tight (cf. use of salt caverns for natural gas) the air can be stored for much longer time if so desired. The levelized cost of energy storage will increase if longer time periods are applied, but it can easily be done.

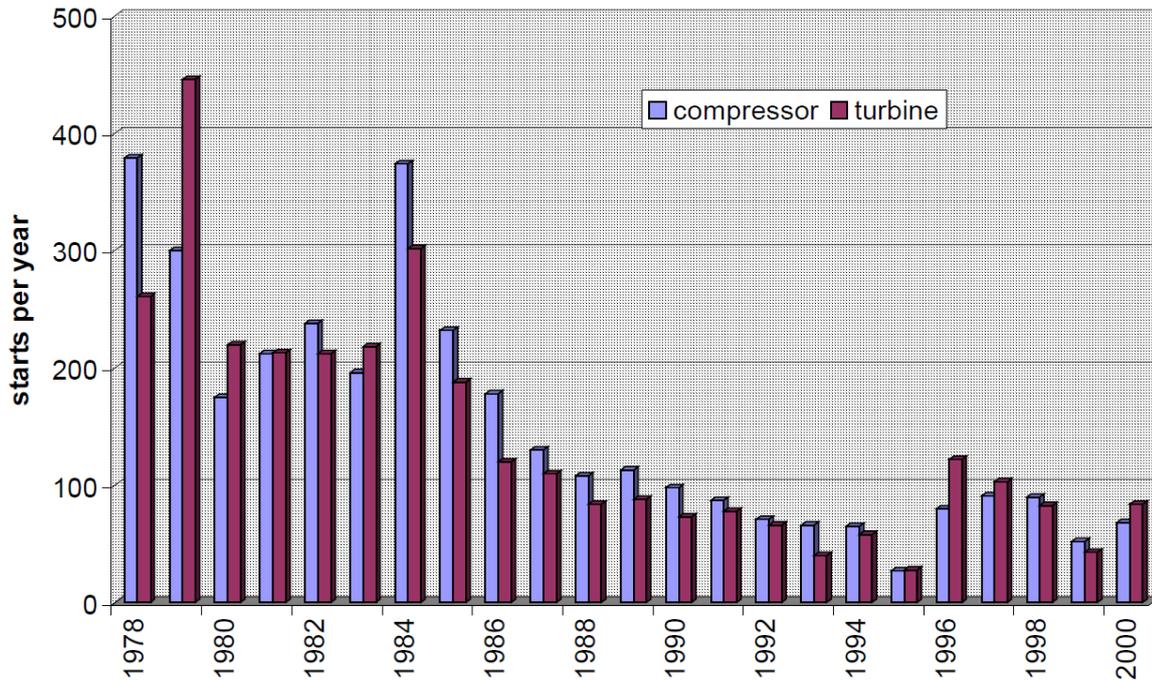


Figure 5: Number of compressor starts (charges) and turbine starts (discharges) for the Huntorf facility for the period between 1978 and 2000 [10]

### Space requirement

The space requirement for a CAES facility can be seen from the following photo [11], which shows the Huntorf CAES plant from above. Thus an area of approx. 200x200 m (40,000 m<sup>2</sup>) is required for 320 MW<sub>el</sub> output. However, according to reference [8] 1 acre, which corresponds to approximately 4000 m<sup>2</sup> (63x63 m), is required for a 100 MW output plant.

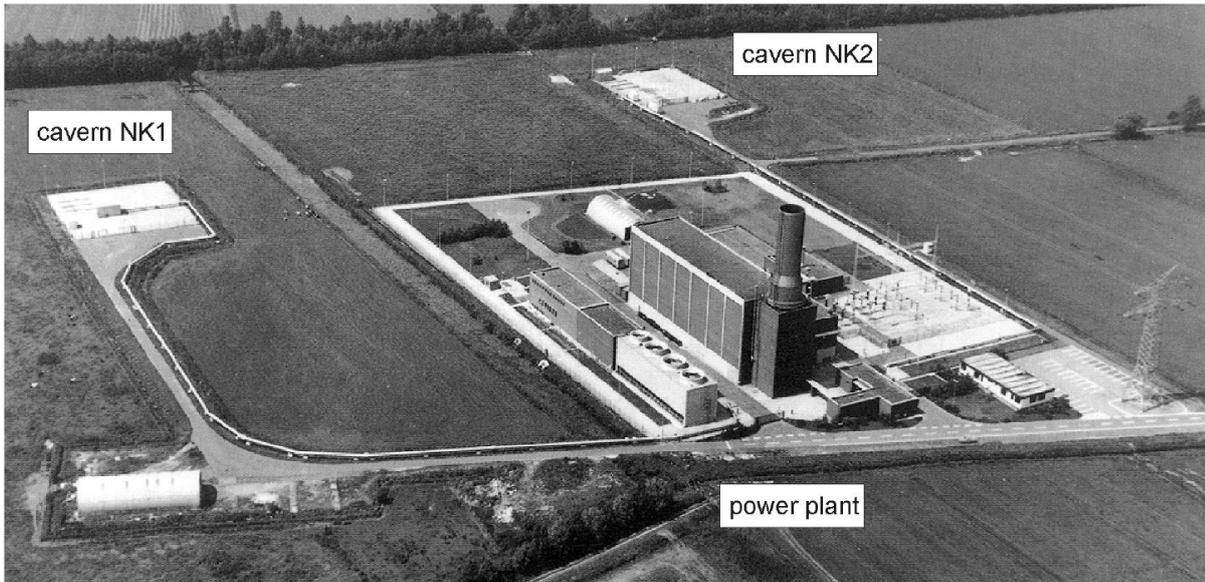


Figure 6: Aerial photo of the Huntorf facility [12] .

The placing of a CAES plant depends completely on accessibility to store large amounts of compressed air. Since the energy storage capacity depends on the volume of underground formations it is not possible to give a number in  $\text{m}^2/\text{MWh}$ . As mentioned the existing two plants utilize underground caverns in salt domes. Other structures may be used but the entrepreneur is not free to establish a CAES plant wherever needed and thus the 200 by 200  $\text{m}^2$  surface area (for 320 MW) mentioned above does not set the complete requirements.

### Advantages/disadvantages

#### Advantages

The following advantages are cited from [8] :

- The CAES plant can provide significant energy storage (in the thousands of MWhs) at relatively low costs (approximately (in 2003 USD)  $\$400/\text{kW}_{\text{ac}}$  to  $\$500/\text{kW}_{\text{ac}}$ ). The plant has practically unlimited flexibility for providing significant load management at the utility or regional levels.
- Expanders have a large size range. Commercial turboexpander units range in size from 10 -20  $\text{MW}_{\text{ac}}$  (Rolls Royce-Allison) to 135  $\text{MW}_{\text{ac}}$  (Dresser-Rand) to 300-400  $\text{MW}_{\text{ac}}$  (Alstom).
- The CAES technology can be easily optimized for specific site conditions and economics.
- CAES plants are capable of black start. Both the Huntorf and McIntosh plants have black start capability that is occasionally required.
- CAES plants have fast startup time. If a CAES plant is operated as a hot spinning reserve, it can reach the maximum capacity within a few minutes. The emergency startup times from cold conditions at the Huntorf and McIntosh plants are about 5 minutes. Their normal startup times are about 10 to 12 minutes.
- CAES plants have a ramp rate of about 30 % of maximum load per minute.

- A CAES plant can (and does) operate as a synchronous condenser when both clutches are opened (disconnecting the motor-generator from both the compressor train and the expander train), and the motor-generator is synchronized to the grid. Reactive power can be injected and withdrawn from the grid by modulating the exciter voltages. Both the Huntorf and the McIntosh plant are used in this manner. Since this operation does not require the use of stored air, the plant operator can choose to operate the plant in this mode for as long as necessary.
- Danish installations could benefit from the widespread and developed district heating infrastructure. CAES installations can sell the heat generated in the gas compression phase and purchase the heat in the decompression phase, thus reducing the need for natural gas.

### Disadvantages

- For traditional CAES the use of natural gas implies CO<sub>2</sub> emissions. However, for A-CAES there is no use of chemicals and no exhausts.
- Geographical placement is limited to places, where high pressure air can be stored in sufficient amount. Several geological underground formations are suitable, but the restriction puts limitations to where CAES can be placed.
- In the basic form (without intermediate heat storage) CAES shows a relatively low electricity to electricity efficiency around 45 % without recuperation.

### Environment

The main environmental impacts from operating a CAES plant - except from surface footprint – relate to the use of fossil energy in the expansion phase [13]. This problem could be overcome by the development of A-CAES (Adiabatic CAES), where heat is stored from the compression phase and redelivered in the expansion phase.

However, in the construction phase it has been found that the environmental impacts correlate strongly with the size and method of construction of the underground storage cavity [14]. Particularly for solution mined salt caverns the dissolved salt may (depending on location) contain concentrations of heavy metals, which may not readily be disposed in rivers or lakes or even in the sea.

### Research and Development Perspectives

Research and development efforts for CAES are directed towards improving the relatively low round cycle efficiency by intermediately storing the heat generated in the compression phase and reuse it during the expansion phase (ACAES) [15]. Figure 7 shows how the German utility company RWE envisages how a heat storage facility can be incorporated in a CAES plant. Heat may be stored at temperatures up to 600 °C or even higher in rock (stone) or other ceramic materials and the technology is being developed for a variety of purposes these years. Within a time perspective of 10-15 years it thus seems fair to anticipate that A-CAES will be commercially available. This development is expected to improve the power-to-power efficiency to around 70 % and bring A-CAES into a much more attractive efficiency class



Figure 7: RWE's vision for an ACAES plant [15].

### Examples of market standard technologies

There is not a living market for CAES plants. As mentioned, only two plants have been built worldwide until now – in 1978 and 1991. It does not seem fair to take any of these as standard technologies. If the demand for CAES will increase at some point in the future it must be expected that CAES market standards will be developed based on up-to-date technologies for compressors, turbines and thermal energy storage (A-CAES).

### Prediction of performance and costs

#### Efficiency until 2016

Recorded performance – in terms of electricity to electricity efficiency – for the Huntorf and McIntosh plants are 42 % and 54 % respectively [16]. The main reason for the difference is that the McIntosh plant utilizes recuperation of waste heat from the expansion turbine. Conventional CAES uses additional fuel in the discharge phase and thus has a not ignorable CO<sub>2</sub> emission.

In the Datasheet it is assumed, that a CAES plant built today will have the same efficiency as the McIntosh plant or maybe higher.

### Efficiency 2020 - 2050

It must be expected that future CAES plants 10-15 years from now will be based on adiabatic CAES, which has a much better efficiency, estimated to be around 70 %. We are therefore likely to see a stepwise increase in efficiency of CAES at some point in the future, when appropriate thermal energy storage technology has been developed. Considering present activities within high-temperature energy storage technologies this point is estimated to be about 2030.

### Cost

A-CAES comes at an increased cost, because of the addition of the thermal energy storage. For an indication of the price difference see Table 4.

It is questionable how many traditional CAES plants will actually be built in the future. Many optimistic studies have been performed - particularly in the US - during the past 25 years, however it remains a fact that none have been built. Since 2013 the Irish utility company Gaelectric has been working to establish a traditional CAES plant in Larne, Northern Ireland [17]. The company reports that plans are underway to establish CAES plants in the United Kingdom and in the Netherlands. Gaelectric states the total investment cost to be £300 million in the Larne CAES project, according to independent analysis by PMCA Economic Consulting [18]. The facility will generate up to 330 MW of power for periods of up to 6 hours. It will create demand of up to 200 MW during the compression cycle [18].

Documented prices for CAES plants are few and old. The individual technologies involved in a CAES plant (i.e. compressors, solution mining and turbines) existed before they were put together in a CAES plant. On the other hand the same technologies (or close to the same) have been further developed concerning performance and costs and the same (matured) development must be expected to continue for many years ahead showing a price decreases of 0.5-1%/year characteristic for such technologies. It should be noted here, though, that one source [19] quotes a report, which the author of this section has not been able to retrieve, in the following way:

A 2005 report on the economic impact of CAES suggests the following reasons:

1. Since regulated utilities grew through an increase in invested capital, there was no economic incentive to add CAES, which increases the efficiency of existing plants and decreases the total capital required to serve a given load;
2. Independent power producers in the US did not develop CAES because CAES did not qualify for Public Utility Regulatory Policies Act (PURPA) contracts, which were available only for renewable power plants or for cogeneration facilities.
3. There was a boom in power plant construction in the late 1990's, but a lack of available equipment prevented the development of new CAES plants. Until very recently, major turbine manufacturers had sold out production capacity and had not been willing to invest in the development of CAES turbines.

As mentioned above several researchers have estimated prices for CAES plants over recent years. It is likely that not all sources quoting such prices have actually developed prices themselves independently. Quite some redundancy is seen in estimated prices and looking into the literature you find that many authors actually rely on Electric Power Research Institute [8], [20].

## 161 Compressed Air Energy Storage

Table 3 gives 2015 inflation-corrected prices for CAES plants in terms of EUR/kW and EUR/kWh [21]. The cost per kW varies from 300 EUR/kW to 1250 EUR/kW and costs per kWh prices vary between 0.09 EUR/ kWh and 120 EUR/ kWh.

For use in the data sheet the costs per kWh between 0 and 2 EUR/kWh have been disregarded because it is assumed, that only storage costs are included here (that is costs for mining the storage cavities).

Year of publication	Investments cost per discharge capacity		Investments cost per energy storage capacity		Reference no.
	\$/kW*	€/kW (2015 prices)	\$/kWh*	€/kWh (2015 prices)	
2003	450	460	1.0	1.0	12
2007	850	680			23
2007	890	710			24
2008	650	530	1.75	1.40	6
2009	750	580			25
2009	540	420	130	100	26
2010low	430	340	2	1.6	27
2010high	480	380			27
2011	1000	820	150	120	20
2011	900	740			22
2012low	400	320	2	1.6	8
2012high	1150	910	120	100	8
2012	400	320			28
2012			0.12	0.09	29
2013low	400	300	120	90	9
2013high	1000	740			9
2014low	500	420			16
2014high	1500	1250			16
2014	1400	1170			2
2015low**	300	410	0.6	0.8	30
2015high**	500	690	18	25	30
2016	1300	1220			31
2017***	750	660			18

Table 3: Prices for CAES plants from literature. Year, references and prices in source currency are given. The cost is converted into 2015 prices. \*in reference year prices, \*\*reference in £, \*\*\*reference in €.

Table 4 below gives yet another cost breakdown for CAES and A-CAES plants illustrating the cost differences between the two types. The total cost for A-CAES is seen to be 43 % higher than for conventional CAES. Comparing the table with Figure 3 above also gives an impression of the divergence (or uncertainty) of the prices (compare e.g. salt cavern cost fraction).

	Conventional CAES <sup>2</sup>		Adiabatic CAES <sup>3</sup>	
	Cost (\$2009/kW)	Cost Fraction (%)	Cost (\$2009/kW)	Cost Fraction (%)
Compressor	84	11	129	13
Heat Exchanger	33	4	150	15
High pressure expander	60	8	114	11
Low pressure expander	140	19	100	10
Electrical and Controls	44	6	60	6
Cavern Development	75	10	86	8
Construction materials and labor	215	29	255	25
Indirect Costs	98	13	137	13
<b>Total</b>	<b>749</b>	<b>-</b>	<b>1031</b>	<b>-</b>

Table 4: Cost breakdown for a conventional and adiabatic CAES system deployed with a salt cavern [22]. These costs represent a conventional system with 10 hours of storage and an oversized expander (110 MW) relative to the compressor (81 MW). Capital costs are expressed in terms of expander capacity. These costs represent an adiabatic CAES system with 10 hours of storage and oversized compressor (96 MW) relative to the expander (72 MW). Capital costs are expressed in terms of expander capacity.

Table 5 shows the costs for the energy storage components in \$/kWh. The share of the cost that can be related to the energy storage differs significantly depending on the storage media, from 0.3 % for *porous media* to 46 % for *hard rock (new cavern)*. The solution-mined salt caverns (which are relevant for Danish conditions) can be seen to be cheap in particular in comparison with hard rock solutions, the cost related to the salt mine energy storage makes up 3 % of the total.

Storage medium for CAES plant	Size (MWe)	Cost for power related plant components (\$/kW)	Cost for the energy storage components (\$/kWh)	Typical hours of storage for a plant	Total capital costs (\$/kWe)
Salt	200	350	1	10	360
Porous media	200	350	0.10	10	351
Hard rock (new cavern)	200	350	30	10	650
Surface piping	50	350	30	3	440

Table 5: CAES plant costs for various storage media [23], 2002

## 161 Compressed Air Energy Storage

---

Figure 8 gives another cost breakdown for a CAES plant and shows the fraction of costs associated with developing the salt cavern. This fraction is about 40 %. It can be seen that the turbine is another costly component of the system and comprises about 30 % of costs. Comparison with the numbers in Table 4 also gives an indication of the uncertainty of prices stated in different reports and articles.

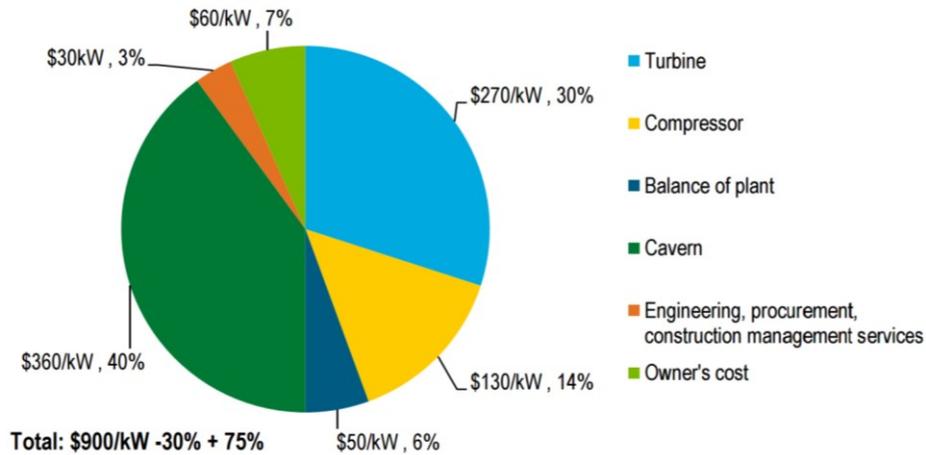


Figure 8: The capital cost breakdown for a CAES plant, approximately 262 MW net with 15 hours of storage and with storage in a solution-mined salt dome is assumed [24], 2012

Table 6 gives a detailed cost breakdown for CAES showing cost classes that are not often shown. The size of the designed plant was 150 MW charging and 83 MW discharging.

## 161 Compressed Air Energy Storage

<b>Project Title:</b> PROJECT:		Hybrid CAES Yakima Min.		<b>Scenario Name:</b> Low Flow	
<b>Project Name:</b>		North America		<b>Prep. By:</b> --	
<b>Proj. Location:</b>		08JAN13		<b>Currency:</b> DOLLARS	
<b>Estimate Date:</b> 18:35:30		<b>Est. Class:</b>		USD	
<b>Account</b>	<b>MH</b>	<b>Labor Cost</b>	<b>Matl Cost</b>	<b>Total Cost</b>	<b>Percentages</b>
(2) Equipment	31,040	1,552,000	77,141,100	78,693,100	70% of TDC
(3) Piping	74,451	3,722,550	14,477,200	18,199,750	16% of TDC
(4) Civil	70,889	3,544,450	3,163,500	6,707,950	6.0% of TDC
(6) Instruments	7,085	354,250	1,151,400	1,505,650	1.0% of TDC
(7) Electrical	14,270	713,500	4,380,400	5,093,900	5.0% of TDC
(8) Insulation	21,762	1,088,100	796,100	1,884,200	2.0% of TDC
(9) Paint	8,158	407,900	89,700	497,600	<1.0% of TDC
					of TDC
<b>Total Direct Field Costs</b>	227,655	11,382,750	101,199,400	112,809,805	100.0% of TDC
	(TDMH)	(TDL)	(TDM)	(TDC)	
<b>Indirect Field Costs</b>				9,154,156	
				(IFC)	
<b>Total Field Costs</b>	227,655			121,963,961	69% of TIC
	(TFMH)			(TFC)	
Freight				4,047,976	4.0% of TDM
Taxes and Permits				6,324,963	5.6% of TDC
Engineering and HO	38,881			6,590,300	3.7% of TIC
Other Project Costs				10,373,000	5.8% of TIC
Contingency				26,874,100	15.3% of TIC
<b>Total Non-Field Costs</b>	38,881			54,210,339	30.7% of TIC
<b>Project Total Costs</b>				<b>176,174,300</b>	156.0% of TDC

Table 6: Overnight capital costs of hybrid CAES facility [25]

### Prediction of performance

The perspectives for significantly improving performance of conventional CAES are not very positive. The technology relies on quite well known technology (i.e. compressors, expanders/turbines and cavern), which can indeed be purchased in a mature state already today.

Table 7 below shows results prepared by Black & Veatch for the National Renewable Energy Laboratory in the USA for a conventional CAES plant [24]. The lack of improved cost (inflation and deflation cleaned prices) and performance characteristics in this study is obvious for the period towards 2050. Data is simply the same in all columns over the period.

An informal communication with Energinet.dk (natural gas storage section) did not suggest any foreseen change in prices for solution mining salt caverns. In addition, solution mining is done quite rarely and thus not much data is available. Costs for solution mining depend strongly on local geographic and underground conditions.

Based on the fact that conventional CAES relies very much on well-known, well-proven and long existing technology components it is not anticipated that the costs for CAES plants will change significant towards 2050.

## 161 Compressed Air Energy Storage

Year	Heat Rate (Btu/kWh)	Capital Cost (\$/kW)	Variable O&M (\$/MWh)	Fixed O&M (\$/kW-year)	Round-Trip Efficiency	FOR (%)	POR (%)	Construction Schedule (Months)	Min. Load (%)	Spin Ramp Rate (%/min.)	Quick Start Ramp Rate (%/min.)
2008	4910	927	–	–	–	–	–	–	–	–	–
2010	–	–	–	–	–	–	–	–	–	–	–
2015	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2020	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2025	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2030	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2035	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2040	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2045	4910	900	1.55	11.6	1.25	3	4	18	50	10	4
2050	4910	900	1.55	11.6	1.25	3	4	18	50	10	4

**Table 7: Cost and performance projection for a 262 MW CAES plant [24]. The source does not explain how efficiency over 1 should be interpreted.**

The energy storage cost target set by the European Commission for Thermal Energy Storage in 2030 is 28 €/kWh or 0.028 M€/MWh [26]. This will naturally add to the CAES price in 2030, when A-CAES is expected to gain market share. However, in 2050 this cost add-on is expected to be reduced by 50 % because of a steep learning curve and the effect of mass production by that time.

## Quantitative description

Technology	Compressed Air Energy Storage									
	2015	2020	2030	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref
Energy/technical data					Lower	Upper	Lower	Upper		
Form of energy stored	Electricity to mechanical and heat									
Application	System, energy-intensive									
Energy storage capacity for one unit (MWh)	3000	3000	3000	3000	-	-	3000	10000	I	[3]
Output capacity for one unit (MW)	300	300	300	300	-	-	300	500	I, J	[3]
Input capacity for one unit (MW)	60	60	60	60	-	-	60	80	I, J	[9]
Round trip efficiency (%)	55	60	70	72	55	55	64	72	A, B	(Nakhmkin & Prost)
- Charge efficiency (%)	80	80	84	85	80	80	80	85		[7]
- Discharge efficiency (%)	69	80	84	85	69	69	80	85		[7]
Energy losses during storage (%/period)	Close to 0	0	0	0	0	0	0	0		[27]
Auxiliary electricity consumption (% of output)	-	-	-	-						
Forced outage (%)	5	5	4	4	-	-	2	4	I, K	[9]
Planned outage (weeks per year)	5	5	4	3	-	-	2	3	I, K	[9]
Technical lifetime (years)	40	40	40	40	35	45	35	45		[20] [8]
Construction time (years)	<3	<3	<3	<3	2	3	2	3		[8]
Regulation ability										
Idle to full discharge (sec)	700	700	1000	1000	500	1000	800	1200	D, G	[3], [8]
Full charge to full discharge (sec)	-	-	-	-					F	
Financial data										
Specific investment (M€2015 per MWh)	0.65	0.65	1.0	0.8	0.3	1.2	0.4	2.0	C, E	Table 3 [26]
-Energy component (M€/MWh)	0.002	0.002	0.002	0.002	0.002	0.01	0.002	0.01	H	[23]
-Capacity component (M€/MW)	0.6	0.6	0.9	0.9	0.3	1.2	0.3	1.2		[24]
-Other project costs (M€/MWh)	0.085	0.085	0.085	0.085	0.08	0.09	0.08	0.09		[24]
Fixed O&M (€2016/MW/year)	2460	2460	2460	2460	2000	4000	2000	4000		[20]
Variable O&M (€2016/MWh)	2.46	2.46	2.46	2.46	2	3	2	3		[20]
Technology specific data										
Specific investment ((€2016/kW)	640	640	640	640	-	-	550	640	C, K	Table 3

### Notes

- A. For efficiency it is assumed that that new CAES plants can be constructed with at least the same efficiency as the McIntosh plant.
- B. The use of gas in a CAES plant is assumed at the same efficiency as the average use of chemical fuels in the Danish electricity system, i.e. 35% in 2014
- C. In general it is assumed that at some point between 2020 and 2030 adiabatic CAES plants will dominate the market. This means that investment costs will increase and performance characteristics will improve.
- D. The obtainable ramping rate is likely to decrease after application of thermal energy storage. This is because the heat must be delivered to the storage material, which is a process that cannot be controlled independently.
- E. For the costs per kWh in Table 3 the data lying between 0 and 2 EUR/kWh have been disregarded because it is assumed, that only storage costs are included
- F. Operation not suitable nor relevant for CAES. Data not available.
- G. If a CAES plant is operated as a hot spinning reserve, it can reach the maximum capacity within a few minutes. The emergency startup times from cold conditions at the Huntorf and McIntosh plants are about 5 minutes. Their normal startup times are about 10 to 12 minutes [8]
- H. Energy component here taken as the cavern excavating
- I. New plants cannot be realized in 2020 because of lead time. Furthermore the upper limit for storage capacity of one unit is determined by cavern volume, which can be obtained practically without.
- J. Upper limit in 2050 is based on the author's assessment of technological development until then.
- K. Lower limit in 2050 is based on the author's assessment of technological development until then.

### References

- [1] S. Karellas and N. Tzouganatos, "Comparison of the performance of compressed-air and hydrogen," vol. 29, 2014.
- [2] E. Barbour, "<http://energystoragesense.com/compressed-air-energy-storage/>," [Online].
- [3] S. Zunft, S. Freund and E. M. Schlichtenmayer, "Large Scale Electricity Storage with Adiabatic CAES," Paris, November 2014.
- [4] "Geological storage in Northern Ireland," Geological Survey of Northern Ireland. [Online].
- [5] P. Johnson, "ASSESSMENT OF COMPRESSED AIR ENERGY STORAGE SYSTEM (CAES)," Thesis Submitted to the University of Tennessee, University of Tennessee at Chattanooga, Chattanooga, Tennessee, USA, 2014.
- [6] R. W. S. Succar, "Compressed Air Energy Storage: Theory, Resources, And Applications For Wind Power," Energy Systems Analysis Group, Princeton Environmental Institute, Princeton University, April 2008.
- [7] J. W. X. Luo, "Overview on current development on Compressed Air Energy Storage, EERA Technical Report – CAES.," School of engineering, University of Warwick. Available on <http://integratedenergystorage.org/>. Accessed February 2017, December 2013.
- [8] I. Gyuk and S. Eckroad, "EPRI-DOE Hanbook of Energy Storage for Transmission and Distribution Applications,1001834, Final Report," EPRI and DOE, December 2003.
- [9] Nakhamkin and Brotel, "Second generation compressed air storage," in Energy Storage Forum Europe, Rome, 2012.
- [10] F. Crotagino, K.-U. Mohmeyer and R. Scharf, "Huntorf CAES / More than 20 years of successful operation," Orlando, April 2001.
- [11] "<https://dddusmma.wordpress.com/2014/05/30/storage-is-essential-for-wind-and-solar/>," Department of Energy, USA. [Online]. [Accessed 2017].
- [12] "<https://dddusmma.wordpress.com/2015/03/17/the-quest-for-storing-electricity/>," 17 March 2015. [Online]. [Accessed 2017].
- [13] A. Wänn, P. Leahy, M. Reidy, S. Doyle, H. Dalton and P. Barr, "Environmental performance of existing energy storage installations. Deliverable D.3.1. Available on [www.store-project.eu](http://www.store-project.eu). Accessed February 2017," stoRE project, 2012.
- [14] E. Bouman, M. M. Øberg and E. G. Hertwich, "LIFE CYCLE ASSESSMENT OF COMPRESSED AIR ENERGY STORAGE (CAES)," Gothenburg, 2013.
- [15] "ADELE – ADIABATIC COMPRESSED-AIR ENERGY STORAGE FOR ELECTRICITY SUPPLY. RWE Brochure.," RWE Power AG, Cologne, 2010.
- [16] "Energy Storage Technology Roadmap, Technology Annex, p. 5," International Energy Agency, March 2014.

- [17] Gaelectric. Accessed February 2017. [Online].
- [18] "Gaelectric energy storage: The missing link. Brochure by Gaelectric. Available on <http://www.gaelectric.ie/energy-storage-publications/>. Accessed February 2017," Gaelectric.
- [19] [Online].
- [20] D.Rastler, A. Akhil and D. Gauntlett, "Energy Storage System Costs 2011 update. Executive summary.," 2011.
- [21] "InflationData.com," InflationData, 2017. [Online]. [Accessed March 2017].
- [22] E. Drury, P. Denholm and R. Sioshansi, "The Value of Compressed Air Energy Storage in Energy and Reserve Markets," National Renewable Energy Laboratory, USA, 2009.
- [23] "Handbook for Energy Storage for Transmission or Distribution Applications. Report No. 1007189. Technical Update December 2002. Document can be found at: [www.epri.com](http://www.epri.com)," EPRI, 2002.
- [24] "COST AND PERFORMANCE DATA FOR POWER GENERATION TECHNOLOGIES, Report prepared for the National Renewable Energy Laboratory, Available on <https://www.bv.com/docs/reports-studies/nrel-cost-report.pdf> (Accessed February 2017)," Black & Veatch, 2012.
- [25] B. McGrail, "Techno-economic Performance Evaluation of Compressed Air Energy Storage in the Pacific Northwest. Available on <http://caes.pnnl.gov/pdf/PNNL-22235.pdf>. Accessed February 2017," Pacific Northwest National Laboratory (operated by Battelle), 2013.
- [26] "Materials Roadmap Enabling Low Carbon Energy Technologies, Commission Staff Working Paper," European Commission, Brussels, 2011.
- [27] A. Bary, "Storing natural gas underground. Available on [https://www.slb.com/~media/Files/resources/oilfield\\_review/ors02/sum02/p2\\_17.pdf](https://www.slb.com/~media/Files/resources/oilfield_review/ors02/sum02/p2_17.pdf) (Accessed February 2017)," Oilfield review, 2002.
- [28] A. Cavallo, "Controllable and affordable utility-scale electricity from intermittent wind resources and compressed air energy storage (CAES)," vol. 32, pp. 120-127, 2007.
- [29] J. T. Dasand, "Compressed Air Energy Storage (Educational Chapter)," Iowa state University, 2012.
- [30] E. M. G.Locatellia, "Assessing the economics of large Energy Storage Plants with an optimisation methodology," vol. 83, April 2015.
- [31] "Energy Storage News," Energy Storage News, 2016. [Online].
- [32] P. Tayler, "Pathways for Energy Storage in the UK, Report 007," The Centre for Low Carbon Futures, March 2012.
- [33] H. Lund and G. Salgi, "The role of compressed air energy storage (CAES) in future sustainable energy systems," vol. 50, pp. 1172-1179, 2009.

[34] M. Nakhamkin, M. Chiruvolu and C. Daniel, "Available Compressed Air Energy Storage (CAES) Plant Concepts. Available on [http://www.espcinc.com/library/PowerGen\\_2007\\_paper.pdf](http://www.espcinc.com/library/PowerGen_2007_paper.pdf). Accessed February 2017," ESPC and Towngas International Company, 2007.

[35] J. Simmons, "Study of Compressed Air Energy Storage with Grid and Photovoltaic Energy Generation," The Arizona Research Institute for Solar Energy (AzRISE) - APS Final Draft Report., University of Arizona, 2010.

## 162 FLYWHEELS

### Contact information

Danish Energy Agency: Thomas Mandal Østergaard

Energinet.dk: Rune Duban Grandal

Author: Allan Schrøder Pedersen, DTU, Department of Energy Conversion and Storage

### Publication date

December 2018

### Amendments after publication date

Date	Ref.	Description

---

### Brief Technology Description

Flywheels store energy mechanically as kinetic energy by bringing a mass into rotation around an axis. According to classical, mechanical physics the kinetic energy of a rotating mass  $m$  in distance  $r$  from the point of rotation can be expressed as:

$$E_{kin} = \frac{1}{2} \cdot I \cdot \omega^2,$$

where  $I$  is the moment of inertia – equal to  $m \cdot r^2$  – and  $\omega$  is the angular velocity (radians per second).

It is seen from this expression that the kinetic energy of a rotating flywheel increases proportionally to the mass and to the distance from the rotation point squared. The energy also increases proportionally to the angular velocity squared.

To maximize the stored energy for a given mass and rotation speed, the mass should be separated from the rotation point as much as possible. On the other hand the centrifugal force acting on the mass is defined as:

$$F_c = m \cdot r \cdot \omega^2$$

and thus the requirements to the materials binding the mass to the rotation center - increases proportionally to the separation distance. This fact sets limits to the maximal available distance because of the properties (tensile strengths) of known, available construction materials.

Whereas flywheels were formerly mainly constructed of metallic materials, modern flywheels are usually constructed – at least partially - by polymer/fiber composite materials. Flywheels are appropriate for fast dynamic energy storage for applications like peak shaving or long energy storage times. Large flywheels should preferably be designed from composite materials due to the high rotational speeds and the bigger strength to weight offered by these materials. Metallic rotors are mainly used for simple seconds to minutes energy storage systems like UPS (uninterruptable power supplies). Thus, Amber Kinetics believes in steel as a suitable rotor material as seen on the photo to the right in Figure 1.



Figure 1: Photo of WattsUp Power's and Amber Kinetics' flywheels. The latter allowing for a look into the internal steel rotor whereas the first utilizes composite materials for the rotor [1].

Flywheels have been known and used for centuries in steam and combustion engines, whereas development of the independent energy storage potential has only been underway since the 1960s [2]. According to the reference given in [3] the world's largest flywheel has been in operation since 1985. It consists of 6 discs each with a diameter of 6.6 m and thickness 0.4 m, weighing 107 t. The system can supply 160 MW over a 30 sec period and has shown excellent reliability, particular concerning the mechanical construction. Another system developed by Okinawa Electric Company and Toshiba ROTES (ROTary Energy Storage) has been operated since 1996 [4]. The two examples indicate that flywheels represent highly reliable technology. This statement is supported by more recent data from Beacon Power, which states that their system is capable of more than 150,000 charge/discharge cycles at constant full power [5]. Such flywheel systems can be seen in Figure 2, with the addition of a separate fiber composite flywheel being carried by a forklift.



Figure 2: Photo of Beacon Power's flywheels [6]. The fiber composite flywheel itself is seen to the right on the fork-lift. Each unit is 100 kW. Photo from manufacturer's store.

A cross section of a flywheel system and the system installed in an operation environment can be seen in Figure 3.

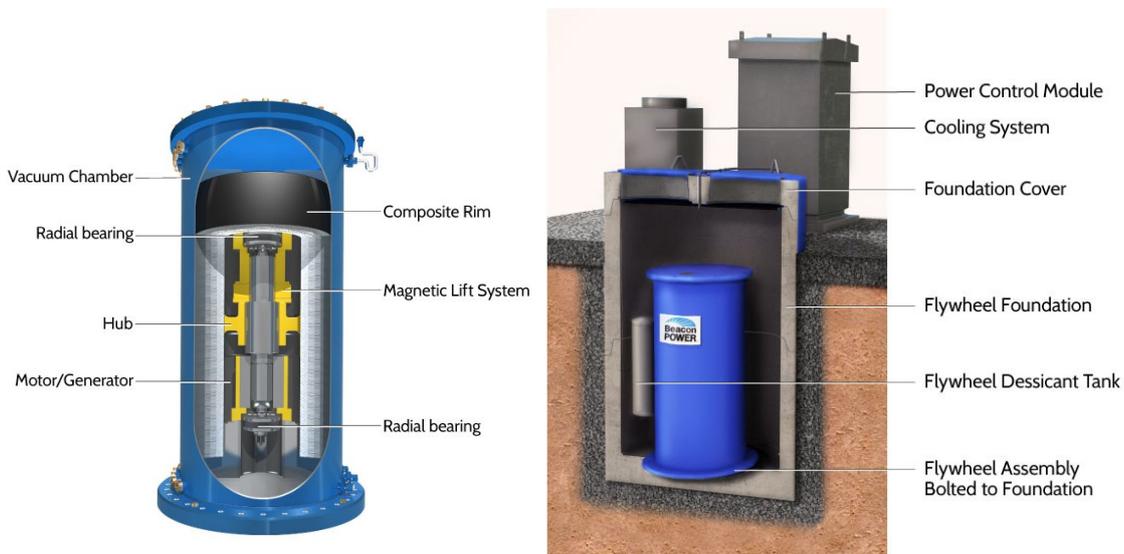


Figure 3: Drawing showing a cross section of the flywheel system and a visualization of how each module of a Beacon flywheel is mounted for operation [6]

### Input/Output

The input for flywheels is electricity.

The output from flywheels is electricity.

In principle flywheels can also be charged and discharged mechanically, but in any practical perspective for grid applications electricity would be the input and output.

### Energy efficiency and losses

Modern flywheels are operated in high vacuum to eliminate (or strongly reduce) aerodynamic drag. Likewise, the bearings are contact-less magnetic bearings, which means that the mechanical energy losses during a full storage cycle are negligible from a practical perspective. Flywheel technology in itself does not imply any significant energy loss even over prolonged periods. However, the power electronics taking care of converting primary power to the power format suitable for the flywheel and vice versa (the power electronics include rectifier, bus, inverter and converter) gives rise to loss of energy during the use of flywheels. These losses are naturally associated with charging and discharging the wheels and depends somewhat on the mode of operation. In 2018 WattsUp Power stated that stand by losses of today's flywheel technology is about 5% per day whereas round trip efficiency is 98 % for the wheel.

In contrast Beacon Power in 2009 stated that the energy loss would be about 15% for a full charge/discharge cycle, measured at the transformer terminals, whereas for typical operation providing frequency control the loss per cycle would be 6-7% [5].

Due to its mechanical design and working principle, flywheels have zero degradation in energy storage capacity over time. This is independent of how the system is operated and in particular independent of depth of charge and discharge, which is in noteworthy contrast to the properties of most electrochemical battery systems.

### Regulation ability and other system services

Flywheels can absorb and release electro-mechanical energy extremely fast. The response time is up to 10 times faster than the response times of batteries, meaning that flywheels can react on demand and supply signals almost instantaneously. This property is attractive for providing ancillary services in the power grid and makes flywheels highly suitable for frequency regulation.

Due to the fast response time flywheels can provide ultrafast ancillary services to the grid, with reaction times down to 3 ms. In particular primary reserves – and even synthetic inertia - for maintaining grid frequency can easily be provided and managed by use of flywheels. The reason for flywheels sometimes outshining batteries for certain applications is their high ramping rate. The fast up and down ramping rates and the not ignorable storage capacity makes flywheels suitable [2] for

- Ramping (how fast an application can increase or decrease load)
- Peak Shaving
- Time Shifting (storing energy from one time to another)
- Frequency regulation
- Power quality (in particular voltage) – Power distribution grids strive to have a power factor as close to 1 as possible. Using flywheels, power utilities may vary active and re-active power to reach a perfect power factor.

An example illustrating the response time of a flywheel system can be seen on Figure 4.

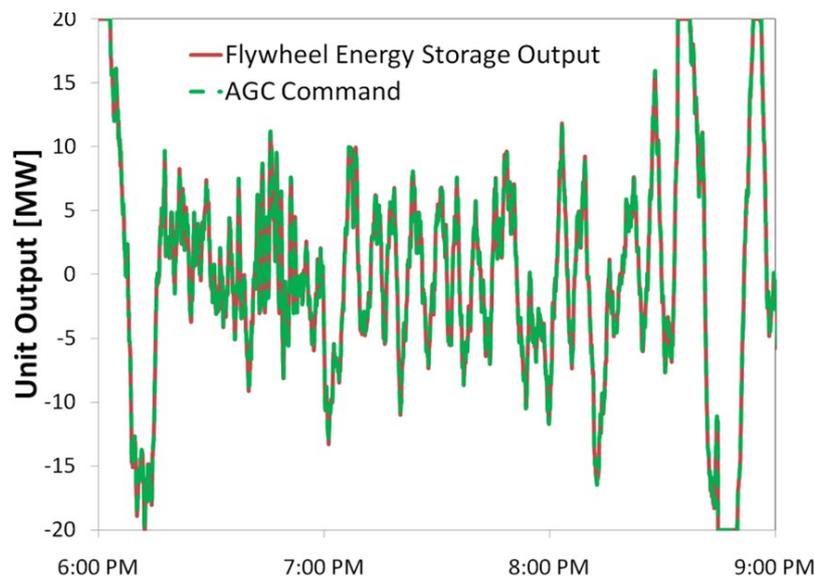


Figure 4: The reaction of a flywheel (MW input/output) in response to signals from the Automatic Generation Control. It can be seen that within the accuracy of the graph (please note the axis scaling) the flywheel follows signals completely. Source: Beacon Power.

## Typical characteristics and capacities

### Storage density

The energy storage density – whether on volume or weight basis – for flywheels (about 0.05 kWh/kg) is comparable to advanced batteries and in the range of 1-2 orders of magnitude lower than for chemical methods for storing energy (in ways similar to the natural energy storage media oil and gas). This is, however, not important for static applications. On the other hand flywheels have high power densities of about 1 kW/kg [7] also confirmed by WatssUp Power in February 2018.

### Sizes of flywheel plants

Flywheels for energy storage can be produced and deployed in numerous sizes ranging from multi MW utility applications to small systems (few kW and kWh) intended for use in cars and buses. Until recently Beacon Power seemed to be the dominating producer of large scale flywheels. Their systems are based on a modular flywheel size (a single flywheel) of 100 kW and 25 kWh, with the standard unit size consisting of an assembly of 10 modules which can be combined in any multiple of 10. Such modules sum up to 1 MW and 250 kWh. Figure 5 shows a photo of an example of their systems that currently provides 20 MW of frequency regulation service.



**Figure 5: Photo of Beacon Power flywheel installation in commercial operation in PJM, Hazle, Pennsylvania. The plant includes 200 flywheel modules lowered into the ground (5 on each side of a container). The plant currently provides 20 MW of frequency regulation service to PJM and reached full commercial operation in July 2014 [6].**

### Typical storage period

Flywheels can be constructed to store energy from seconds to years, but usually the storage period is shorter than days. Flywheels have relatively small standby losses, and the user or producer will design a flywheel for each specific application. Now a typical 10 second storage application could be a UPS (uninterruptable power supply) for hospitals or server centers. In other less typical applications like power peak shaving, the flywheel will be designed to store the power for days and in the most extreme conditions in space applications NASA's flywheel designs store the power for up to 3 years.

## Space requirement

The land area requirement for flywheels naturally depends on the capacity of the installation. Figures 5 above gives indications of the area demand, additionally, Beacon Power states that the space required for an installation of 20 MW is 1 acre (approx. 4000 m<sup>2</sup>)

## Advantages/disadvantages

### Advantages

Flywheels are fast reacting, reliable, efficient and clean in terms of use of resources and waste disposal.

Some advantages and disadvantages are shown in Table 1.

**Advantages and Disadvantages of Flywheel Energy Storage Relative to Other Energy Storage Technologies**

Advantages	Disadvantages
Power and energy are nearly independent	Complexity of durable and low loss bearings
Fast power response	Mechanical stress and fatigue limits
Potentially high specific energy	Material limits at around 700M/sec tip speed
High cycle and calendar life	Potentially hazardous failure modes
Relatively high round-trip efficiency	Relatively high parasitic and intrinsic losses
Short recharge time	Short discharge times

**Table 1: Advantages and disadvantages of Flywheel Energy Storage Relative to Other Energy Storage Technologies, 2003 [8]. Please note that the table reflects data from 2003, and may have been improved since then. For instance WattsUp is now using tip speed of 875 m/sec.**

As an example of hazardous failure modes the crash of two Beacon Power flywheels in 2011 is prominent. The incident was described by the Beacon Power spokesman:

*“flywheels failed due to flawed early production runs of the carbon fiber material used in their manufacture. The faulty flywheels spun out of balance and tilted to touch the chamber sides, which caused the flywheels to “grind down” into a heated “cotton candy-like material” of carbon fiber. Safety features in the chamber detected the rising temperature and released water to cool the units, which created steam that caused pressure to increase, blowing off chamber covers in an explosive manner” [9].*

## Environment

There are no particular environmentally hazardous aspects of flywheels. Materials and production methods imply the same environmental emissions as any manufacturing based on metals and polymers.

Under operation, there is no use of water, harmful chemicals or hazardous materials.

It can be argued that application of flywheels in the grid will save CO<sub>2</sub> emissions to the extent they improve the ability to utilize variable renewable energy production.

### Research and Development Perspectives

In 2013 the European Association for Energy Storage (EASE) stated the following R&D needs for flywheels [10]:

1. Flywheel disc: Study of better materials for fibre flywheels (high density) should be carried out in order to reduce the total cost.
2. Electrical machines: High performance machines are required to be used in these devices and although permanent magnet machines seemed to be the best option, the high cost of the magnets has redirected the research to search new machine concepts with less magnets.
3. Bearings: Faster control systems are being developed to improve the bearings response and more efficient actuators are used to increase the performance of the complete system.
4. Power electronics: Increase the added value of the power electronics in an energy storage system, ensuring the robustness and reliability.
5. Digital control and communications: Communication improvements permit to control the system with guaranties of robustness, being able to analyse a lot of variables, maintaining a complete analysis of the application from anywhere, being easily integrated with some other subsystems.
6. Security case or frame: A better knowledge and a more wide experience in prototypes would reduce the cost in security.
7. Demonstration plants to demonstrate the convenience or not of flywheel technology for certain applications

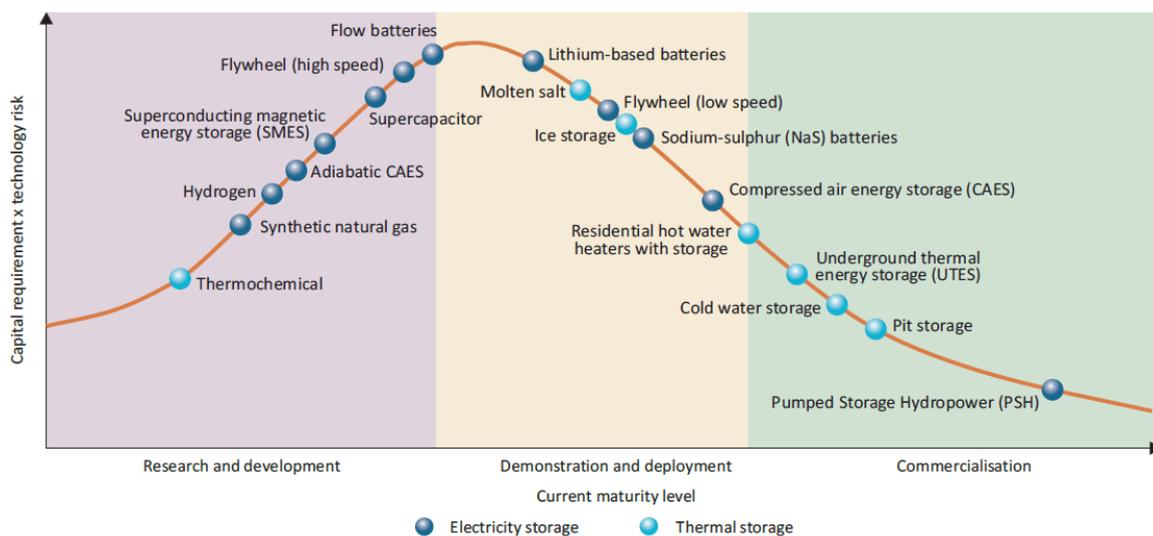


Figure 6: Ranking of energy storage technologies concerning maturity level [11]. Data published in 2013. Flywheels have moved to the next class of the figure since then.

Figure 6 shows how the International Energy Agency (IEA) considers the maturity of flywheels compared to other storage technologies. The ranking was published in 2013 and since then flywheels have gained maturity so that they are now used in commercial applications.

Flywheels are generally considered to be a little less mature technology than many batteries and in addition the cost is perhaps still too high to make them competitive on the commercial market somewhat depending on the specific application, though [12]. However, as described in the present document, flywheels also seem to be catching up rapidly and gain market shares although batteries are still dominating many energy storage applications. In some applications – like grid stabilization for railways and large battery charging – flywheels are often a preferred solution.

## Examples of market standard technologies

### Test standards

SAE, the Society of Automotive Engineers, has developed standards [13] for smaller flywheels used in combination with combustion engines. The SAE Recommended Practice applies to flywheels used with internal combustion engines of spark ignition and diesel type. The document is intended to provide a uniform test procedure for flywheel assemblies to determine the rotational speeds at which they will either burst or withstand a specified limiting speed.

According to the IEC, International Electrotechnical Committee, [14] standards have only been developed for mature electrical energy storage systems (such as PHS, LA, NiCd, NiMH and Li-ion) and for those technologies various IEC standards exist. However, to the knowledge of the author of this section no standards exist for grid-connected flywheels.

### Potential flywheel suppliers

A number of potential suppliers are listed below. Most manufacturers seem to concentrate their product development towards niche applications like the market for uninterrupted power supply. A simple check of the below web sites shows that some suppliers may not even really market flywheels in the sense that they have standard designs and products. However in relation to ancillary services particularly Beacon Power, Calnetix and recently WattsUp Power have pioneered a considerable development work and seem indeed to be reliable suppliers.

Active Power	<a href="http://www.activepower.com">www.activepower.com</a>
Amber Kinetics	<a href="http://amberkinetics.com">http://amberkinetics.com</a>
Beacon Power	<a href="http://www.beaconpower.com">www.beaconpower.com</a>
WattsUp Power	<a href="http://wattsuppower.com/about-us">http://wattsuppower.com/about-us</a>
CAT	<a href="http://www.cat.com/en_US/power-systems/electric-power-generation/ups-flywheel.html">http://www.cat.com/en_US/power-systems/electric-power-generation/ups-flywheel.html</a>
Calnetix	<a href="https://www.calnetix.com/">https://www.calnetix.com/</a>
Optimal Energy Systems	<a href="http://www.optimalenergysystems.com/">http://www.optimalenergysystems.com/</a>
Pentadyne	<a href="http://www.pentadyne.com/">http://www.pentadyne.com/</a>
Piller GmbH	<a href="http://www.piller.com">www.piller.com</a>
Precise Power Corporation	<a href="http://www.precisepwr.com">http://www.precisepwr.com</a>
Toshiba	<a href="http://www.toshiba.co.jp/thermal-hydro/en/hydro/products/facts/rotes.htm">http://www.toshiba.co.jp/thermal-hydro/en/hydro/products/facts/rotes.htm</a>
Vycon	<a href="http://www.vyconenergy.com">www.vyconenergy.com</a>
Urenco Power Technologies	<a href="http://www.urenco.com/">http://www.urenco.com/</a>
Ricardo	<a href="http://www.ricardo.com/en-GB/Who-we-are/">http://www.ricardo.com/en-GB/Who-we-are/</a>

## Prediction of performance and costs

### Performance and costs in 2017

#### Performance

Figure 7 is an excerpt from test data for a flywheel run in the New York ISO grid in the US. The extremely fast reaction time of flywheels is indicated (often superior to reaction times for batteries). There is no reason to anticipate improvement (or need for improvement) of this performance.

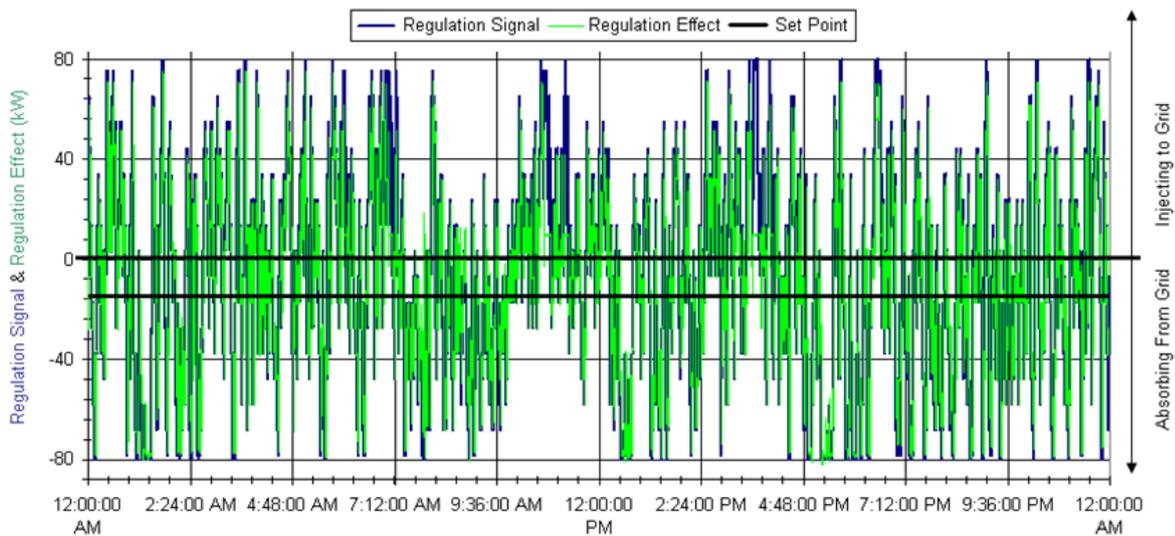


Figure 7: Test data run in the New York ISO grid in the US. The data shows regulation during one day and night after 8 months following fast changing frequency regulation signal. Availability to respond 97.2% of the time it was online. Source: Beacon Power.

#### Costs

System installation prices naturally depend on the individual location conditions and size of purchase.

Examples of prices for flywheels in 2010 and 2017 and comparison of these prices are shown in Table 2 which is based on information provided by Beacon Power in 2010 and by WattsUp Power (WUP) A/S in 2017 (numbers are based on recent sales).

Cost of flywheel 2010 and 2017			
<b>Beacon Power plants 2010</b>			
Discharge-/charge capacity	(MW)	1	0.2
Energy storage	(Wh/W)	0.25	0.25
Cost per charge capacity	M\$(2010)/ MW	2.9	8
Cost per capacity	M\$(2015)/ MW	3.1	8.5
Cost per charge capacity	M€(2015)/ MW	2.3	6.4
Cost per energy storage	M€(2015)/MWh	9.3	4.6
<b>WattUp plants 2017</b>			
Discharge-/charge capacity	(MW)	1	2
Energy storage	(Wh/W)	0.1	0.1
Cost per charge capacity	M€(2015)/ MW	0.20	0.16
Cost per energy storage	M€(2015)/MWh	2.0	1.6

Flywheel cost reduction 2010 to 2017		
		1
Cost per charge capacity	per MW	92%
Cost per energy storage	per MWh	79%

Table 2: Prices for flywheels and comparison of prices, information is provided by Beacon Power in 2016 and WattsUp Power (WUP) A/S in 2017 (numbers are based on recent sales)

In the examples in Table 2 significant drop in cost from 2010 to 2017 can be seen. The costs calculated per charging/discharging capacity has fallen approximately 90 % (for 1MW plants) and calculated relative to energy storage capacity it has decreased 80 %. This can indicate of that the prices in general have decreased significantly, even if the plants are not directly comparable as the energy storage capacities are not the same.

One major reason for the dramatic decrease in flywheel prices is a corresponding decrease in materials prices for materials (polymer composite materials) used for production of the flywheel itself. In 2017, 40% of the total investments cost, including BoP, for flywheels arises from rotor materials costs [15]. The reason for the materials price decrease is the considerable market expansion for windmills, which use the same kind of

<sup>6</sup> Beacon Power 2009:- Full system price for a 1MW(250kWh) system in the range of \$2.8-3 million/MW; -2 flywheel(200kW) system app. \$1.6 million/MW, both prices without VAT and to be adjusted for relative scope.

<sup>7</sup> WattsUp Power 2017: Standard solutions optimized to stabilize MV/LV power transformers in the power grid. The system is sold in modular configurations. Each module has a capacity of 100kWh and a peak discharge capacity of 1 MW capacity. Full system price in the range of 1.5 million Dkk/MW and for a 2 MW (200kWh)system in the range of 2.5 million Dkk/MW, both prices without VAT and to be adjusted for relative scope.

materials and manufacturing routines for turbine rotor blades. This decrease in materials prices is expected to continue for the coming decade.

Table 3 shows historical flywheel prices as well as recent up-to-date prices for flywheel systems. Looking at the prices in the table it is difficult to predict a significant tendency neither in energy price nor in power price.

Year of publication	Investment cost per energy storage capacity		Investment cost per discharge capacity		Reference
	\$/kWh*	M€/MWh (2015 prices)	\$/kW*	M€/MW (2015 prices)	
2001			230	0.35	19
2003			300	0.35	10
2010		9.3		2.3	Beacon Power <sup>8</sup>
2010		5		6.4	Beacon Power <sup>9</sup>
2011	4000	3.1	1500	1.1	20
2012	1000	0.81	250	0.20	9
2012	14000	11	25000	20	9
2013	300	0.23	1333	1.0	22
2014			130	0.10	15
2015	6500	5.9	24	0.02	23
2015	1340	1.2	3360	3.0	24
2015	1570	1.4	3920	3.5	24
2015	3000	2.7			25
2017		0.3		0.03	WattsUp Power
2017		2.0		0.20	WattsUp Power <sup>10</sup>
2017		1.6		0.16	WattsUp Power <sup>11</sup>

Table 3: Overview of energy- and power prices for flywheel storage systems, from different references and years, prices are updated to 2017 based on CPI index change. \*Price year is the year of the publication.

### Maintenance

Maintenance costs decreased considerably from 2009 to 2017, as shown by information from Beacon Power 2009 and WattsUp Power 2017.

<sup>8</sup> Table 2 Beacon Power, plant size: 1 MW

<sup>9</sup> Table 2 Beacon Power, plant size: 0.2 MW

<sup>10</sup> Table 2 WattsUp Power, plant size: 2 MW

<sup>11</sup> Table 2 WattsUp Power, plant size: 1 MW

Data from Beacon Power 2009:

- Detailed operating and maintenance manuals available
- No onsite operator presence
- Remotely monitored
- Specific faults shut down systems and notify operators
- Flywheels monthly visual inspections
- Monthly BOP maintenance (pumps/fans/chillers/etc.)
- ~4-5% of capital cost/year

Data from WattsUp Power 2017:

- Detailed operating and maintenance manuals are available.
- No onsite operator presence.
- Remotely monitored.
- Specific errors/malfunctions shut down systems and notify operators.
- Flywheels yearly visual inspections.
- Maintenance cost < 1% of capital cost/year.
- Product life time +25 years on mechanics and 15 years on electronics.

The demand for inspection is reduced from once each month to once a year and the expected yearly cost of maintenance is reduced from 4-5% of capital cost to 0.01% of capital cost p.a. At the same time, the expected capital cost for WattsUp Power flywheel is a fifth to a tenth of the cost of Beacon Power meaning that the maintenance cost for a WattsUp Power flywheel in 2017 is less than 1 % of the maintenance cost for a Beacon Power flywheel in 2009.

### Lifetime

The expected lifetime for a flywheel system in 2017 is in the range of 20-25 years for the wheel or more than 1,000,000 cycles.

Losses from flywheels are low and can be down to the range of 1%/year when left in a spinning state [16]. The practical number however is 5% (WattsUp).

Reliability: Mean time between failures 3.400.000 hours (Beacon Power).

### Prediction of price and performance

As mentioned above a significant decrease of material prices for manufacturing the flywheel rotors has been seen over recent years and this development is believed to continue in years to come. Since the cost of the rotor in 2017 is about 40% of system costs a decrease in materials prices has a significant impact on the full system cost. This is the explanation why flywheel system prices have recently decreased up to 30%/year and is expected to continue decreasing significantly over the next decades.

The price prediction data given in Table 4 below are based on an evaluation of how the price decrease development can be anticipated towards 2050. In fact, the materials and production technology used for the wheels themselves are the same as used in wind turbine industry for rotor blades. The strong demand for new and more efficient wind turbines at lower price has driven a correspondingly strong decrease in materials prices, which has in turn had a parallel impact on flywheels. The same development is anticipated to go on approx. for the next 10 years supported also by learning processes and increased production volume. After 2025 a much more controlled – although still decreasing – price development for flywheel systems is expected.

### Uncertainty

As described in the above section there is uncertainty to the flywheel price projection shown in the present document (Table 4 below). 40% of this uncertainty is linked to the corresponding development in wind turbine rotor blades and this effect is expected to decrease in the years towards 2050 due to increasing maturity of composite production technology. The remaining 60% of system price concerns more mature and well-known technology (e.g. electronics and control system), where the price projection is less uncertain. The price projection shown in Table 4 results from summing the estimations from the two contributions.

### System delivery time

Delivery time for a flywheel system will depend somewhat on the local site schedule including permits from relevant authorities. But it seems that the delivery time in 2017 has been reduced to about half of the delivery time in 2009.

In 2009 Beacon Power informed that an optimistic schedule for flywheel delivery would be

- For purchase of 1-2 flywheels 0.1 MW approx. 9 months
- For purchase of 1 MW module around 12-15 months
- For purchase of 20 MW SEM initial operation after 12-15 months and full operation after 15 months

In 2017 WattsUp Power informed that delivery time for a flywheel system is 3-6 months, including planning. Laboratory tests are available within 2 – 4 weeks.

## Quantitative description

Technology	Flywheels								Note	Ref
	2018	2020	2030	2050	Uncertainty (2020)		Uncertainty (2050)			
<b>Energy/technical data</b>					<b>Lower</b>	<b>Upper</b>	<b>Lower</b>	<b>Upper</b>		
Form of energy stored	Electro-mechanical energy									
Application	Short and medium term grid services									
Energy storage capacity for one unit (MWh)	0,1	0,1	0,1	0,1	0.1	0.1	0.1	0.15	A, F, M	
Output capacity for one unit (MW)*	1	1	1	1	1	1	1	1.5	A, F, M	
Input capacity for one unit (MW)*	1	1	1	1	1	1	1	1.5	A, F, M	
Round trip efficiency (%)	98	98	98	98	98	99	98	99	G, M	
- Charge efficiency (%)	99	99	99	99	99	99.5	99	99.5	G, M	
- Discharge efficiency (%)	99	99	99	99	99	99.5	99	99.5	G, M	
Energy losses during storage (%/day)	5	3	1	1	2	5	0.5	1.5	H	[16]
Auxiliary electricity consumption (% of output)	0								C	
Forced outage (%)	0									[17]
Planned outage (weeks per year)	0									
Technical lifetime (years)	20	20	25	25	20	25	20	25	B, M	[17]
Construction time (years)	0.5	0.25	0.25	0.25	0.25	0.25	0.25	0.25	A, M	
<b>Regulation ability</b>										
Response time from idle to full-rated discharge (sec)	0.003	0.003	0.003	0.003	0.003	0.003	0.003	0.003	D, M	
Response time from full-rated charge to full-rated discharge (sec)	0.003	0.003	0.003	0.003	0.003	0.003	0.003	0.003	D, M	
<b>Financial data</b>										
Specific investment (M€2015 per MWh)	1	0.335	0.335	0.335	0.3	0.36	0.3	0.36	E, J, L	[18]
- energy component (M€2015 per MWh)	1	0.33	0.33	0.33	0.3	0.36	0.3	0.36	D	
- capacity component (M€2015 per MW)	0.1	0.1	0.1	0.1	0.1	0.1	0.09	0.1	D	
Fixed O&M (€2015/MW/year)	750	750	750	750	750	750	750	750	D, M	
Variable O&M (€2015/MWh)									I	[7]
<b>Technology specific data</b>										
Specific investment (M€2015/MW)	0.164	0.145	0.136	0.131	0.14	0.15	0.13	0.14	A	[18]
Specific energy (Wh/kg)	115	350	350	350	300	400	350	400	A	
Specific energy (Wh/l)	500	1500	1500	1500	1300	2000	1300	2000	A	
Cycle life	10 <sup>6</sup>	10 <sup>6</sup>	10 <sup>6</sup>	10 <sup>6</sup>	10 <sup>6</sup>	10 <sup>7</sup>	10 <sup>6</sup>	10 <sup>7</sup>	A	

### Notes

- A. Data informed by WattsUp Power February 2018
- B. +25 years on mechanics. 15 years on electronics. Informed by WattsUp Power March 2017
- C. 150 W during upstart procedure for 7 min informed by WattsUp Power. After upstart auxiliary power is included in round trip efficiency
- D. Informed by WattsUp Power February 2018
- E. Confer also Table 2
- F. Please note that the mentioned 1 MW is standard size *of one unit* that can be assembled to larger entities functioning as “larger units” (somewhat similar to the case of cells in batteries). The displayed financial data is for a 2 MW plant. Flywheels can be connected and provide 20 MW regulation power and several MWh of storage capacity (this size is in commercial operation cf. Figure 5 above). Higher capacities can be obtained and the price per unit decreases when several units are purchased.
- G. Informed by WattsUp Power February 2018
- H. Loss per day measured by WattsUp Power. The projected losses towards 2050 is justified by results already now obtained by NASA
- I. The variable costs of flywheels are not directly related to the power put in and out. The data is based on storing (and discharging) 33 MWh per day in 350 days per year. Data from WattsUp Power.
- J. Displayed price information is based on recent WattsUp Power sales prices for two units (each 1 MW, 100 kWh). Price for one unit of 1 MW and 100 kWh is approx. 0.1 mill EUR. If several units are purchased unit price may be lower than by purchase of two units.
- K. Based on plans for increasing rotational speed by a factor 3 (WattsUp Power)
- L. The non-flywheel costs depend on the use of the flywheel. Demanding use patterns may increase non-flywheel costs from the 5 kEUR (as included here) to 75 kEUR per MWh
- M. Future uncertainties based on author’s best assessment

## References

- [1] "<http://www.elp.com/articles/2016/01/amber-kinetics-signs-flywheel-energy-storage-contract-with-pg-e.html>," 2016. [Online]. [Accessed March 2017].
- [2] e. a. I. Gyuk, "Grid Energy Storage," US Department of Energy, 2013.
- [3] S.-i. Inage, "Prospects of Electricity Storage in Decarbonised Power Grids, IEA Working Paper Series," OECD/IEA, 2009.
- [4] "Toshiba Leading Innovation," Toshiba. [Online]. [Accessed March 2017].
- [5] "Fact sheet. Frequency Regulation and Flywheels," Beacon Power, 2010. Archived March 2017. Available on [https://web.archive.org/web/20100331042630/http://www.beaconpower.com/files/Flywheel\\_FR-Fact-Sheet.pdf](https://web.archive.org/web/20100331042630/http://www.beaconpower.com/files/Flywheel_FR-Fact-Sheet.pdf).
- [6] "<http://beaconpower.com>," Beacon Power. [Online]. [Accessed March 2017].
- [7] B. Z. a. S. Syri, "Electrical Energy Storage Systems: A comparative life cycle cost analysis," *Renewable and Sustainable Energy Reviews*, vol. 42, pp. 569-596, 2015.
- [8] I. P. ., E. S. Gyuk, "EPRI-DOE Handbook of Energy Storage for Transmission & Distribution Applications 1001834," US Department of Energy, Washington, 2003.
- [9] "timesunion," Times Union, 2011. [Online]. [Accessed March 2017].
- [10] "Joint EASE/EERA recommendations for a European Energy Storage Technology Development Roadmap towards 2030," EASE and EERA, Brussels, 2013.
- [11] "Technology Roadmap, Energy Storage," International Energy Agency, Paris, 2013.
- [12] N. K. Kohli, "Short-Term backup power through flywheel energy storage system. Available on <https://www.slideshare.net/Drnavinkumarkohli/ppt-fly-wheel-navin-kohli> (Accessed March 2017)," 2012.
- [13] S. o. A. E. I. SAE, "[https://global.ihs.com/doc\\_detail.cfm?rid=GS&&item\\_s\\_key=00138611](https://global.ihs.com/doc_detail.cfm?rid=GS&&item_s_key=00138611)," IHS Markit, 2013. [Online]. [Accessed March 2017].
- [14] "Electrical Energy Storage," International Electrotechnical Commission, Geneva, Switzerland, 2011.
- [15] 2. Private communication with WattsUp Power.
- [16] W. Torell, "Lifecycle Carbon Footprint Analysis of Batteries vs. Flywheels, White Paper 209," Schneider Electric, 2015.
- [17] W. V. H. Susan M. Schoenung, "Long- vs. Short-Term Energy Storage Technologies Analysis. A Life-Cycle Cost Study," Sandia National Laboratories, Albuquerque, New Mexico 87185 and Livermore, California 94550, 2003.

- [18] "Lazard's levelized cost of storage - Version 2.0," Lazard, 2016.
- [19] e. a. P. Tayler, "Pathways for Energy Storage in the UK, Report 007," The Centre for Low Carbon Futures, March 2012.
- [20] "<https://www.calnetix.com/resource/flywheels/advantages-flywheels>," Calnetix. [Online]. [Accessed March 2017].
- [21] "<http://www.climatetechwiki.org/technology/jiqweb-es-fw>," [Online].
- [22] P. N. N. L. Daryl Brown, "Federal Technology Alert. DOE/EE-0286," Federal Energy Management Program, 2003.
- [23] "InflationData.com," InflationData, 2017. [Online]. [Accessed 2017].
- [24] "Materials Roadmap Enabling Low Carbon Energy Technologies, Commission Staff Working Paper," European Commission, Brussels, 2011.
- [25] "energy.gov," 2010. [Online]. [Accessed March 2017].
- [26] "Scientific American," Scientific American, 2011. [Online]. [Accessed March 2017].
- [27] e. a. M. Hedlund, "Flywheel Energy Storage for Automotive Applications," *Energies*, vol. 8, pp. 10636-10663, 2015.
- [28] 2009. [Online]. [Accessed March 2017].
- [29] Memoori, Smart Building Resesearch, 2017. [Online]. [Accessed MArch 2017].

## 180 LITHIUM-ION BATTERIES FOR GRID-SCALE STORAGE

### Contact information

Danish Energy Agency:

Thomas Dahl, [thoda@ens.dk](mailto:thoda@ens.dk)

Emil Esketveit Rasmussen, [emrm@ens.dk](mailto:emrm@ens.dk)

Authors:

Anders Christian Solberg Jensen, [acje@teknologisk.dk](mailto:acje@teknologisk.dk), Danish Technological Institute

Gunnar Rohde, [groh@teknologisk.dk](mailto:groh@teknologisk.dk), Danish Technological Institute

Thomas Mandal Østergaard, [tmod@teknologisk.dk](mailto:tmod@teknologisk.dk), Danish Technological Institute

### Publication date

May 2025

### Amendments after publication date

Date	Description
22.05.2025	Update to text and data to reflect development
6.12.2019	Revised technology specific data for the LIB chapter regarding specific power and power density
4.10.2019	Revised financial data for the Lithium ion battery chapter, regarding PCM reinvestment and the power to capacity ratio.
15.03.2019	Corrections to the notes in the datasheet.
07.02.2019	
15.03.2019	Corrections to the notes in the datasheet.
07.02.2019	

### Qualitative description

#### Brief technology description

*Lithium-ion batteries* or *Li-ion batteries* (LIBs) are rechargeable batteries that store electric energy and provide electric power, typically for short durations (up to 6 hours) when used in relation to the power system. LIBs are a large family of technologies with several subgroups available, serving different applications depending on the power or energy requirements. The subgroups are typically defined by their inherent chemistry and new technologies are becoming available frequently. For energy storage, the NMC- or LFP-battery chemistries<sup>12</sup> are the dominating technologies. Non-rechargeable, or “primary”, LIBs exist but are mainly used for low-current or long-duration storage applications and not for large-scale applications. Rechargeable, or “secondary”, LIBs are applied in all kinds of consumer electronics, electric vehicles and large-scale electricity storage.

LIBs, and batteries in general, consist of battery cells, in which the energy is stored, which are assembled in modules and packed together into a battery system, as shown in Figure 8. The battery system also contains auxiliary components to ensure the battery operation. The battery system should not be confused with a grid-connected *energy storage system* (ESS), which is explained in the end of this section under “*Components in a lithium-ion battery energy storage system*”.


The first lithium batteries were developed in the early 1970s, and Sony released the first commercial lithium-ion battery in 1991. Since then, LIBs have improved the performance of electrical applications in several fields from miniature electronics to electric vehicles to large-scale grid storage. As of 2024, the largest standalone facility in operation is located at Moss Landing with 3 *GWh* energy capacity and 0.75 *GW* rated power output, with options to expand to 6 *GWh* energy capacity and 1.5 *GW* rated power output [1].

LIBs can be used to supply system-level services covering nearly all current services depending on the functionality of the attached inverter and the size of the system with sub-millisecond response times making them ideal for services such as primary frequency regulation, voltage regulation and load shifting. As the technology is effective both at large and small scale it finds uses in both large grid services and small household applications typically allowing access to power during blackouts or optimizing usage of rooftop solar power.

---

<sup>12</sup> Detailed description of LIB chemistries can be found in Table 4.


Figure 8 Basic components of a cell-based battery system from cell to system level.

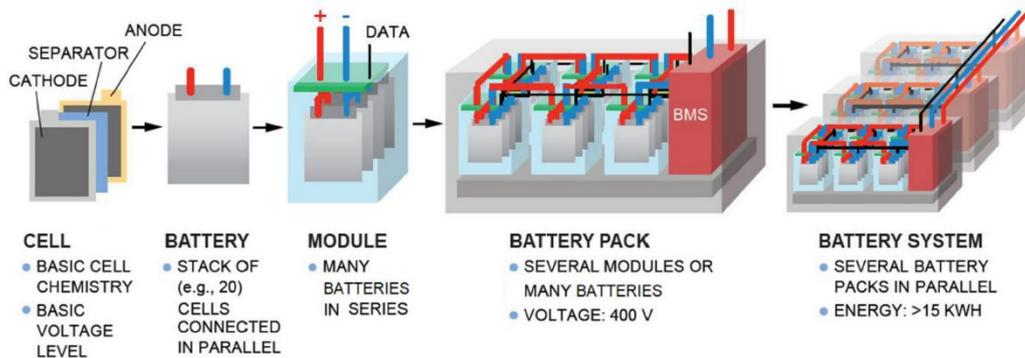

### The LIB electrochemical cell

A LIB cell contains two electrodes and a porous membrane as separator (see Figure 9). The materials used for the electrodes typically motivate the notation of the different LIBs. A liquid electrolyte fills the pores in the electrodes and membrane. Lithium salts (e.g.  $LiPF_6$ ) are dissolved in the electrolyte to form  $Li^+$  and  $PF_6^-$  ions. These ions can be released and absorbed by the electrodes from the electrolyte during charge and discharge. Alternatively polymer or solid electrolyte can be used but these are rarely seen in grid scale energy storage. The performance of the cell is determined by several factors with the chemistry of the anode and cathode electrodes being the main factor, but geometry, electrode thickness and electrolyte composition also influence the quality of the cell. Similarly, the cells architecture determine the ability to transfer heat out of the cell and avoid overheating from high power draw, since different materials or geometries show different thermal capacity and conductivity. A schematic representation of a cell's internal components is shown in Figure 9.

Figure 9 Schematic diagram of a typical LIB cell displaying the individual components in the battery. The membrane component is also known as the separator.

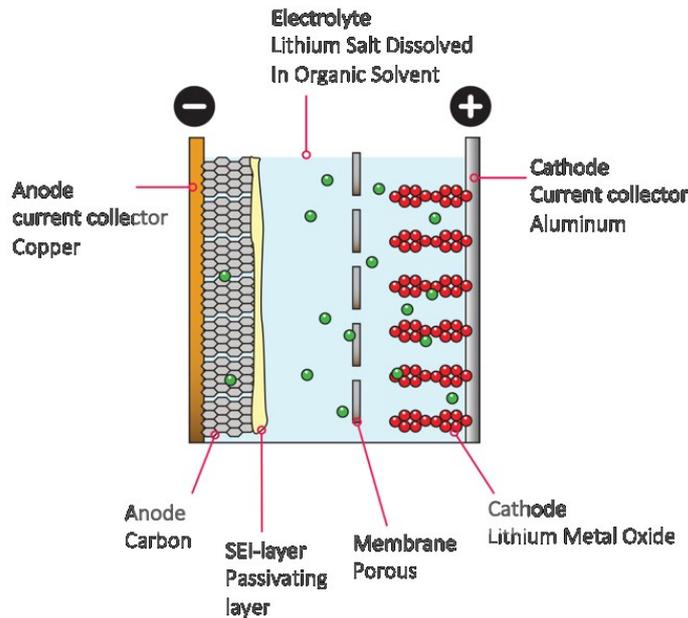

Each cell in a system provides a voltage and capacity with most LIB providing between 2 V and 5 V. In the case of the dominating NMC chemistry each cell provides about 3.6 V as nominal voltage. However, when fully charged each cell reaches 4.1 V to 4.2 V and once a load is used to discharge the battery the voltage drops until all the energy is consumed and the minimal voltage is reached. This minimum level varies from producer to producer and is typically between 2.5 V and 3 V.

As most stationary systems are build from modules with 24 V or 48 V, each module will typically be made of 6 or 16 cells in a series connection. On system level a voltage of 400 V, 600 V or 800 V is common, where 8, 12 or 16 individual 48 V-modules are connected in series to reach the system voltage. Thus common systems have 96, 144 or 192 cells in series through all modules. To increase the energy capacity without affecting the system voltage, cells are placed in parallel in the modules or whole systems are placed in parallel. This is typically presented as a  $96_s 2_p$  system, read as 96 cells in series and 2 in parallel. Parallel connections can be tens or hundreds of cells depending on the specific system. Generally, higher system voltages are common in applications with a higher power requirements and lower system voltages are found in compact low to medium power applications.

The operating range of a system in terms of voltage, temperature and power is determined by the architecture as described above. The entire system is protected from abuse by a *battery management system* (BMS) which controls the voltage, temperature and current the system is exposed to. If the limits of the system are exceeded the BMS must close down the system to protect the cells as voltage level, temperature or current outside of the limits can permanently damage the system and result in an increased safety risk.

### Lithium-ion chemistry

Table 4 shows a comparison of the three most widely used LIB chemistries for grid-connected LIB systems and the major manufactures. The listed chemistries are NMC, LFP and LTO. Other LIB chemistries such as LCO<sup>13</sup>, LMO<sup>14</sup> and NCA<sup>15</sup> are generally not used for grid electricity storage due to insufficient performance or high cost and are therefore not included in the table. The numbers in the table are from cell manufacturers or product and system suppliers.

NMC is the most widely used of the three chemistries, due to the increased production volume and lower prices led by the automotive sector. As mentioned above, a LIB contains an anode and a cathode, which are the two electrodes in the cell.

The LFP battery is the second dominating chemistry and is widely used for its high safety level, as it does not release oxygen from the cathode during fires. It has also found uses in the automotive sector for midrange cars due to the development of cell-to-pack technology.

Both NMC and LFP batteries have graphite anodes. The main cause for degradation of NMC and LFP LIBs is graphite exfoliation and electrolyte degradation, which occur outside the voltage limit of operations.

LTO LIBs are the least used and most expensive cell chemistry among these three. In LTOs the graphite anode is replaced with a lithium-titanate anode. The cathode of an LTO battery can be NMC, LFP or other battery cathode chemistries. The LTO technology excels at ultra-high-power application with charge times below 1 minute in the most extreme cases, while maintaining a very long lifetime with more than 10,000 cycles. The main drawback for this technology is the significantly lower energy density and high price making its application limited.

---

<sup>13</sup> Lithium Cobalt Oxide.

<sup>14</sup> Lithium Manganese Oxide.

<sup>15</sup> Lithium Nickel Cobalt Aluminium Oxide.

**Table 4** A comparison of three widely used LIB chemistries, with values based on the listed supplier's available data sheets for specific system.

Acronym	NMC <sup>16</sup>	LFP <sup>17</sup>	LTO <sup>18</sup>
Cell Chemistry	Lithium Nickel Manganese Cobalt Oxide	Lithium Iron Phosphate	Lithium Titanate
Energy Density (Wh/kg)	105 – 288 (Cell) 115 – 140 (System)	50 – 170 (Cell) 80 – 110 (System)	50 – 90 (Cell)
Energy Footprint <sup>19</sup> (kWh/m <sup>2</sup> )	~ 150	190 – 275	n/a
Cycle Life	1,500 – 8,000	4,000 – 12,000	20,000 – 25,000
Calendar Life	10 to 20 years	20 years	20 years
Exemplary Manufacturers	Samsung SDI, LG Chem, Panasonic, CATL, ATL	CATL, BYD, LG Chem, Panasonic, Ufine	Toshiba, Leclanche, Altairnano

### Sodium-ion batteries and other related battery cell types

There is a constant drive to develop new battery chemistries/technologies. While most never reach commercial success, a few promising technologies have shown the potential to complement or compete with the dominating LIB. Two promising technologies for industrial scaling are *sodium-ion batteries* (SIB) and solid-state batteries.

Sodium-ion batteries work as a simple substitution of lithium with sodium, but this minor change has caused complications, as the materials used in LIB must be reoptimized for the sodium ion before it can be commercialized. In contrast to lithium, sodium is less rare, geographically more abundant and cheaper, reducing the dependency on scarce resources for the battery system. SIBs operate on a similar principle, involving the movement of sodium ions between the anode and cathode during charge and discharge cycles. While they typically offer a lower energy density compared to lithium-ion batteries with CATL reporting energy densities of 160 Wh/kg based on a sodium Prussian white cathode chemistry. Their potential for lower costs makes them appealing for large-scale energy storage applications and midrange EVs. [2] However, it is unclear when sodium ion batteries will reach the necessary production scale to match the cost

<sup>16</sup> Cell and system values are taken from LG chem, TesVolt (using Samsung SDI), Panasonic, CATL websites.

<sup>17</sup> Cell and system values are taken from BYD, UFINE and CATLs websites.

<sup>18</sup> Cell and system values are taken from Toshiba and Leclanché websites.

<sup>19</sup> The energy footprint may vary significantly between suppliers, the numbers presented here are based on 4 systems from the listed suppliers. No values are given for LTO BESS systems as these were not available.

of LIB or succeed them. This technology is commercially available as of 2024 with several manufacturers on the market.

Solid-state batteries represent a broad family of batteries having a combined separator and electrolyte in one solid material. These batteries can be made with materials from both lithium and sodium ion technologies and use the same ions as the working principle. However, since the technologies does not rely on flammable liquid electrolytes, they promise a higher degree of safety as less fuel is available for a fire. However, this does not mean that they cannot catch fire, and safety concerns will remain. Additionally, since solid-state batteries allow for different electrode materials, there is greater possibility reaching higher energy densities, enabling longer battery life and improved performance in applications such as electric vehicles and portable electronics. Especially, if pure lithium metal anodes can be used safely not only in primary batteries, but this also greatly increases the energy density as the added weight of graphite can be removed. Despite these benefits, challenges remain in terms of manufacturing complexity and cost, especially as the manufacturing process is significantly different from LIB. Researchers are actively working to overcome these obstacles, aiming to make solid-state batteries a viable and widespread solution for future energy storage needs.


### Lithium-ion battery packaging

Battery cells come in various packaging styles—coin, cylindrical, pouch, and prismatic (Figure 10 and Figure 11) — each suited for different applications due to their unique characteristics. Coin cells are small and compact, perfect for low-power devices like watches and hearing aids. Cylindrical cells, known for their robust design and ease of manufacturing, are widely used in consumer electronics and electric vehicles, such as those made by Tesla, due to their enhancing safety and durability. Pouch cells are lightweight and flexible, making them ideal for applications where space and weight are critical, like in electric vehicles and portable electronics; however, their lack of rigid casing makes them more susceptible to physical damage. Prismatic cells have a rectangular shape that allows for easy stacking and efficient space use, making them suitable for electric vehicles and industrial energy storage systems. While they are more expensive to manufacture than cylindrical cells, prismatic cells offer better thermal management and higher capacity in a compact form. Each packaging type balances factors like size, energy density, cost, and application suitability to meet specific needs.

**Figure 10** Examples of LIB cells. (a) Tesla 21700 cylindrical NMC LIB cell [3]. (b) Samsung SDI prismatic NMC LIB cells [4]. (c) LG Chem pouch NMC LIB cell [5].



**Figure 11** Schematic drawing showing the shape, packaging and components of various Li-ion battery configurations [6]. (a) Cylindrical; (b) coin; (c) prismatic; and (d) pouch.

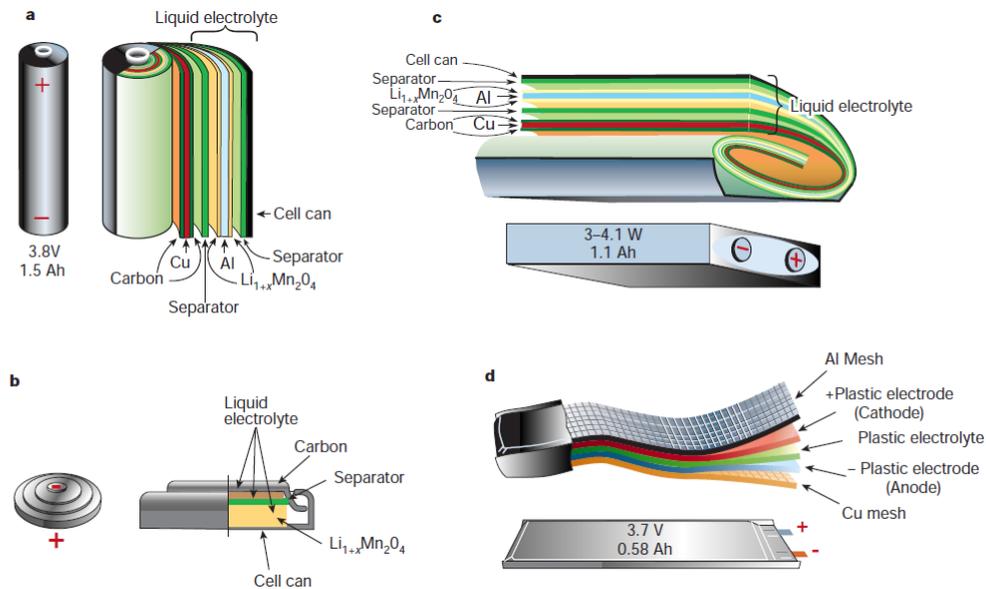


### Components in a lithium-ion battery energy storage system

Figure 12 provides an overview of the components in a LIB storage system with an interface to the power grid. In LIB storage systems, battery cells are assembled into modules that are assembled into packs (see Figure 8). The battery packs include the BMS. The BMS is an electronic subsystem that monitors the battery conditions such as voltage, current, and temperature and protects the cells from operating outside the safe operating area. This is the main component responsible for the functional safety of the system. The BMS may be implemented as a single unit, but in the case of grid scale systems it is often distributed with local monitoring units in each module and 1 or 2 layers of control units in each rack or container and a system control for the whole site, this can be combined with the *energy management system* (EMS) in some cases.

A *thermal management system* (TMS) regulates the temperature for the battery and storage system. The TMS depends on the environmental conditions, e.g. whether the system is placed indoors or outdoors. Further, an EMS controls the charge/discharge of the grid-connected LIB storage from a system perspective. Depending on the application and power configuration the *power conversion system* (PCS) may consist of one or multiple power converter units (DC/AC link). For system coupling a transformer may be needed for integration with higher grid voltage levels.

Grid integration provides services to the grid such as increased reliability, load shifting, frequency regulation etc. The services are described further below in the section “Regulation ability and other system services”. Value generation and profit is created by selling services to grid *transmission system operators* (TSOs). Battery capacity may be sold to the TSOs in full or partially, allowing for alternate use of the remaining capacity, for example local load management, energy trading or *distributed system operator* (DSO) services. Appropriate sizing of the battery and power conversion systems is essential to maximize the revenue. Technical aspects of a battery storage system, system coupling, and grid integration are summarized in Table 5, Figure 12 and Figure 13.

Figure 12 Components and their categorization of grid-connected battery energy storage systems, such as Li-ion. Modified from [7].

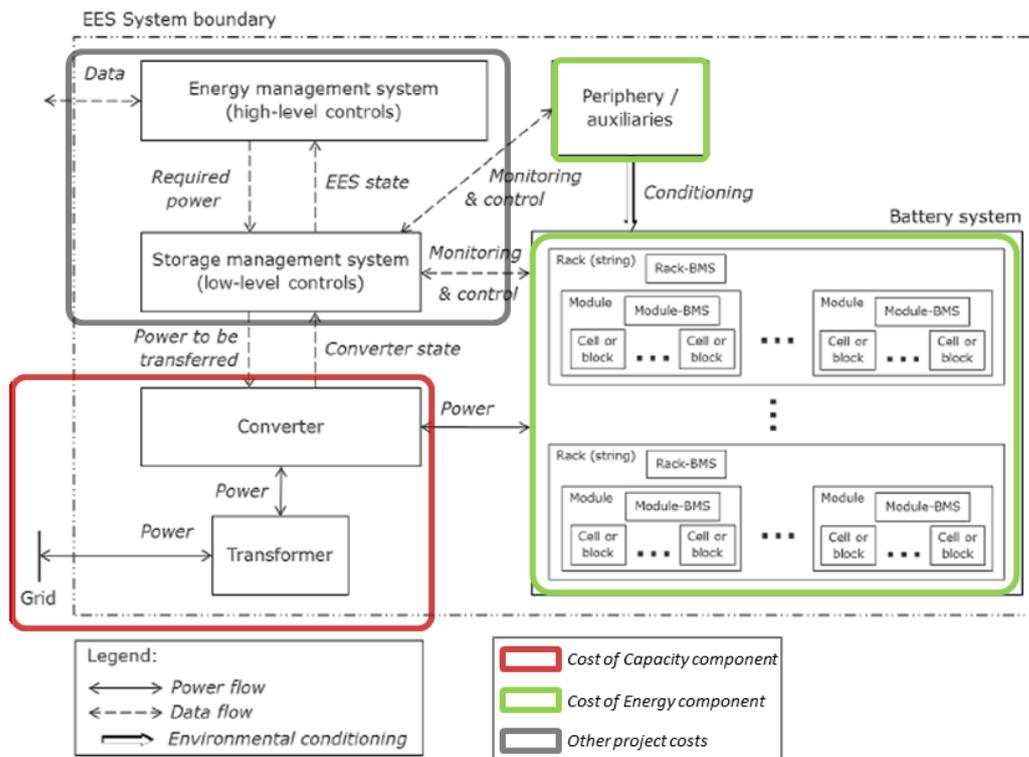

### Input/output

Input and output are both electricity but must be converted in voltage and/or from AC to DC and vice versa depending on the local grid type with the battery side always requiring DC. In an AC grid this is done by an inverter which outputs AC current at a set frequency and voltage level. In a DC grid a converter is used to transform the variable DC voltage on the battery side to a fixed DC voltage on the grid side. The grid may require AC or DC, with AC being the most common. Electricity is stored in the cell as electrochemical energy during charge and converted back to electricity during discharge. Typically, with around 10% loss released as heat.

### Energy efficiency and losses

The losses in a LIB can be divided into operational and standby losses. The operational losses are first described, then the standby losses. Finally, total energy efficiency is discussed.

#### Operational losses

The operational losses occur when energy is discharged or charged to/from the grid. It includes the conversion losses in the battery and the power electronics.

The battery loses energy as heat during charge and discharge with a typical loss of 1 – 12%, depending on the current drawn, where higher current leads to higher losses. For a system discharging/charging over more than an hour, losses in the battery are typically below 4% for modern technologies. As this is related to the internal resistance of the cell, it will increase during the cell’s lifetime typically reaching 200% of the initial value by *end of life* (EoL). However, the charge profile and temperature can heavily influence efficiency and

for systems at extreme temperature and/or high power/energy ratios the efficiency obtained can be highly system specific and will need individual evaluation to accurately understand.

Power electronics is responsible for converting the stored energy in the battery into a usable AC system at the grid frequency and voltage. Inverters are designed with an optimal efficiency load, typically around 90 – 95% of their rated capacity and are therefore the main source of losses.

The total round-trip efficiency is determined by the combination of losses in the inverter and the battery. The total roundtrip efficiency includes losses in the AC system and DC system in addition to the standby losses making the total roundtrip efficiency typically ranging between 80% and 90%. The higher the power rating of a system the more important a high efficiency system is to avoid issues with handling waste heat.

### Standby losses

LIB electricity storage system requires power to operate the auxiliary *balance of plant* (BOP) components, such as monitoring units, control systems and thermal management. Additionally, capacity components such as inverters have a standby consumption even at zero load that must be supported. This is often drawn directly from the battery itself.

The cells also experience self-discharge typically in the order of 0.1% per day depending on the environmental conditions. This arises from side reactions inside the cells, which are accelerated by increasing temperatures and therefore more important for systems in continuously warm climates. The standby losses are important for long-duration storage systems, as they are typically constant over time and not dependent on the number of charge/discharge cycles per day.

### Regulation ability and other system services

Grid-connected LIBs can absorb and release electrical energy almost instantly. The response time of grid-connected LIBs are strongly dependent on control components, EMS, BMS and TMS as well as the PCS. The fast response time and the ability of inverter to support grid services makes a BESS system capable of offering a wide range of services to the grid (Table 5 and Figure 13).


**Table 5** Grid services relevant for grid systems.

Services	Notes
Frequency regulation	Frequency services are supplied in a fixed timeframe where the system must react to changes in the grid frequency. The service's price is based on the power available from the system.
Energy shifting	Energy shifting is designed to minimize the peak power drawn from the local user or provide additional power during peaks hours on the utility scale.
Wholesale arbitrage	Wholesale arbitrage exploits price differences by buying energy when prices are low and selling when they are high.
Black start	Due to grid forming technology, in the inverter systems a BESS may be used to initiate the grid after a blackout. However not all inverters are designed for black start applications
Voltage support	Smaller BESS system may be placed in weak parts of the grid to provide or draw reactive power to influence the local voltage.

Increased self-consumption	For both large- and small-scale power production by wind or solar, a BESS may be used to avoid sending surplus energy to the grid when market prices are unfavorable. The energy can then be used locally or sold to the grid once prices are favorable.
----------------------------	--

These grid services often have requirements to a minimum size, power or response time, and thereby limiting access to different markets depending on the system specifications. The market requirements are generally met during the design phase of centralized systems targeting specific markets. However, the rise of decentralized systems such as aggregated *electric vehicles* (EV) or aggregated residential BESS has meant that smaller units can be combined to meet market demands similar to a virtual power plant. However, virtual power plants typically comprise power production units such as *photovoltaics* (PV) or wind power, which are not needed in an aggregated BESS or EV system. These systems are harder to control as their primary use influences the availability of energy and power from the systems. Because of this, these systems typically target markets such as energy arbitrage or frequency regulation. Due to practical reasons, decentralized systems may not be suitable to offer black-start services or voltage stabilization services. They also suffer from unpredictability of the available capacity and energy as e.g. an EV may be unplugged by the owner while it is actively providing grid services. For this reason, *vehicle-to-grid* (V2G) will require a large number of EVs to be aggregated to get a statistical capacity that is robust against individual EVs losing connection.

Figure 13 Battery storage can provide a broad range of services to a power system [8]. Battery storage applications are represented along the dimensions: horizontal axis shows the location within a power system; vertical axis shows the type of services.

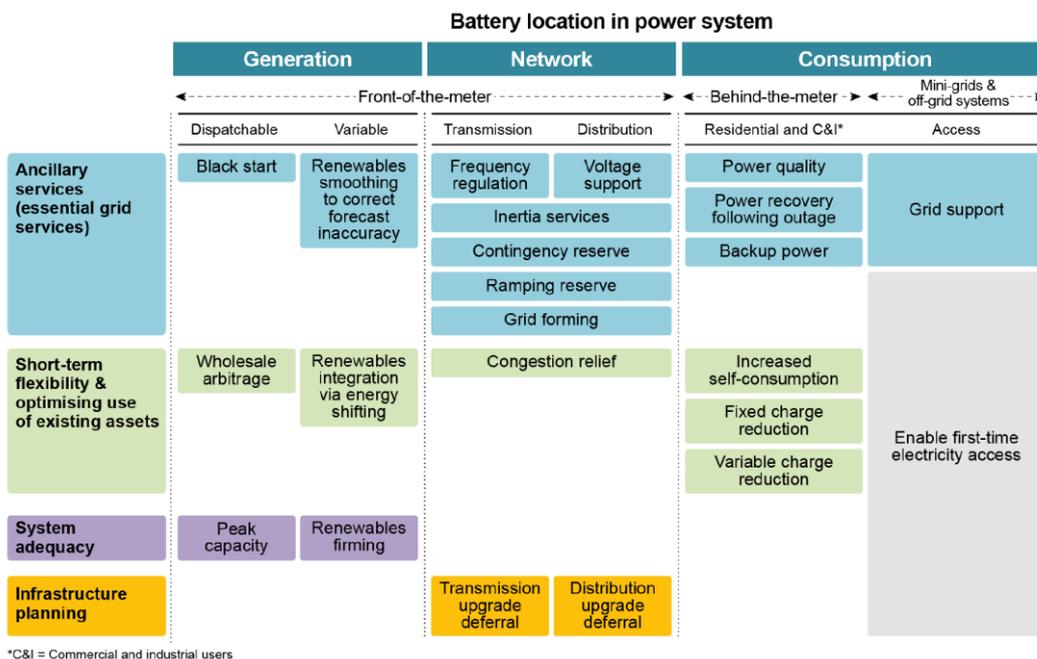

The BESS can further be used to provide inertia as a virtual spinning reserve. This can improve the integration of renewable energy. This service is rarely assessable by BESS system owners as it has historically been an

inherent feature of the generators in central power plants and unless they are taken offline, it may not be necessary to provide such a service from a BESS system.

### Typical characteristics and capacities

Most BESS systems are designed using the 19-inch rack standard or containerized solutions for easy installation. These racks can fit several modules in series and can often reach the full system voltage in a single rack. In this section we have taken 3 examples of commercially available BESS systems with 2 rack-based systems from Xolta and TesVolt and a containerized system from BYD see Table 6. Based on the available system, all have symmetric charge and discharge power rating and near  $1C_1$  power to energy ratio. All systems are in the range of  $0.075 - 0.12 \text{ kWh/kg}$  and  $105 - 160 \text{ kWh/m}^2$  with the containerized solution generally having better performance. However, the rack does allow for more flexibility when dimensioning the size of the system as several racks or containers can be placed in parallel to increase the size of the system. The 20 ft. containerize solution is used in the data sheet as the default unit.

**Table 6** Typical BESS characteristic for commercially available systems as of 2024.

Producer	Model	Energy	Power	Size (m)	Weight(kg)
Xolta	BAT-80/60	73 kWh	60 kVA	0.8 x 0.85 x 2.18	950
TesVolt	TS-I HV 100 E	96 kWh	96 kW	0.99 x 0.61 x 2.2	834
BYD	CP36-B2800-E-R1M01	2,560 kWh	2,430 kW	11 x 1.7 x 2.65	31,000

### Typical storage period

Several aspects of LIB technology put an upper limit to the feasible storage period. The lifetime of the battery means that the cost per cycle becomes significantly higher for long term storage. The BOP power for standby operation adds parasitic losses to the system, which further limits the feasible standby time. This calls for shorter storage periods in order to obtain enough cycles to reach positive revenue. Most markets provide both favorable charge and discharge conditions within an  $8 - 12 \text{ hrs}$  time window corresponding to the natural peaks loads during the day or the production from solar power farms. Therefore, most applications work well with a  $2 - 6 \text{ hrs}$  system matching the time characteristic of the market. This does not necessarily apply to frequency services, which can have much shorter time characteristics of  $15 - 60 \text{ min}$ . While systems with longer storage times are possible, they are generally not cost competitive due to the high cost of the energy unit and the low number of cycles that can be realized within the system's lifetime.

### Advantages/disadvantages

LIB based BESS systems have the main advantage that the technology shares part of the same supply chain as the automotive sector, causing the scale up of production to occur much faster compared to most other storage technologies.

On the technical side, the technology has a very fast response time and ability to deliver both high power and large amounts of energy making it useful for most services needed in the grid as described in the chapter above. Additionally, low maintenance is expected, resulting in low operational cost for the system.

The main disadvantage is the inherent fire risk of the battery cells which results in high requirements for fire safety, which can greatly increase the footprint of the system due to safety zones around the racks or containers.

Table 7 Typical BESS characteristic for commercially available systems as of 2024.

Advantages	Disadvantages
Short response time	Fire risks
Scales to large and small sizes	High voltage risks
High energy efficiency	Large investment cost
Proven technology	
Long lifetime	
Low maintenance	
Low cost per kWh/cycle	

**Environment**

Like all storage technologies, LIB adds additional *greenhouse gas* (GHG) emissions on the electricity that is stored. These emissions arise from manufacturing, recycling and losses during the use phase. However, energy storage in LIBESS can still provide a net reduction in GHG emissions of electricity by displacing high-emissions power sources, such as coal or gas based powerplants, with stored energy generated from low emissions sources such as wind or solar. The emissions from a BESS are determined in a *life cycle analysis* (LCA), typically taking all the above-mentioned contributions into account, i.e. emissions from production and avoided emissions from integration of *renewable energy* (RE). However, it is difficult to estimate the impact of RE-integration, since it is highly dependent on the actual usage of a BESS and the energy system in which it is integrated and may therefore vary significantly from case to case [9]. In a case study of a grid-scale BESS in Normandy it was estimated that with optimized control strategies, the BESS may displace up to 3 times the GHG emissions produced in its manufacturing and recycling phase [9]. Additionally, LCA analysis has shown that the choice of battery chemistry has a minimal impact on the total emissions. The main impact on the emissions per kWh stored comes from how intensely the BESS is utilized. More charging/discharging cycles per operating time reduces the emissions per kWh energy stored, an optimum lies typically around 1 full cycle per day. At frequencies above 1 cycle/day minimal additional improvement is achieved. External factors also affect the emissions intensity, especially the grid mix. When comparing the US grid mix with a pure PV source, the emission intensity drops from 0.55  $kg_{CO2eq}/kWh$  to 0.1  $kg_{CO2eq}/kWh$ , respectively [10, 11]. Based on common LIB technologies, it can be expected that BESS storage system in 2020 has an emission intensity of 200  $kg_{CO2eq}/kWh$  of installed capacity, resulting in a 43 – 84  $kg_{CO2eq}/kWh$  stored energy through the systems lifetime if the system is used effectively [11].

**Critical and strategic raw material aspects**

LIB technologies rely on *critical raw materials* (CRM). To classify as a CRM, according to the EU, material needs to be both economically important to the EU and have a certain risk in supply. Specifically, the so-called *supply risk score* must be over 1 and the *economic importance* be over 2.8. The score of relevant materials is published in the *Study of critical raw materials for the EU* in 2023. There were 32 identified CRMs out of 87 screened, additionally copper and nickel are considered strategic materials but do not meet the criteria for CRM. As shown in Table 8, all of the LIB technologies rely on CRMs and production is typically centralized in a few countries with China, Australia, Russia and Chile playing key roles in the global supply chains. In all CRMs recycling of EoL equipment cannot meet the current demand and as demand increases, this situation will likely persist in the future. The future demand toward 2040 is expected to rise significantly and will, even with optimized recycling rates, require additional production capacity of virgin materials, especially for nickel, cobalt and lithium [12]. In theory, there are enough CRM available globally to realize the current production targets for LIB. Mining and processing of these materials, however, has considerable negative ecologic as well as economic impact on the global energy transition and the sustainable development goals. Therefore, both recycling of LIB materials and alternative battery chemistries should be exploited in near future.

The raw material price of these materials is highly volatile and can shift significantly year to year. Especially 2022 and 2023 saw historical high pricing of lithium reaching 78 kEUR in November 2022 up from its historical low in Oct. 2020 of just 5 kEUR. [13] This volatility is drastically reduced when going from raw materials to full scale systems. This can be seen in the peak price of lithium, dropped 35.9% between April 2023 and April 2024. In the same period battery pack pricing dropped only 14 % driven by both innovation and price drop. The price volatility is further reduced by long term contract across the battery value chain. As a result, the volatility in raw material market is unlikely to have high impact on pack pricing in the short term. [14]

Table 8 Overview of key materials used on the different storage technologies.

CRM	Technologies	Biggest and second biggest producers	Supply risk/Economic impact <sup>20</sup>	Recycling share <sup>21</sup>
Aluminum	LIB (NMC, LFP, LTO), SIB <sup>22</sup>	Australia (28%) China (21%)	1.2(+)/5.8(+)	32 %
Cobalt	LIB (NMC, LTO)	DRC (63 %) Russia (7 %)	2.8(+)/6.8(+)	22 %
Copper	LIB (NMC, LFP, LTO)	Chile (28 %)	0.1(-)/4.0(-)	55 %

<sup>20</sup> (+) is used for values that have increased from the 2020 assessment and (-) is used for values that have decreased. No sign indicates that the value is stable in the period.

<sup>21</sup> Recycling share of the total market demand.

<sup>22</sup> Based on Prussian White technologies.

		Peru (12 %)		
<b>Graphite</b>	LIB (NMC, LFP, LTO), VRFB	China (67 %) Brazil (8 %)	1.8(-)/3.4(+)	3 %
<b>Lithium</b>	LIB (NMC, LFP, LTO)	China (56 %) Chile (32 %)	1.9(+)/3.9(+)	0 %
<b>Manganese</b>	LIB (NMC, LFP, LTO), SIB	South Afrika (29 %) Australia (16 %)	1.2(+)/6.9(+)	9 %
<b>Nickel</b>	LIB (NMC, LTO)	China (33%) Indonesia (12%)	0.5/5.7(+)	16 %
<b>Vanadium</b>	VRFB	China (62 %) Russia (20 %)	2.3(+)/3.9(-)	1 %

### Research and development perspectives

Development is currently focusing on addressing a few key challenges

1. Lower LCOS
2. Development of new cell technology such as solid state and metal-based anodes
3. Increased sustainability
4. Increased safety

Lowering the LCOS has been done by either increasing the lifetime of the battery to spread the large capex cost over more cycles or a longer period. Or by lowering the CAPEX cost with improved production technologies such as dry coating of the electrodes. Eliminating the need for drying and solvent recovery. These technologies are currently near adoption with a maturity level in category 2. [15]

There are several promising materials that can provide a significantly higher capacity compared to current technology. Some of the most promising materials were Lithium sulfur, silicon and solid-state materials. Sulfur and silicon-based material have been in commercialization by companies such as Oxis and Amprius respectively, promising capacities up to 500 *Wh/kg* and 1,300 *Wh/L* with charge times below 6 minutes. [16] [17] However, Oxis has since filed for bankruptcy. Solid state technologies or semi solid-state technologies are also entering the commercialization state and have been announced by several companies such as 24M claiming to be able to make battery packs that can provide ranges in EV of up to 1,600 *km* per charge and costs down to 80 *US\$/kWh* [18]. The solid-state technology also reduces or eliminates the use of flammable electrolyte reducing the safety risk associated with the cells. However, more needs to be studied on the safety of solid-state technologies before the risk associated with the technology is fully known. While these technologies all are at a maturity level in category 2, they have yet to meet the pricing requirements to compete with existing technologies.

### Examples of market standard technology

Grid-scale turn-key LIB systems are commercially available from a wide range of suppliers. Referenced examples are shown in Table 6.

## 180 Lithium-ion Batteries for Grid-Scale Storage

Two larger grid-connected LIB systems are installed in Denmark:

- In Nordhavn, Copenhagen, Denmark a 630 kW and 460 kWh was installed by ABB for Radius Elnet and Ørsted in 2017. This set the scene for Ørsted's first steps into commercial battery storage. For Ørsted the following energy storage projects are under development: a 20 MW battery storage near Liverpool in the UK and a 1 MW storage pilot project in Taiwan [37].
- Lem Kær Wind Farm was Vesta's pilot project for 400 kW and 100 kWh energy storage, which participates in the DK frequency regulation market. Vestas is working on Kennedy Power Plant that integrates wind and solar with grid-scale energy storage and will feature a 2,000 kW and 4,000 kWh grid-scale LIB storage system to provide ancillary services, test energy arbitrage and reduce curtailment.

Global examples:

- Globally the three largest grid-scale LIB storage systems are the Moss Landing BESS operated by Vistra energy of 750 MW and 3,000 MWh with plans to expand to 1,500 MW and 6,000 MWh [19], the Mira Loma Substation in California which features 20 MW and 80 MWh using 400 Tesla Powerpack 2 [38,39] and the Neoen's Hornsdale Wind Farm which features 100 MW and 129 MWh [40], both systems provide peak shaving.
- The Laurel Mountain, West Virginia, USA grid-scale LIB storage system at 32 MW and 8 MWh [41] is designed for frequency regulation and with high power to energy ratio compared to the Tesla grid-scale LIB storage systems, which are designed for peak shaving with a lower power to energy ratio.

**Table 9** Example of market standard technology for grid-connected LIB systems.

Technical provider	Location	Year	Capacity	Primary usage	Ref.
ElectraNet	Dalrymple substation in South Australia	2019	30 MW / 8 MWh	Frequency control plus inertia short-circuit power Renewable energy integration Wholesale arbitrage Black start Voltage regulation	[20]
Vistra energy	Moss Landing, California	2020	750 MW / 3000 MWh	Co-location with gas fuel power plant	[19]
Xolta	Samsø Denmark	2019	80kW/ 240 kWh	Renewable energy integration	[21]
EWII	Bornholm Denmark	2024	30 MW/ 43 MWh	Island mode Frequency regulation Renewable energy integration	[22]

### Prediction of performance and costs

#### CAPEX

The projection of the capital cost for a 1.5 MW and 3 MWh lithium-ion battery energy storage system (LI-BESS) is shown in Figure 7. This cost is divided into the following elements:

- Battery cells
- Packaging of the cells into battery packs with a Battery Management System (BMS)
- Procurement of battery packs in racks within containers, which includes thermal management systems (TMS) and a fire suppression system (FSS)
- Labour for installation and assembly
- Balance of System (BOS), which includes wiring and electrical support equipment
- Power Conversion System (PCS), which converts bidirectionally between the DC current for the battery system and the AC current for the grid
- Cost of connecting the BESS to the grid, which includes a transformer
- Cost of Engineering, Procurement, and Construction (EPC), which encompasses site-specific engineering work, procurement of materials and construction equipment, as well as siting, installation, and commissioning of the BESS.

The cell- and pack-cost are projected from a learning curve based on recent industry average LIB pack cost forecast from BloombergNEF's annual battery price survey from 2023 [23], shown in Figure 15, and on recent historical demand data from IEA [24], shown in Figure 16. The resulting learning rates are 15% on the battery cells and 23% on the battery packs, shown in Table 10. It is assumed that the production capacity of Li-ion batteries will follow the forecast in demand, which drives the cost reduction from the learning curve.

The forecast of demand to 2040 based on [25, 26, 27, 28, 29], and the growth in yearly demand and the corresponding cell- and pack-cost from the learning rate is shown in

Table 11. It is mainly driven by a demand for batteries in electric mobility and is projected to increase ten-fold between now and 2050. The growth in demand from 2040 to 2050 is assumed to be half the growth from 2035 to 2040. Here, the rate of growth is assumed to slow down because of competition with post-LIB or new battery technologies, and not because of a decrease in demand for energy storage. In 2023, the combined battery cell and pack prices are about 139 \$<sub>2023</sub>/kWh or 109 €<sub>2020</sub>/kWh (see conversion factors in Table 14), which falls to about 94 €<sub>2020</sub>/kWh in 2025 and 59 €<sub>2020</sub>/kWh in 2050.

The battery cells correspond to about a fourth or third of the total capital cost. The battery cell cost follows a learning curve that is mainly driven by the market of electric vehicles, since it can be the same cells that are used in both transport and storage applications. The remaining cost components are somewhat more specific to the energy storage system (ESS). Here it is assumed that the learning curve of the other cost elements follows the projected demand for BESS in general, projected by BNEF [30]. The demand profile is shown in Table 12, and the cost and assumed learning rates of the cost elements related to the ESS, is shown in Table 13.

# 180 Lithium-ion Batteries for Grid-Scale Storage

Figure 14 Projection of capital cost element of a 1.5 MW/3.0 MWh LI-BESS.<sup>23</sup>


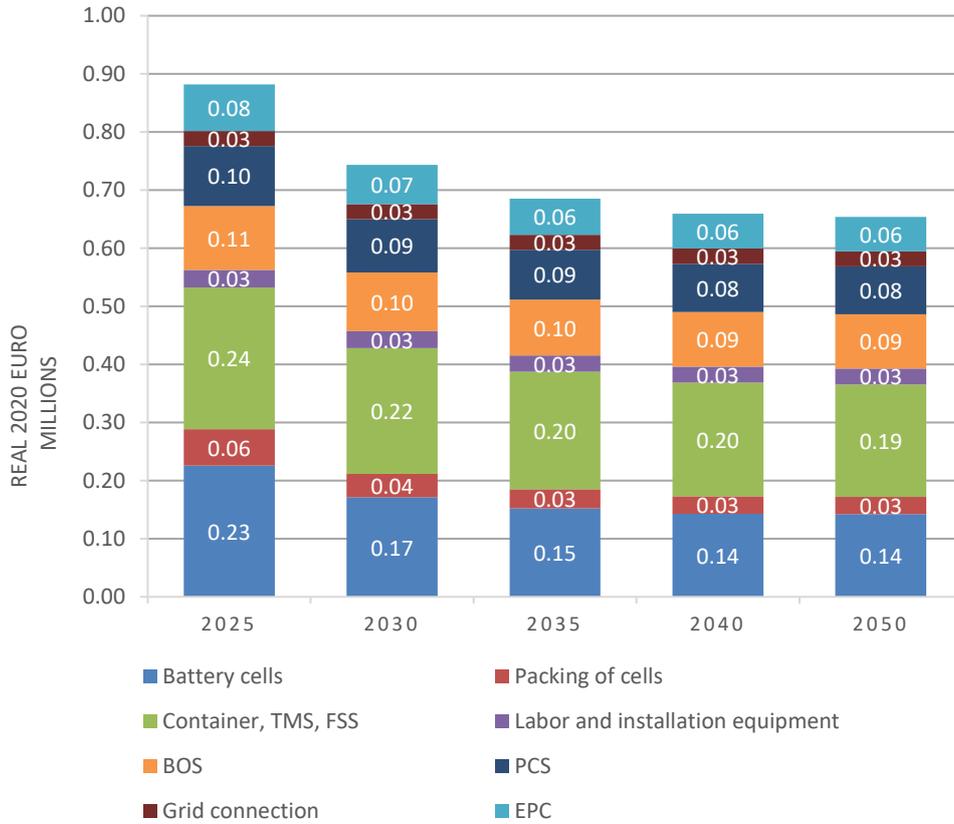



Figure 15 Historical Lithium-ion battery cell and pack cost [23].

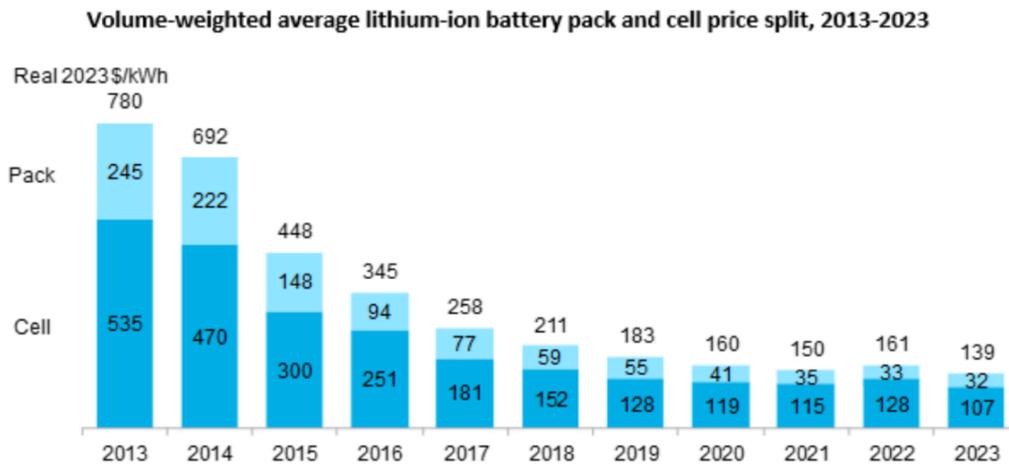

Source: BloombergNEF. Historical prices have been updated to reflect real 2023 dollars. Weighted average survey value includes 303 data points from passenger cars, buses, commercial vehicles, and stationary storage.

<sup>23</sup> The ratio of the cost elements depends on the energy to power ratio of the BESS.

**Figure 16** Historical volumes of Lithium-ion battery packs in use in the global energy sector [24].

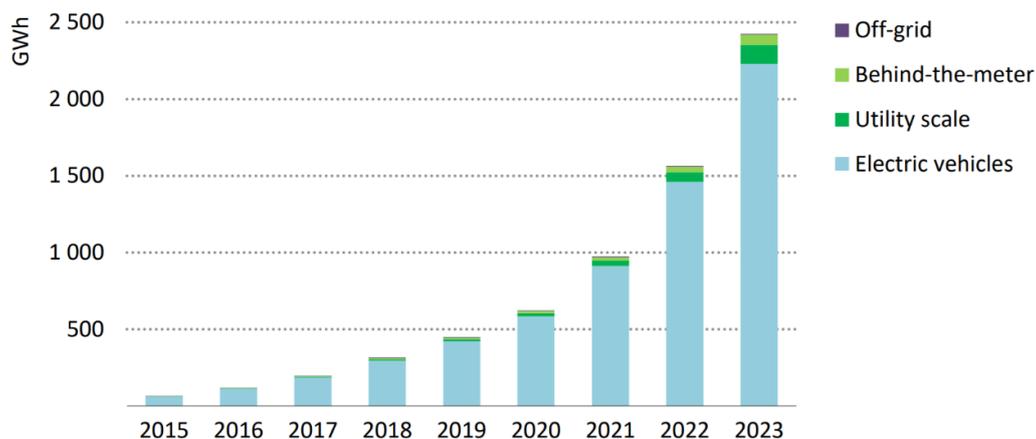

IEA. CC BY 4.0.

**Table 10** Costs and learning rates of Li-ion battery cells and packs. Pack cost includes the battery management system.

Cost element	Cost in 2023 (Million Euro2020 / MWh)	Learning rate <sup>24</sup>	Source
Cell	0,084	15%	[23, 24]
Pack	0,025	23%	[23, 24]

**Table 11** Assumed demand profile for LIB cells and projected costs.<sup>25</sup>

	2023	2025	2030	2035	2040	2050
Yearly demand compared to 2023	100%	165%	530%	880%	1150%	1175%
Projected Cell Cost (MEUR 2020/MWh)	0,084	0,077	0,057	0,05	0,04	0,04
Projected Pack Cost (MEUR 2020/MWh)	0,025	0,023	0,013	0,01	0,01	0,01

<sup>24</sup> Learning rate determined from regression of historical data.

<sup>25</sup> Li-ion packs 2025 forecast is based on [19, 20, 21, 22, 23], 2030 to 2050 is based on IEA [19], where 2050 corresponds to the high estimate for 2035, and 2040 found by interpolation. The demand is primarily in the electric vehicle sector. The growth in demand for LIBs is assumed to slow down from 2035 because of competition with post-LIB or new battery technologies, and not because of a decrease in demand for energy storage [23].

## 180 Lithium-ion Batteries for Grid-Scale Storage

**Table 12** Assumed demand profile for LI-BESS.<sup>26</sup>

	2023	2025	2030	2035	2040	2050
Yearly demand compared to 2023	100%	110%	240%	380%	470%	500%

**Table 13** Other cost elements of Li-ion battery energy storage systems.<sup>27</sup>

Cost element	Cost in 2025	Unit	Learning rate	Comment
Container, TMS and FSS	0,081	MEUR 2020/MWh	10 %	Cost derived from [31], LR from [32].
Labor and installation	0,010	MEUR 2020/MWh	5%	Cost derived from [31], LR from [32].
PCS	0,069	MEUR 2020/MW	10 %	Power conversion system and direct current (DC)-DC converter. Average between the sources. Cost derived from [31, 32, 33], LR from [32].
BOS	0,037	MEUR 2020/MWh	7%	Balance of system. Includes foundation and inverter house, conduit, wiring, dc cable, energy management system, switchgear and monitor and controls for each container. Cost derived from [31], LR from [32].
Grid Connection	0,017	MEUR 2020/MW	0%	Costs associated with connecting the ESS to the grid, including transformer cost, metering, and isolation breakers. Value corresponding to lower estimate of 10 MW-size BESS from [32].
EPC	10	%	0%	The cost of EPC is assumed to be 10 % of all other costs. Average value between [31, 32]. Includes engineering costs and construction equipment as well as sighting, installation, and commissioning of the BESS.

<sup>26</sup> Li-ion BESS demand forecast is based on projected growth in ESS from BNEF in 2018 [24]. The growth in demand for LIBESS is assumed to slow down from 2040 to 2050 because of competition with post-LIB or new battery technologies, and not because of a decrease in demand for energy storage [23].

<sup>27</sup> Cost reductions are assumed to follow demand in BESS shown in Table 12. All cost elements are reported in the real 2020 EUR. The inflation correction factors, and exchange rates, used in this work are shown in Table 14.

**Table 14** Inflation correction factors and exchange rates.<sup>28</sup>

X (year)	Inflation correction factor EUR X to EUR 2020	Exchange rate EUR X to USD X
2023	0,85	1,08
2022	0,90	1,05
2021	0,97	1,18
2020	1	1,14
2019	1,00	1,12
2018	1,01	1,18

### Impact of second life

The prediction described above is based on first life BESS systems which dominate the current market. However, second life systems have long promised to deliver a competitive alternative by using secondhand battery systems from the EV sector. However, this comes with significant disadvantages as listed below:

**Table 15** Advantages and disadvantages of second life applications.

Advantages	Disadvantages
Better utilization of resources	Uncertain remaining life
Potential for lower CAPEX	Unverified safety level
Reduced pressure on recycling streams	Increased LCOS
	Reduced performance

The main economic driver for second life is the lower CAPEX cost estimated to be reduced by 21 – 36% depending on the business model. [34] Despite the high advantage in the CAPEX reduction the system is also expected to have a higher cost of replacements and lower efficiency as the pack has already been used in other application. This is estimated to result in a mean LCOS increase for the system of 11 – 32% depending on the business model over a 15-year period. [34]

The long-term economic disadvantage of the second life BESS may be offset by the improved utilization of resources. However, this aspect is strongly dependent on the balance between demand and supply but may add competitive advantages to the second life systems if the technology can be effectively implemented. [35]

<sup>28</sup> Costs are corrected for inflation as following the European Harmonized Index of Consumer Prices (HICP), compiled by Eurostat, the statistical office of the European Union, and the national statistical institutes of EU Member States [28]. Inflation factors from year to year are calculated from average yearly changes on a monthly basis. Exchange rates are compiled from the yearly average of daily exchange rates from the European central bank [29].

OPEX

The operational expenditures are costs related to the operation and maintenance (O&M) of the BESS. This includes all costs necessary to keep the storage system operational throughout its life, such as planned maintenance, parts, and labor. This also includes major overhaul-related maintenance, such as refurbishment of power equipment. Some of these cost elements depend on energy throughput, variable O&M, and some occur at fixed time intervals, fixed O&M. In the literature, the variable O&M cost is often reported to be zero or near zero (around  $0 - 2.5 \text{ }_{2022}/kWh$  [36]), and here it is adopted to zero. This corresponds to allocating all operating costs to the fixed O&M, which implies a fixed use-pattern over the lifetime of the BESS. NREL reports a high estimate of yearly fixed O&M for a 4h BESS with one cycle per day over the calendar lifetime to be 2.5% of the  $\$/kW$  capital cost [36]. The high-estimate cost includes maintenance to counteract degradation such that the system will be able to perform at a rated capacity throughout its lifetime. If the battery is operating at a higher rate of cycling, then this fixed O&M value might not be sufficient to counteract degradation. Here it is assumed that for a battery system operating with a power-to-energy ratio of  $2 \text{ MW}/2 \text{ MWh}$  (a 30-minutes system), the yearly fixed O&M cost will be 5%. For systems in between, a linear interpolation is adopted between the two power-to-energy ratios. The fixed O&M is shown in Table 16, with an example cost calculation in 2025. The values are generally aligned with reported O&M values from [36] in the range of  $5 - 50 \text{ }_{2022}/kW * yr$ . The central estimate of O&M in the datasheet is 2.5%, as reported for an  $0.25 \text{ MW}/0.25 \text{ MWh}$  system.

Table 16 Fixed O&M as function of power-to-energy ratio of the BESS.<sup>29</sup>

Power-to-energy ratio (MW/MWh)	0.25	0,5	1	2
Yearly fixed O&M cost as a percentage of the $\$/kW$ capital cost	2,5%	2,9%	3,6%	5%
Projected cost in 2025 (2020EUR/kW/y)	7	8	10	14

Scaling with system size

As with most other modular technologies, there is an impact on price as customers purchase larger volumes. The capacity component cost receives a 10% price break for a tenfold increase in system size. Energy components receive a 5% price break for a tenfold increase in system size [32]. Table 17 shows the resulting cost elements of different system sizes projected for 2025.

<sup>29</sup> Fixed O&M cost is based on a 4h BESS from [30]. The O&M of a 1/2 h BESS is assumed twice the cost. From linear interpolation, the equation is:  $Fixed \text{ O\&M} = 1.43\% * P/E + 2.14\%$ , where  $P/E$  is the power-to-energy ratio in  $MW/MWh$ .

## 180 Lithium-ion Batteries for Grid-Scale Storage

**Table 17** Projected cost of energy and capacity components for a 2h system in 2025.


2h system, 2025	1-10 MW	10-100 MW	100-1000 MW
Energy component (Million Euro/MWh)	0,10	0,092	0,088
Energy component scaling factor	1	0,92	0,88
Capacity component (Million Euro /MW)	0,09	0,08	0,073
Capacity component scaling factor	1	0,89	0,81

### Uncertainty

The LIB price forecasts imply a broad range of uncertainties. If the learning rate is not 18% as estimated in Bloomberg’s New Energy Outlook 2018 [44], but rather 12 – 16% as estimated earlier [50], the forecasted price reductions will be smaller. Having a 12% learning rate, the 2050 price ends at 70 \$/kWh instead of 40 \$/kWh. With a 14% and 16% learning rate the 2050 price ends respectively at 60 \$/kWh and 50 \$/kWh.

As shown in Figure 17 Tesla/Panasonic seems 4 to 5 years ahead of the industry average cost per kWh. The figure also indicates differences in the forecasted cost reduction. The Tesla forecast indicates pack prices are as low as 50 \$/kWh already in 2025.

**Figure 17** Trend data for Tesla/Panasonic vs. Bloomberg’s forecasts for LIB pack cost [44,45].

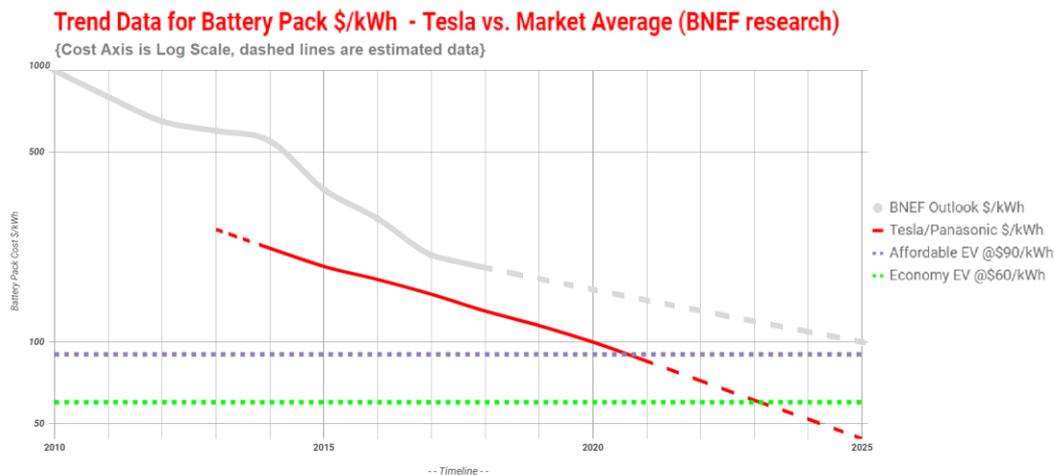

The spread in the current and predicted price shown in Figure 17 indicates a substantial uncertainty in the current and forecasted cost. The estimated 90% confidence interval is 170 – 80 \$/kWh in 2020 and for the 2050 LIB price is estimated to be 30 – 75 \$/kWh.

### Cost examples

The aim of this technology catalogue is to provide a brief insight into the technical aspects, current status, and forecasted price level of LIB BESS technology. In relation to this, and to help the reader obtain realistic prices indications, we provide two simple installation cost calculation examples below. One for frequency regulation in 2020 and one for energy integration in 2030. The examples are based on the data in the Data sheet. For simplicity neither O&M expenses nor interest rates are included in the calculations.

#### ***Frequency regulation in 2025: 4C-rate, 2 MWh BESS system. 20 years operation time.***

Cost items:

2 MWh “energy component”, year 2025 at 0.10 M€/MWh

2 MWh “other project costs”, year 2025 at 0.15 M€/MWh

8 MW PCS “capacity component”, year 2025 at 0.09 M€/MW

Scale factor of 1 for both capacity and energy

$$\text{CAPEX: } 2 * (0.10 \text{ M€} + 0.15 \text{ M€}) + 8 * 0.09 \text{ M€} = 1.22 \text{ M€}$$

#### ***Energy integration in 2030: ¼C-rate, 16 MWh BESS system. 25 years operation time.***

Cost items:

16 MWh “energy component”, year 2030 at 0.07 M€/MWh

16 MWh “other project costs”, year 2030 at 0.13 M€/MWh

Energy component scaling factor of 0.92

4 MW PCS “capacity component”, year 2035 at 0.09 M€/MW

$$\text{CAPEX: } 16 * 0.92 * (0.13 \text{ M€} + 0.07 \text{ M€}) + 4 * 0.09 \text{ M€} = 3.28 \text{ M€}$$

### References

- [1] ETN, »Vistra completes phase III expansion of Moss Landing Energy Storage Facility,« 2 August 2023. [Online]. Available: <https://etn.news/energy-storage/vistra-completes-phase-iii-expansion-of-moss-landing-energy-storage-facility>. [Senest hentet eller vist den 27 August 2024].
- [2] F. E. E. GmbH, »1,« Farasis Energy Europe GmbH, 12 11 2024. [Online]. Available: <https://www.farasis-energy.com/en/the-worlds-first-ev-powered-by-farasis-energys-sodium-ion-batteries-rolls-off-the-assembly-line/>.
- [3] Shutterstock., »Tesla 2170 battery cell stock photos,« 2024. [Online]. Available: <https://www.shutterstock.com/search/tesla-2170-battery-cell>.
- [4] Samsung SDI , »Smart Battery System for Energy Storage,« 2016. [Online]. Available: [https://www.samsungsdi.com/upload/ess\\_brochure/Samsung%20SDI%20brochure\\_EN.pdf](https://www.samsungsdi.com/upload/ess_brochure/Samsung%20SDI%20brochure_EN.pdf). [Senest hentet eller vist den 28 August 2024].
- [5] M. Kane, »LG Energy Solution Batteries Already Powers Over 1 Million BEVs,« INSIDEEVs, 18 August 2021. [Online]. Available: <https://insideevs.com/news/527006/lges-batteries-powers-million-bevs/>. [Senest hentet eller vist den 28 August 2024].
- [6] J. Tarascon og M. Armand, »Issues and challenges facing rechargeable lithium batteries,« *Nature*, årg. 414, p. 359–367, 2001.
- [7] DNV GL, »Safety, operation and performance of grid-connected energy storage systems,« 2017.
- [8] International Energy Agency (IEA), »Batteries and Secure Energy Transitions,« IEA, Paris, 2024.
- [9] H. Elzein, T. Dandres, A. Levasseur og R. Samson, »How can an optimized life cycle assessment method help evaluate the use phase of energy storage systems?,« *Journal of Cleaner Production*, årg. 209, pp. 1624-1636, 2019.
- [10] X. Han, Y. .: L. Li, X. Huang, Y. Deng, J. Yan, D.-S. Kourkoumpas og S. Karellas, »Comparative life cycle greenhouse gas emissions assessment of battery energy storage technologies for grid applications,« *Journal of Cleaner Production*, årg. 392, p. 136251, 2023.
- [11] T. L. Varlet, O. Schmidt, A. Gambhir, S. Few og I. Staffell, »Comparative life cycle assessment of lithium-ion battery chemistries for residential storage,« *Journal of Energy Storage*, årg. 28, p. 101230, 2020.
- [12] F. Maisel, C. Neef, F. Marscheider-Weidemann og N. F. Nissen, »A forecast on future raw material demand and recycling potential of lithium-ion batteries in electric vehicles,« *Resources, Conservation and Recycling*, årg. 192, p. 106920, 2023.
- [13] Trading Economics, 09 12 2024. [Online]. Available: <https://tradingeconomics.com/commodity/lithium>. [Senest hentet eller vist den 09 12 2024].
- [14] CIC Energi Gune, [Online]. Available: <https://cicenergigune.com/en/blog/impact-raw-material-price-decrease-battery-industry>. [Senest hentet eller vist den 09 12 2024].

- [15] S. L. Z. W. V. F. L. Z. Y. Yang Zhang, »Recent technology development in solvent-free electrode fabrication for lithium-ion batteries,« *Renewable and Sustainable Energy Reviews*, årg. 183, 2023.
- [16] Ambrius, »<https://amprius.com/products/>,« Ambrius. [Online]. [Senest hentet eller vist den 15 11 2024].
- [17] M. Kane, »<https://insideevs.com/news/509878/oxis-faces-bankruptcy/>,« insideEV. [Online]. [Senest hentet eller vist den 15 11 2024].
- [18] 24M, »<https://24-m.com/technology/>,« 24M. [Online]. [Senest hentet eller vist den 15 11 2024].
- [19] A. Colthorpe, »<https://www.energy-storage.news/moss-landing-worlds-biggest-battery-storage-project-is-now-3gwh-capacity/>,« Energy storage. news. [Online]. [Senest hentet eller vist den 15 11 2024].
- [20] ARENA, »Grid scale ESCRI battery charges up in South Australia,« 2019. [Online]. Available: <https://arena.gov.au/news/grid-scale-escrri-battery-charges-up-in-south-australia/>. [Senest hentet eller vist den 30 08 2024].
- [21] S. Project, »<https://h2020smile.eu/press-downloads/>,« [Online]. [Senest hentet eller vist den 11 20 2024].
- [22] »<https://www.ewii.dk/nyheder/ewii-udruller-satsning-med-flere-batterier/>,« EWII. [Online]. [Senest hentet eller vist den 20 11 2024].
- [23] BloombergNEF, »Lithium-Ion Battery Pack Prices Hit Record Low of \$139/kWh,« 26 November 2023. [Online]. Available: <https://about.bnef.com/blog/lithium-ion-battery-pack-prices-hit-record-low-of-139-kwh/>. [Senest hentet eller vist den 19 August 2024].
- [24] IEA, »Batteries and Secure Energy Transitions,« IEA, Paris, 2024.
- [25] IEA, »Global EV Outlook 2024,« IEA, Paris, 2024.
- [26] McKinsey & Company, »Enabling renewable energy with battery energy storage systems,« 2 August 2023. [Online]. Available: <https://www.mckinsey.com/industries/automotive-and-assembly/our-insights/enabling-renewable-energy-with-battery-energy-storage-systems>. [Senest hentet eller vist den 19 August 2024].
- [27] Fraunhofer ISI, »Lithium-Ion Battery Roadmap – Industrialization Perspectives Toward 2030,« Fraunhofer Institute for Systems and Innovation Research ISI, Karlsruhe, 2023.
- [28] »Battery Monitor 2022,« PEM of RWTH Aachen University / Roland Berger GmbH, Aachen / Stuttgart, 2022.
- [29] F. Degen, M. Winter, D. Bendig og J. Tübke, »Energy consumption of current and future production of lithium-ion and post lithium-ion battery cells,« *Nature Energy*, årg. 8, nr. 11, pp. 1284-1295, 2023.

- [30] BloombergNEF, »Energy Storage is a \$620 Billion Investment Opportunity to 2040,« 6 November 2018. [Online]. Available: <https://about.bnef.com/blog/energy-storage-620-billion-investment-opportunity-2040/>. [Senest hentet eller vist den 20 August 2024].
- [31] V. Ramasamy, J. Zuboy, E. O'Shaughnessy, D. Feldman, J. Desai, M. Woodhouse, P. Basore og R. Margolis, »U.S. Solar Photovoltaic System and Energy Storage Cost Benchmarks, With Minimum Sustainable Price Analysis: Q1 2022.,« National Renewable Energy Laboratory, Golden, CO, 2022.
- [32] Pacific Northwest National Laboratory, »2022 Grid Energy Storage Technology Cost and Performance Assessment,« U.S. Department of Energy, 2022.
- [33] R. Benato, G. Bruno, F. Palone, R. Polito og M. Rebolini, »Large-Scale Electrochemical Energy Storage in High Voltage Grids: Overview of the Italian Experience,« *Energies*, årg. 10, nr. 1, p. 108, 2017.
- [34] A. K. H. A. Tobiah Steckel, »Applying levelized cost of storage methodology to utility-scale second-life lithium-ion battery energy storage systems,« *Applied Energy*, årg. 300, 2021.
- [35] D. M. J. M. H. M. R. F. M. S. H. S. a. N. M. E. Hossain, »A Comprehensive Review on Second-Life Batteries: Current State, Manufacturing Considerations, Applications, Impacts, Barriers & Potential Solutions, Business Strategies, and Policies,« *IEEE Access*, årg. 7, 2019.
- [36] W. Cole og A. Karmakar, »Cost Projections for Utility-Scale Battery Storage: 2023 Update,« National Renewable Energy Laboratory, Golden, CO, 2023.
- [37] Danish Energy Agency, "Energistyrelsen.dk," 22 05 2024. [Online]. Available: <https://ens.dk/>. [Accessed 22 05 2024].
- [38] DEA, Test, Cph: Danish Energy Agency, 2022.
- [39] H. C. Hesse, M. Schimpe, D. Kucevic and A. Jossen, "Lithium-Ion Battery Storage for the Grid—A Review of Stationary Battery Storage System Design Tailored for Applications in Modern Power Grids," *Energies*, vol. 10, no. 12, p. 2017, 2017.
- [40] European Central Bank, »Inflation and consumer prices,« Juli 2024. [Online]. Available: [https://www.ecb.europa.eu/stats/macroeconomic\\_and\\_sectoral/hicp/html/index.en.html](https://www.ecb.europa.eu/stats/macroeconomic_and_sectoral/hicp/html/index.en.html). [Senest hentet eller vist den 22 August 2024].
- [41] European Central bank, »Euro foreign exchange reference rates,« 21 August 2024. [Online]. Available: [https://www.ecb.europa.eu/stats/policy\\_and\\_exchange\\_rates/euro\\_reference\\_exchange\\_rates/html/index.en.html](https://www.ecb.europa.eu/stats/policy_and_exchange_rates/euro_reference_exchange_rates/html/index.en.html). [Senest hentet eller vist den 22 August 2024].
- [42] M. Kane, »BMW i3 Samsung SDI 94 Ah Battery Rated For 524,000 Miles,« INSIDEEVs, 28 May 2018. [Online]. Available: <https://insideevs.com/news/338067/bmw-i3-samsung-sdi-94-ah-battery-rated-for-524000-miles/>. [Senest hentet eller vist den 28 August 2024].

- [43] N. Maluf, »INSIDE THE BATTERY OF A NISSAN LEAF,« Qnovo, 8 July 2015. [Online]. Available: <https://www.qnovo.com/blogs/inside-the-battery-of-a-nissan-leaf>. [Senest hentet eller vist den 28 August 2024].
- [44] LG Chem, »CHANGE YOUR ENERGY CHARGE YOUR LIFE,« August 2018. [Online]. Available: [https://www.lgchem.com/upload/file/product/LGChem\\_Catalog\\_Global\\_2018.pdf](https://www.lgchem.com/upload/file/product/LGChem_Catalog_Global_2018.pdf). [Senest hentet eller vist den 28 August 2024].
- [45] Ambrius, »<https://amprius.com/products/>,« Ambrius. [Online]. [Senest hentet eller vist den 11 2024].
- [46] P. K. a. S. F. S. a. J. W. a. J. T. a. A. H. a. R. C. K. a. A. Jossen, »Calendar Aging of Lithium-Ion Batteries,« *The Electrochemical Society*, årg. 163, p. A1872, 2016.

## 181 VANADIUM REDOX FLOW BATTERY

### Contact information

Danish Energy Agency:

Thomas Dahl, [thoda@ens.dk](mailto:thoda@ens.dk)

Emil Esketveit Rasmussen, [emrm@ens.dk](mailto:emrm@ens.dk)

Authors:

Anders Christian Solberg Jensen, [acje@teknologisk.dk](mailto:acje@teknologisk.dk), Danish Technological Institute

Gunnar Rohde, [groh@teknologisk.dk](mailto:groh@teknologisk.dk), Danish Technological Institute

Thomas Mandal Østergaard, [tmod@teknologisk.dk](mailto:tmod@teknologisk.dk), Danish Technological Institute

### Publication date

May 2025

### Amendments after publication date

---

Date	Description
22.05.2025	Update to text and data to reflect development


---

## Qualitative description

### Brief technology description

A *redox flow battery* (RFB), or simply flow battery, is a special type of secondary (i.e., rechargeable) batteries for electrical energy storage systems. A flow battery stores electrical energy in chemical compounds, whereby the reactants are present in dissolved form. These two reactants act as energy carriers and circulate in separate circuits, between which ion exchange takes place in galvanic cells consisting of two electrodes and a separating membrane. In these cells, the dissolved reactants are chemically reduced and oxidized<sup>30</sup> to either absorbing or releasing electrical energy in form of electrons. The electrolyte that is reduced (i.e., the reductant) at the negative electrode of the galvanic cells (i.e., the anode) is also referred to as *negolyte* or *anolyte*. The electrolyte that is oxidized (i.e., the oxidant) at the positive electrode of the galvanic cells (i.e., the cathode) is also referred to as *posolyte* or *catholyte*. A principal diagram of a general RFB is shown in Figure 18.

Figure 18 Principal diagram of a redox flow battery.

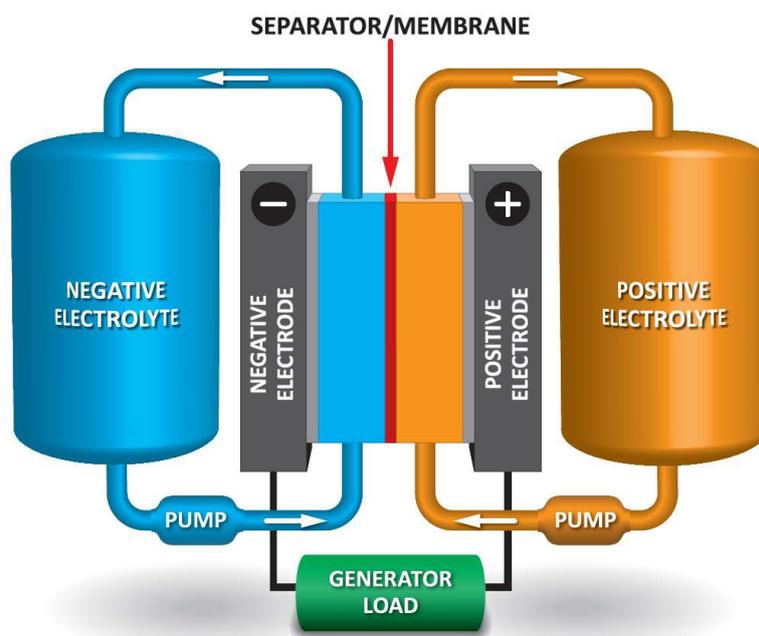


The number and sizes of the electrolyte tanks determine the energy capacity of an RFB, whereas the number and size of the galvanic cells determine its power capacity. Due to the possibility to scale their rated energy and power independently of each other, RFBs are today primarily used within stationary *electrical energy storage systems* (EESS) for short-term (< 6 hours) and medium-term storage periods (< 24 hours). Figure 19 illustrates the general architecture of an EESS with a redox flow-based battery system including the cell stack, two electrolyte tanks, necessary pipes and pumps as well as a *battery management system* (BMS). The

<sup>30</sup> The term *redox* originates from the electrochemical processes of reduction and oxidation.


remaining components of such a system can be directly related to other types of *battery energy storage systems* (BESS), for example, Lithium-based BESS in Chapter 180.

Figure 19 General architecture of a redox flow-based battery energy storage system (Modified from [1]).

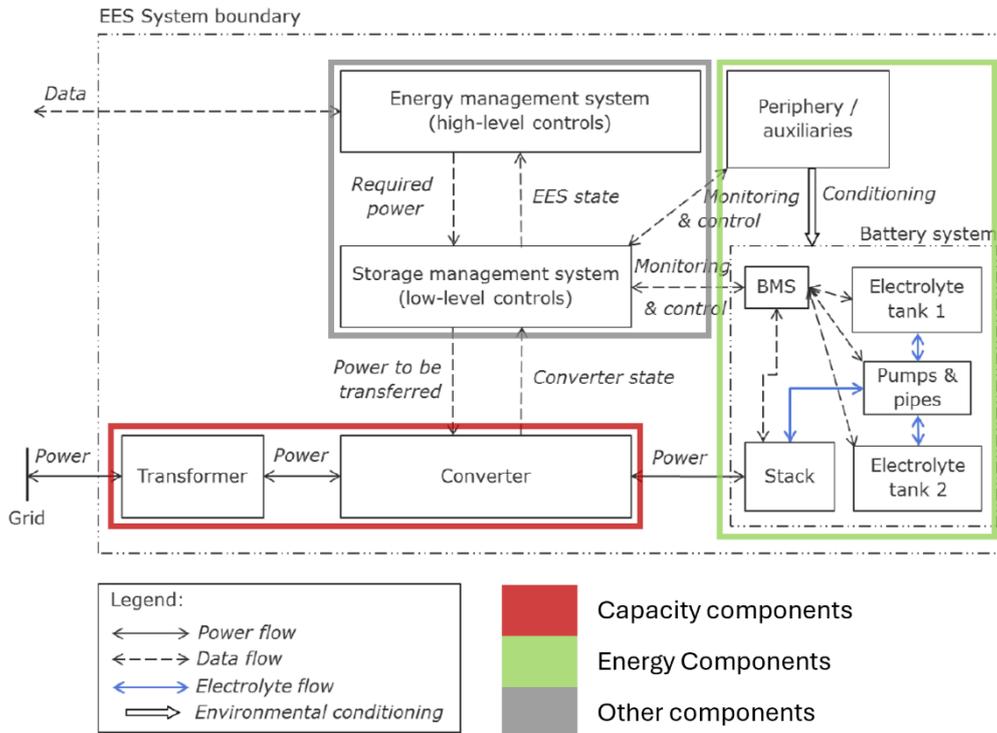

Vanadium redox flow batteries (VRFB), sometimes also known simply as *vanadium redox batteries* (VRB) or *vanadium flow batteries* (VFB), are currently both the most common and mature technical realizations of RFBs. A VRFB utilizes the ability of vanadium to adopt four different oxidation states in solutions, so that only one electroactive element is required for these RFBs instead of two as redox pairs of vanadium can be used for both electrolytes. The electrodes of VRFBs are made of carbon, the structure of which has a significant influence on the properties. The electrodes and the two electrolyte reservoirs are separated by a membrane that ideally only allows hydrogen ions to pass through. This makes the VRFB-technology ideal for exploiting in the cell stack (and for other subsystems) materials, components and processes originally developed for hydrogen fuel cells. Figure 20 shows the principal electrochemical reactions inside a VRFB.

VRFBs use redox pairs of vanadium in both half-cells of the cell stack. The posolyte reactive species contains vanadyl sulphate (i.e., vanadium(IV) oxide sulphate,  $VO_{SO_4}$ ), which can be oxidized to the pentavalent ion. The corresponding half-cell reaction at the cathode is:



where  $VO^{2+}$  is the oxovanadium(IV) cation vanadyl and  $VO_2^+$  is pervanadyl, an oxycation of vanadium(V). The negolyte reactive species contains vanadium(III) sulphate (i.e.,  $V_2(SO_4)_3$ ), which can be reduced to the bivalent vanadium salt. The corresponding half-cell reaction at the anode is:






Figure 20 Principal electrochemical reactions inside a vanadium redox flow battery [2].

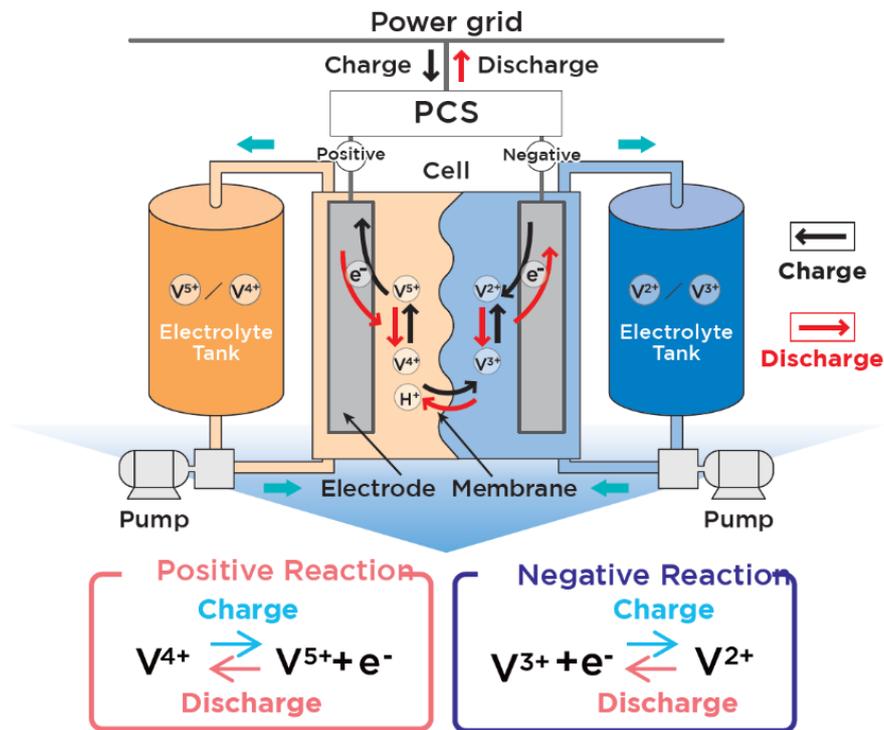

Hence, the full-cell reaction is:




and provides a cell voltage of 1.25 V at standard environmental conditions. The source voltage per cell (voltage without load) is between 1.15 V and 1.55 V. At 25°C it is 1.41 V. Traditionally, the reactive species have been dissolved with concentrations of 1.5 – 2 M in aqueous sulfuric acid solutions with an acid concentration of 2 – 5 M [2].

VRFBs have lower energy density of approximately 15 Wh/l to 35 Wh/l of liquid electrolyte, compared to lithium-ion batteries. The energy density by mass is therefore between 20 Wh/kg and 32 Wh/kg electrolyte [2].

As with all redox flow batteries, one of the main advantages of the vanadium redox accumulator is that, unlike conventional secondary cells, the power and capacity are independent of each other. The power can be regulated primarily by the electrode surface, the storage capacity by the amount of electrolyte. Full discharge to 0% state of charge (SoC) is also harmless. The modular and scalable design of a VRF-BESS is illustrated in Figure 21. Further advantages of VTFBs include cycle stability and ‘charging’ via electrolyte exchange. According to a study from 2016 [3], such a battery completed over 200,000 charge/discharge cycles within a three-year test.


The main disadvantage of vanadium redox accumulator technology, in addition to the poor volume-energy storage ratio, is the more complicated overall structure compared to conventional accumulators, which also includes pumps and storage tanks.

Figure 21 Illustrations of the modular and scalable nature of VRFBs (©Sumitomo Electric, 2019).

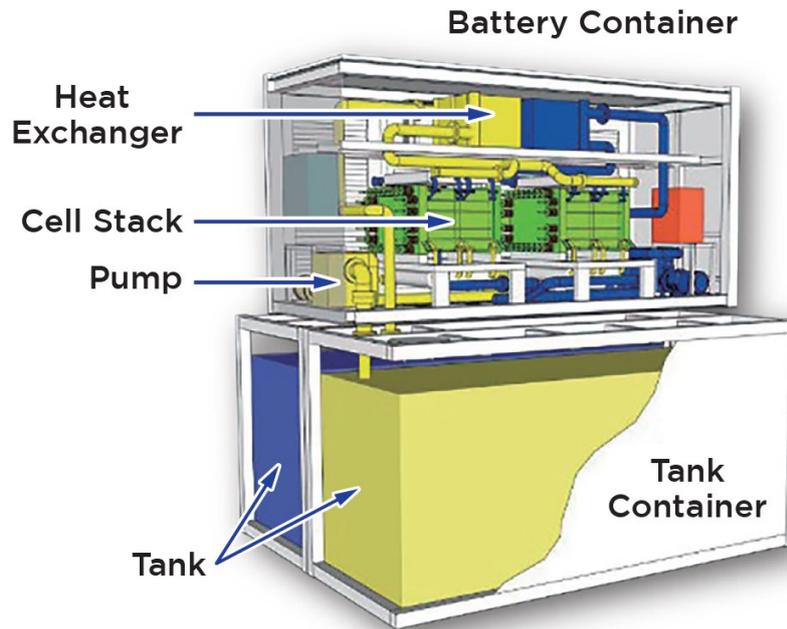

When pumped into the reaction cell the anolyte and catholyte will be separated by a proton conducting (polymer) membrane. An illustration of reaction cell components and a full reaction stack can be seen in Figure 22.


Figure 22 Illustration of a single cell, a cell stack and the respective cell stacking for a VRFB (©Sumitomo Electric, 2019).

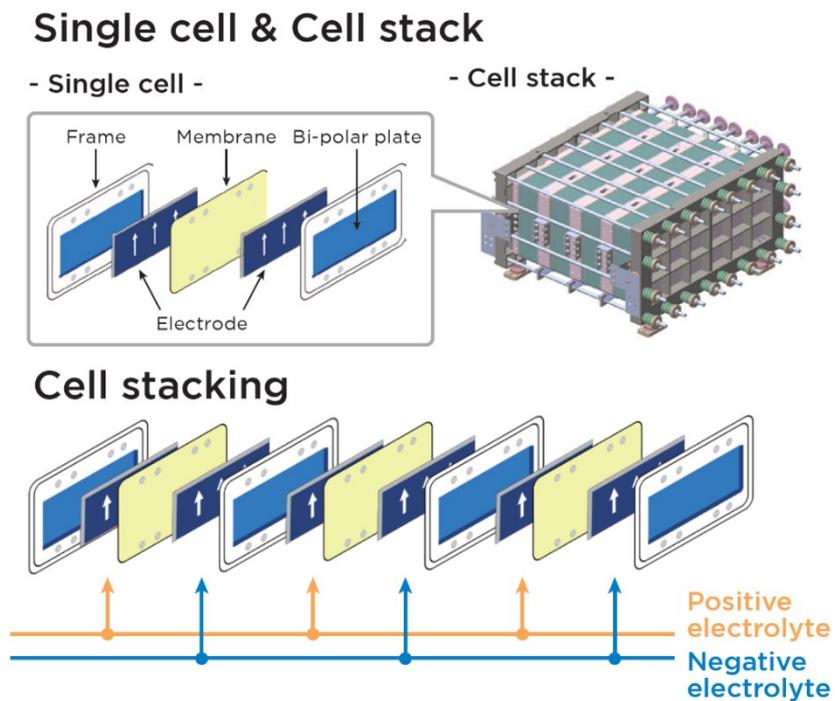

**Input/output**

As is common for BESS, the primary input as well as output of VRFBs is electrical energy. Electrical energy is converted electrochemically into chemical energy during charge and converted back to electrical energy during discharge in the reaction process described above. Figure 23 illustrates energy conversion of both input and output energy in a VRFB.

**Figure 23** Illustrations of the energy conversion processes in a VRFB during discharging (a) and charging (b).

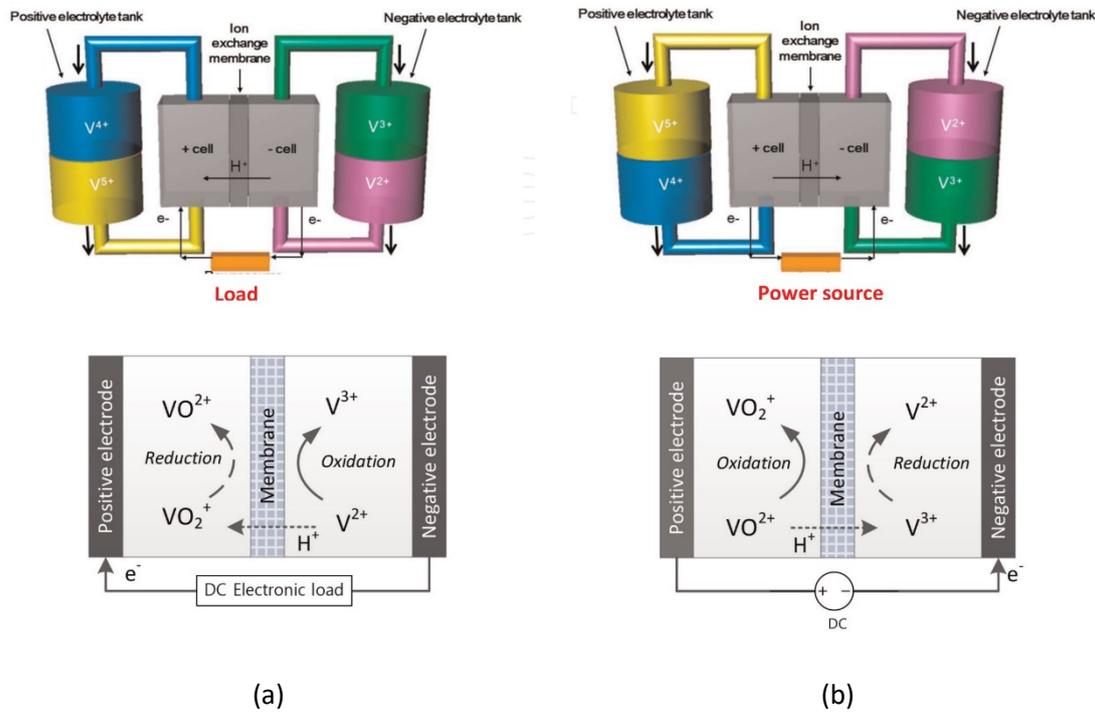

The cell stacks of VRFBs operate typically with *direct current* (DC). When operated with *alternating current* (AC) as input/output power, this must be converted accordingly by appropriate power electronics (cp. Figure 19).

Secondary input or output power in the form of thermal energy can generally be neglected for VRFBs. Due to their operating temperatures being close to average ambient temperature, waste heat of VRFBs is not of high value. At the same time, most VRFBs do not require auxiliary cooling for the cell stacks due to the large thermal mass of the electrolyte itself [2].

**Energy efficiency and losses**

Like all other energy conversion technologies, certain loss mechanisms also occur with the practical operation of VRFBs. The losses in VRFBs can be divided into operational losses and standby losses. The total energy efficiency is a combination of these effects.

**Operational losses**

The operational losses of a VRF-BESS comprise all the losses that occur during charging and discharging.

Voltage efficiency is the ratio of average discharge voltage to the average charge voltage. In VRFBs, voltage efficiency typically ranges from 75% to 90%. This efficiency is affected by factors such as internal cell resistance and overpotentials during operation. Coulombic efficiency is the ratio of the total charge discharged to the total charge initially charged. VRFBs generally have high Coulombic efficiencies, often exceeding 95%, because the vanadium ions do not cross-contaminate between the two half-cells which minimizes side reactions. Energy efficiency is the product of voltage efficiency and Coulombic efficiency. It represents the overall efficiency of a battery in converting the input electrical energy into electrical energy stored and back into electrical energy. For VRFBs, energy efficiency typically ranges from 70% to 85%.

In practice, the use of electric pumps and valves in the VRF battery system results in additional losses due to the consumption of these peripherals. Added to this are the peripheral consumptions of communication, controls and other central subsystems. These losses add up to below 2% during operation. Furthermore, the central power electronics are designed with rated efficiencies typically rated around 95% which results in additional losses during operating VRF-BESS.

The overall roundtrip efficiency of a complete VRF-BESS can be expected to be in the range between 75% and 90% on the DC-side alone. The respective losses of between 10% and 25% are released in the form of thermal energy.

### **Standby losses**

The standby losses of a VRF-BESS comprise all the losses that occur in periods when not operated (i.e., neither charging nor discharging).

Electrolyte left in the cell stack after operation will self-discharge during idle/standby due to diffusion of vanadium ions across the membrane separating the two half-cells. These losses are comparatively low for VRFBs, often between 1% and 3% per day, and affect only the amount of electrolyte within the cell stacks. Small volumes and/or closing valves close to the input/output of the cell stacks can minimize the losses.

Any standby consumption of other subsystems and peripherals of a VRF-BESS (e.g., communication and controls) can be considered additional losses. The losses are typically below 1% per day.

### **Regulation ability and other system services**


The response time is an important characteristic that determines how fast a battery can respond to changes in load demand during discharging or input power during charging. VRFBs are known for their relatively fast response times below 100 *ms* if electrolyte is already present within the cell stack, below 1 *s* if the electrolyte must first be pumped into the cell stack (idle/standby), and below 1 *min* if the whole VRF-BESS is shut down.

This fast response time, together with low self-discharge and a high number of lifetime cycles, allow VRFBs to be both effectively and efficiently exploited for most grid-scale applications of EESS. Table 18 and Figure 24 collect possible applications for grid-connected VRF-BESS.

Table 18 Possible applications for grid-connected BESS.

Services	Notes	Location
Frequency regulation	Frequency services are supplied in a fixed timeframe where the system must react to changes in the grid frequency. The service price is based on power available from the system.	Front-of-the-meter
Peak shaving	Peak shaving is designed to minimize the peak power drawn from the local user or provide additional power during peaks hours on utility scale.	Front-of-the-meter
Energy arbitrage	Energy arbitrage exploits price differences by buying energy when prices are low and selling when they are high.	Front-of-the-meter
Black start	Due to grid forming technology in the inverter systems a BESS may be used to initiate the grid after a blackout. However not all inverters are designed for black start applications	all
Voltage support	Smaller BESS system may be placed in weak parts of the grid to provide or draw reactive power to influence the local voltage.	all
Optimized self-consumption	For both large- and small-scale wind or solar power production a BESS may be used to avoid sending surplus energy to the grid when marked prices are unfavorable. The energy can then be used locally or sold to the grid once prices are favorable.	Behind-the-meter

Figure 24 BESS applications along the dimensions of the power grid; horizontal axis shows the location; vertical axis shows the service (©IEA, 2024).

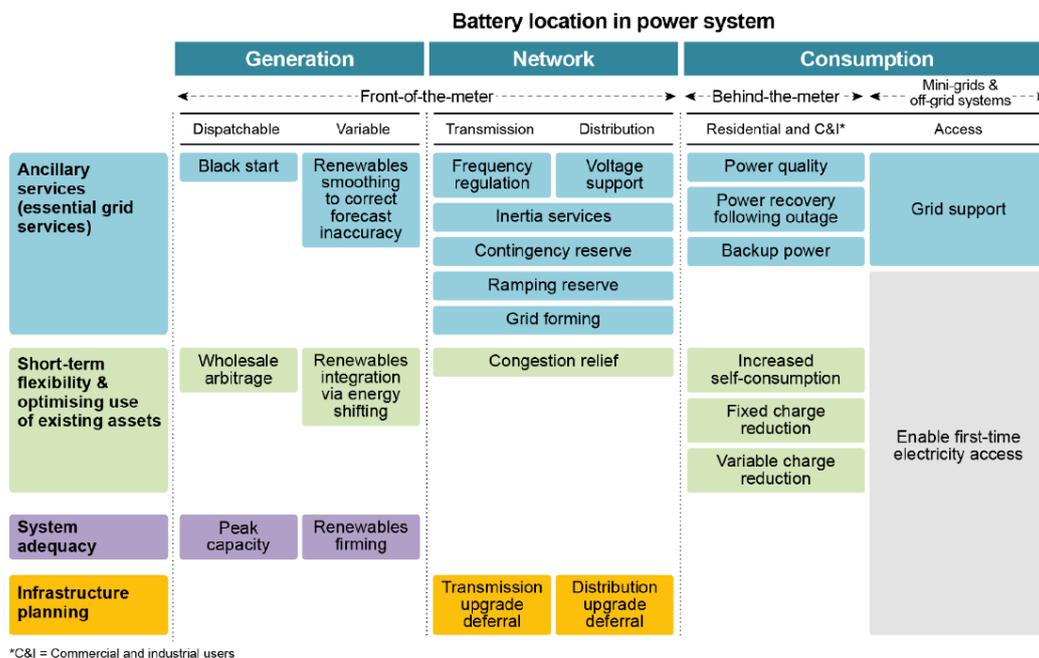

Most possible applications for BESS primarily place demand on the central power electronics, as these ensure the connection to the grid. However, the BMS is responsible for ensuring that the actual battery system can follow the power electronics. This is typically ensured in the design phase of the BESS. With the help of an

## 181 Vanadium Redox Flow Battery

appropriate BMS, VRFBs can deliver up to 1.5 times their rated nominal power for shorter periods (as long as membranes in the stacks are not overheated).

### Typical characteristics and capacities

Examples of recently commissioned grid-scale VRB installations are listed Table 19.

**Table 19** Selective list of the largest VRF-BESS installations worldwide.


Name	Commission Date	Energy (MWh)	Power (MW)	Discharge (Hours)	Country
Minami Hayakita Substation	December 2015	60	15	4	Japan
Pfintzal, Baden-Württemberg	September 2019	20	2	10	Germany
Woniushi, Liaoning		10	5	2	China
Tomamae Wind Farm	2005	6	4	1.5	Japan
Zhangbei Project	2016	8	2	4	China
SnoPUD MESA 2 Project	March 2017	8	2	4	USA
San Miguel Substation	2017	8	2	4	USA
Pullman Washington	April 2015	4	1	4	USA
Dalian Battery	October 2022	400 (800)	100 (200)	4	China

### Typical storage period

The typical energy storage period for BESS depends on both their application, design, and operation. The storage period for VRFBs is principally not limited as their modular nature and scalability allow for flexible deployment to meet the needs of different applications. It ranges from minutes for grid services to weeks for energy storage.

Due to their low self-discharge, minimal degradation, and the favorable *levelized cost of storage* (LCOS) for high energy/power-ratios, VRF-BESS have general benefits for storage periods larger than that for Li-BESS. Figure 25 illustrates typical storage periods for VRF-BESS.

Figure 25 Illustration of typical storage periods for VRF-BESS (©Sumitomo Electric, 2019).

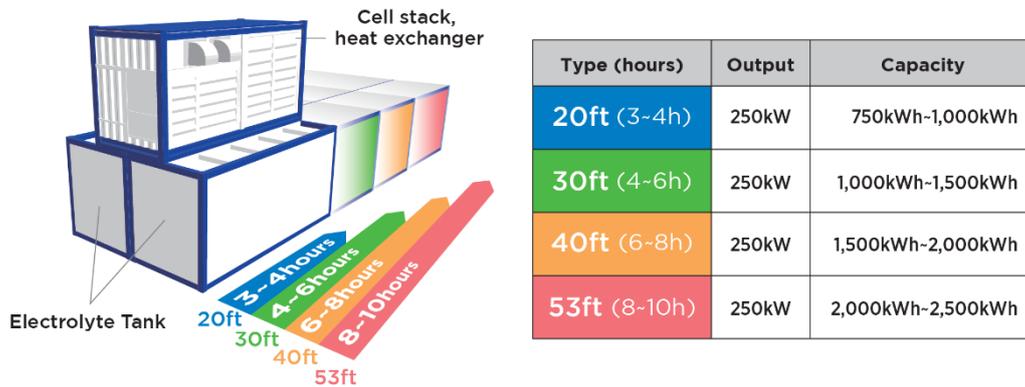


**Space requirement**

Due to their modular nature and scalability, the space requirement for VRF-BESS strongly depends on individual boundary conditions. From actual VRF-BESS in operation land use between 17 m<sup>2</sup>/MWh and 140 m<sup>2</sup>/MWh is reported [4].

A reasonable average value for space requirement for a VRF-BESS results from a modular design based on standard ISO containers as shown in Figure 26. This results in land use between 45 m<sup>2</sup>/MWh and 65 m<sup>2</sup>/MWh, with lower values for higher energy/power ratios.

Figure 26 Illustration of typical land use for VRF-BESS (©Sumitomo Electric, 2019).

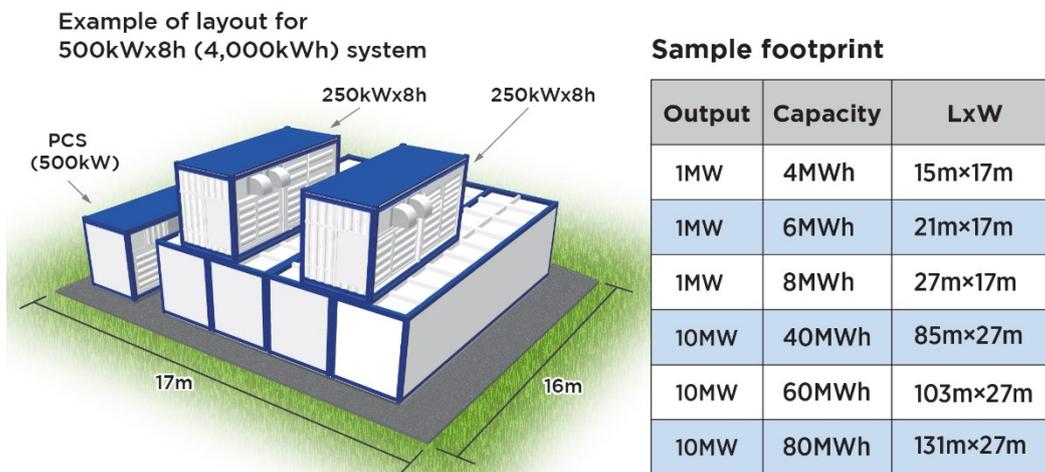

### Advantages/disadvantages

General advantages and disadvantages of VRFBs in comparison to other EESS technologies are listed in Table 20.

**Table 20** General advantages and disadvantages of VRFBs.

Advantages	Disadvantages
Energy and power capacity can be scaled independently of each other	Heavy weight of electrolyte solution
High tolerances for deep discharge	Toxicity of vanadium compounds
Mixing electrolytes causes no damage	Noble materials in cell stack
Single charge state across the electrolyte avoids capacity degradation	Extra active peripherals in the form pumps and valves
Non-flammable and non-explosive aqueous electrolyte	Relatively low energy density (compared to LiB)
Low noise and emissions during operation	Relatively poor roundtrip efficiency (compared to LiB)
Energy and power capacity upgradeable during the whole lifetime	Small operating temperature range (~5 °C to 50 °C)
Passive cooling possible	
High lifetime cycles (> 20.000)	
High lifetime (> 20 years)	
Low LCOS (~ 0.05 €/kWh)	

### Environment

The environmental footprint of VRF-BESS can be considered in the range of between  $160 \text{ kg}_{CO_2eq}/kWh$  and  $190 \text{ kg}_{CO_2eq}/kWh$  (with a median at about  $180 \text{ kg}_{CO_2eq}/kWh$ ), due to the energy-intense production of  $V_2SO_5$  and low production volumes but should be compensated during normal operation by a high lifetime and cycle number. This is considerably higher than the average environmental footprint of about  $105 \text{ kg}_{CO_2eq}/kWh$  for LIB-BESS, but here the range spans between  $80 \text{ kg}_{CO_2eq}/kWh$  and  $230 \text{ kg}_{CO_2eq}/kWh$ . The majority of the components and materials used in a VRF-BESS can be recycled, including the electrolyte which is often directly reused. [8]

Nevertheless, vanadium ions might pose environmental risks that are not fully determined yet [2] and components of the cell stack might be highly acidic or alkaline at end of life, hence, to be treated as corrosive material during recycling and disposal [2].

### Research and development perspectives

The area of VRFB and RFB in general is under heavy development. This is due to the fact that electrical energy storage becomes more important as the penetration with renewable energy supply like wind and solar increases, requiring measures to integrate the fluctuating production of electricity into the grid.

The primary goal of research and development is currently to scale production of VRFBs to reduce LCOS by economy of scale. Here, similar scaling effects like LiB are expected [5].

More specifically, research and development focusses on the following aspects:

1. Electrolytes that are less energy-intensive (cheaper) to produce
2. Electrolytes that transfer more electron per molecule (higher energy density)
3. Electrolytes that operate stable in a wider temperature range
4. Non-aqueous, organic, and/or metallic electrolytes
5. Alternative materials to Nafion for the proton exchange membrane (cheaper, PFAS-free)
6. Catalysts to increase exchange current density (higher efficiency)
7. BMS to optimize oxygen generation at the electrodes

### Examples of market standard technology

Grid-scale VRF-BESS are commercially available from several companies and in operation in different countries. A non-exhaustive list of VRFB manufacturers can be found in Table 21. The market for VRFBs is different to that for LiB as large VRF-BESS are typically electrochemical process plants and therefore designed and installed by different industries.

**Table 21** Exemplary manufacturers of VRFBs.

Name	Origin	Link
VFlow Tech	Singapore	<a href="http://www.vflowtech.com">www.vflowtech.com</a>
VoltStorage	Germany	<a href="http://www.voltstorage.com">www.voltstorage.com</a>
VRB Energy	China	<a href="http://www.vrbenergy.com">www.vrbenergy.com</a>
UniEnergy Technologies	USA	<a href="http://www.uetechologies.com">www.uetechologies.com</a>
Ashlam Energy	USA	<a href="http://www.ashlamenergyllc.com">www.ashlamenergyllc.com</a>
NEXTracker	USA	<a href="http://www.nextracker.com">www.nextracker.com</a>
CellCube Energy Storage	Canada	<a href="http://www.cellcube.com">www.cellcube.com</a>
Delectrik Systems	India	<a href="http://www.delectrik.com">www.delectrik.com</a>
V Sun Energy	Australia	<a href="http://www.vsunenergy.com">www.vsunenergy.com</a>
Rongke Power	China	<a href="http://www.rongkepower.com">www.rongkepower.com</a>
VisBlue	Denmark	<a href="http://www.visblue.com">www.visblue.com</a>

## 181 Vanadium Redox Flow Battery

---

H2 Inc.	South Korea	<a href="http://www.h2aec.com">www.h2aec.com</a>
Green Energy Storage	Italy	<a href="http://www.greenenergystorage.com">www.greenenergystorage.com</a>
meeco (sun2live)	Switzerland	<a href="http://www.meeco.net">www.meeco.net</a>
Sumitomo Electric	Japan	<a href="http://www.globa-sei.com">www.globa-sei.com</a>
redT energy	Ireland	<a href="http://www.redtenergy.com">www.redtenergy.com</a>
Solibra energy Storage	Germany	<a href="http://www.vanadiumredoxflow.com">www.vanadiumredoxflow.com</a>

### Prediction of performance and costs

#### *Data for 2024*

Available data for 2024 states VRF-BESS costs between 450 k€/MWh and 960 k€/MWh (with a median around 600 k€/MWh) for CapEx and OpEx together for a system with energy/power ratio of about 2:1 [2, 6 – 7, 11 – 12].

#### *Assumptions for the period 2030 to 2050*


Depending on the actual economy of scale and the deployment of VRF-BESS, a cost reduction towards between 320 k€/MWh and 560 k€/MWh (with a median around 470 k€/MWh) for CapEx and OpEx together for a system with energy/power ratio of about 2:1 is expected for 2030 [5].

For price estimation in 2050, data is hardly available as it is expected that RFBs will then be based on alternative (unknown) electrolytes. Nevertheless, a target LCOS below 0.05 €/kWh is expected both from the DOE and the EU [7]. This would result into VRF-BESS cost as low as 320 k€/MWh for CapEx and OpEx together for a system with energy/power ratio of about 2:1.

#### *Learning curves and technological maturity*

The level of maturity for grid scale VRB is early “Category 3: Commercial technologies with moderate deployment”. Based on the current commercial situation with large market volatility it is difficult to establish general learning curves based on past installations. It has been attempted [6]. The reported uncertainties are, however, of a magnitude making the predicted price range 120 \$/kWh to 1,160 \$/kWh by 2040. The approach of IRENA [5], illustrated in Figure 27, is thus preferred for predictions.

Figure 27 Illustration of technology and application dependencies in the IRENA cost-of-service tool approach.

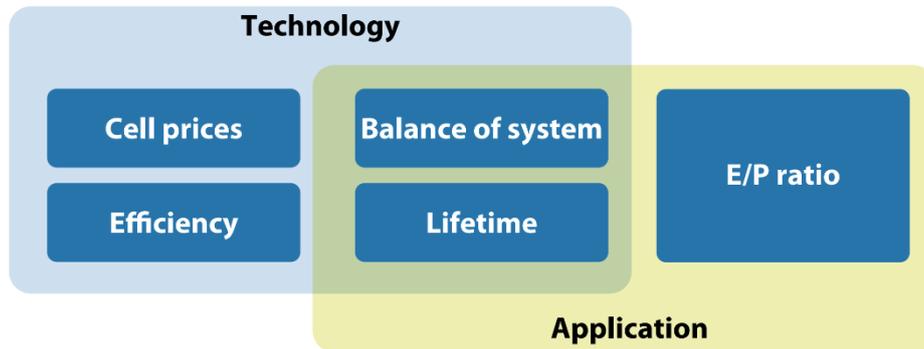


Source: International Renewable Energy Agency.  
 Note: E/P = electricity-to-power ratio

**Uncertainty**

Uncertainty in relation to VRFB, both current and for the future, is primarily in the financial data. For energy/power ratios higher than 4:1 and energy storage durations longer than about 8 hours, VRF-BESS should generally lead to lower LCOS compared to LI-BESS. This is due to the fact that adding extra capacity requires only extra electrolyte and power capacity is not automatically scaled accordingly. [2] In practice, however, VRF-BESS today have higher CapEx (sometimes even OpEx) and also demonstrate larger ecological footprints. This situation could be completely different if both technologies, VRF-BESS and LI-BESS, were at comparable levels of industrial commercialization and production. Since many aspects of industrial scaling are non-linear (e.g., exponential), predicting financial data for VRF-BESS beyond 2030 is therefore fairly uncertain (cp. Figure 28).

Figure 28 Possible development of demand for vanadium in relation to implementation of VRFBs [8].

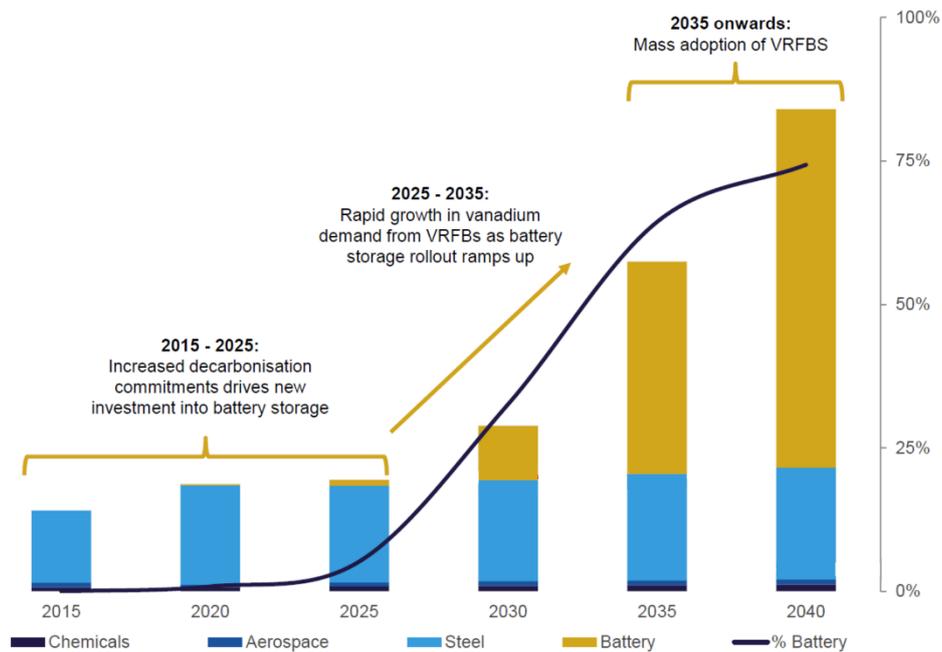

Predicting technology-specific data for VRF-BESS does not involve the same uncertainty. Vanadium compounds are well-understood chemicals in terms of both their behavior and handling. Hence, the energy

density or specific energy of VRF-BESS can only be improved in moderate ranges by certain additives to the electrolyte, optimized conditioning of the electrolyte, and improved tank structures. The power density or specific power of VRF-BESS is primarily dependent on the power density/specific power of the cell stacks. Since these stacks are relying on similar materials and technologies that is applied to fuel cells and electrolyzers with polymer-electrolyte-membrane assemblies, similar improvements can be expected for VRF-BESS.

### Cost examples

Cost examples for VRF-BESS are in the majority of cases customer-specific since no standardized products are being produced in significant volumes today. Research estimates cost for full VRF-BESS between 172 €/kWh and 339 €/kWh for application varying from kilowatts to megawatts [10]. Reverse engineering of shared expenditures for real grid-scale VRFB projects, however, suggest costs about between 450 k€/MWh and 560 k€/MWh.

### Additional remarks

Even though VRFBs and other RFBs have high commercial potential, rapid cost reduction of alternative storage solutions (e.g., LiB) might halter their commercial deployment and technological development. This can prevent VRB and other flow batteries from reaching full commercial potential.

On the other hand, the modularity and scalability of RFBs make them a promising candidate for stationary EESS for storage periods above 6 hours, especially with an electrolyte with low environmental impact over the whole value chain.

### References

- [1] DNVGL; Safety, operation and performance of grid-connected energy storage systems; Recommended Practice; DNVGL-RP-0043; Edition September 2017.
- [2] Maria Skyllas-Kazacos et. al.; Flow Batteries: From Fundamentals to Applications; 2023; DOI:10.1002/9783527832767
- [3] Maria Skyllas-Kazacos et. al.; Modelling and simulation of thermal behavior of vanadium redox flow battery; 2016; DOI: 10.1016/j.jpowsour.2016.05.011
- [4] Sumitomo RFB LDES Brochure 07/2024; [https://sumitomoelectric.com/sites/default/files/2024-09/download\\_documents/RFB\\_Catalog\\_EN%EF%BC%88A4%EF%BC%89\\_202407.pdf](https://sumitomoelectric.com/sites/default/files/2024-09/download_documents/RFB_Catalog_EN%EF%BC%88A4%EF%BC%89_202407.pdf) [Accessed: October 2024]
- [5] IRENA, “Electricity storage and renewables: Costs and markets to 2030 - Cost-of-service tool. Version 1.0,” 2017.
- [6] Internal database at the Danish Technological Institute, based on existing realized VRFB projects.
- [7] “DOE Global Energy Storage Database.” [Online]. Available: <https://www.energystorageexchange.org/>. [Accessed: 29-Mar-2017].
- [8] Michaux, S. P. (2021): Assessment of the Extra Capacity Required of Alternative Energy Electrical Power Systems to Completely Replace Fossil Fuels, GTK Open Work File internal report, Serial number 42/2021, ISBN 978-952-217-414-7, [https://tupa.gtk.fi/raportti/arkisto/42\\_2021.pdf](https://tupa.gtk.fi/raportti/arkisto/42_2021.pdf)
- [9] Vanadium for a cleaner future; Technology Metals Australia Limited; February 2023; <https://api.investi.com.au/api/announcements/tmt/68af872f-66b.pdf> [Accessed: 08-Dec-2024]
- [10] L. Tang, P. Leung, M.R. Mohamed, Q. Xu, S. Dai, X. Zhu, C. Flox, A.A. Shah, Q. Liao, Capital cost evaluation of conventional and emerging redox flow batteries for grid storage applications, *Electrochimica Acta*, Volume 437, 2023, 141460, ISSN 0013-4686, <https://doi.org/10.1016/j.electacta.2022.141460>.
- [11] K.-P. Kairies, “Battery storage technology improvements and cost reductions to 2030: A Deep Dive,” Int. Renew. Energy Agency Work., 2017.
- [12] The Storage Future Study (SFS) by the National Renewable Energy Laboratory (NREL); <https://www.nrel.gov/analysis/storage-futures.html> [Accessed: January 2025]

## 182 NA-S BATTERY

### Contact information

Danish Energy Agency: Thomas Mandal Østergaard

Energinet.dk: Rune Duban Grandal

Author: Rune Christensen, DTU Energy

### Publication date

December 2018

### Amendments after publication date

Date	Ref.	Description

### Brief technology description

Na-S batteries are secondary (i.e. rechargeable) batteries and are designed for system level applications. They are both power-intensive and energy-intensive. Larger installations (34 MW – 50 MW) are used for time shifting of production from renewable or conventional production plants. Smaller installations (400 kW – 8 MW) are used as back-up power, for off-grid applications, and for ancillary services. [1]–[3]

Na-S battery cells consist of a molten sodium anode, a molten sulfur cathode, and a  $\beta$ -alumina oxide solid state electrolyte (BASE) incased in a single tube. A schematic of a Na-S battery cell can be seen in Figure 1.



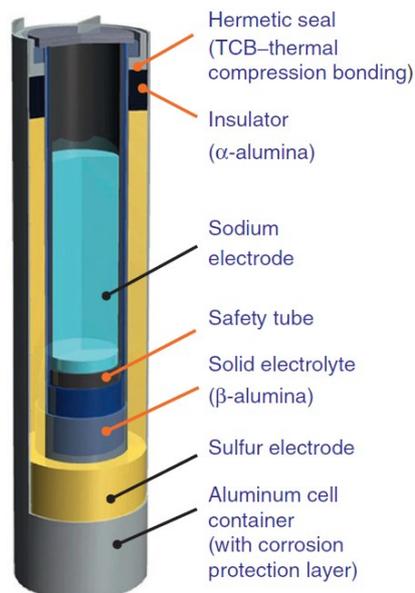


Figure 1: Schematic of a Na-S battery cell. [4]

The reactions taking place during discharge on the cathode and anode sides of the battery are [5], [6]



During charge the reverse reaction occurs. A graphical schematic of the reaction process and the full cell reaction can be seen in Figure 2.

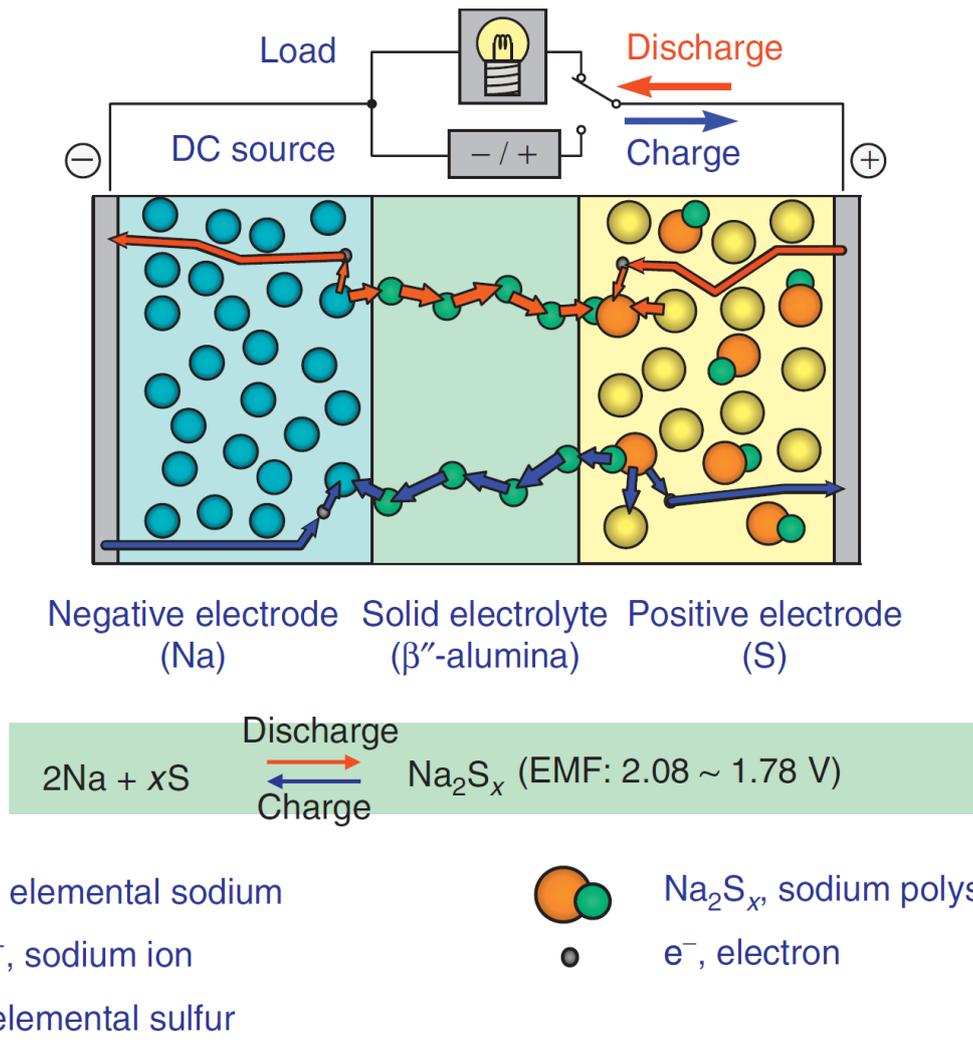


Figure 2: Graphical schematic of the reaction process and the full cell reaction. EMF: electromotive force. [4]

During continued discharge the value of x in Na<sub>2</sub>S<sub>x</sub> will gradually decrease and more sodium rich discharge products will be formed. The reaction occurs at a potential of 1.78 – 2.08 V at 350 °C depending on the state of battery charge. Relatively high temperatures (300-350 °C) are required for the reaction to take place. Elevated temperatures are required to keep the electrodes molten (98 °C for Na, 115 °C for S, and > 250 °C for Na<sub>2</sub>S<sub>x</sub> products [7]). A temperature of 300 °C or more is required to ensure sufficient Na ion conductivity through the BASE. The production of BASE has large impact on both battery performance and cost [6].

Cells are arranged in modules with thermal enclosures to minimize heat loss. An illustration of a module can be seen in Figure 3.

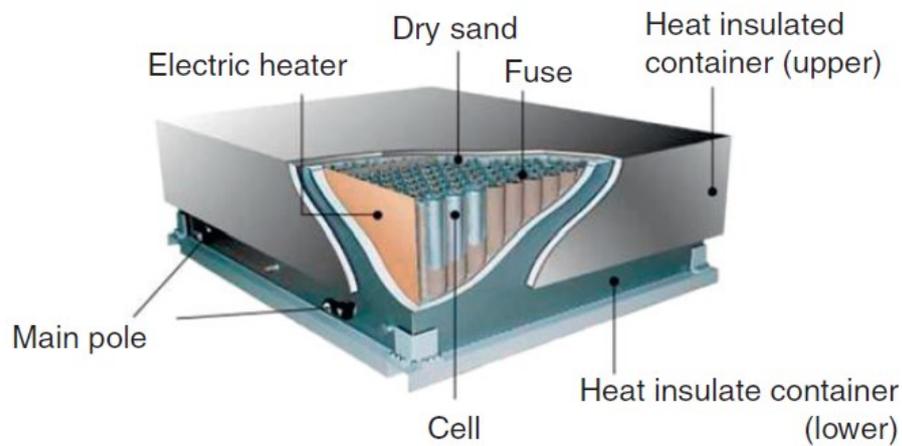


Figure 3: Illustration of Na-S battery module. [4]

A Na-S battery installation consists of one or more Na-S battery units containing the battery modules (shown in Figure 3), a battery management system, and a power conversion system required to connect the batteries to the grid. A schematic and a picture of an older 1 MW Na-S battery installation can be seen in Figure 4. For current market standard units see “

An alternative research route is to use the Na-S chemistry in a flow battery [20], [21].

Due to the similarity with Na-NiCl<sub>2</sub> batteries, synergies in research and development efforts can be expected.

Examples of market standard technology”.

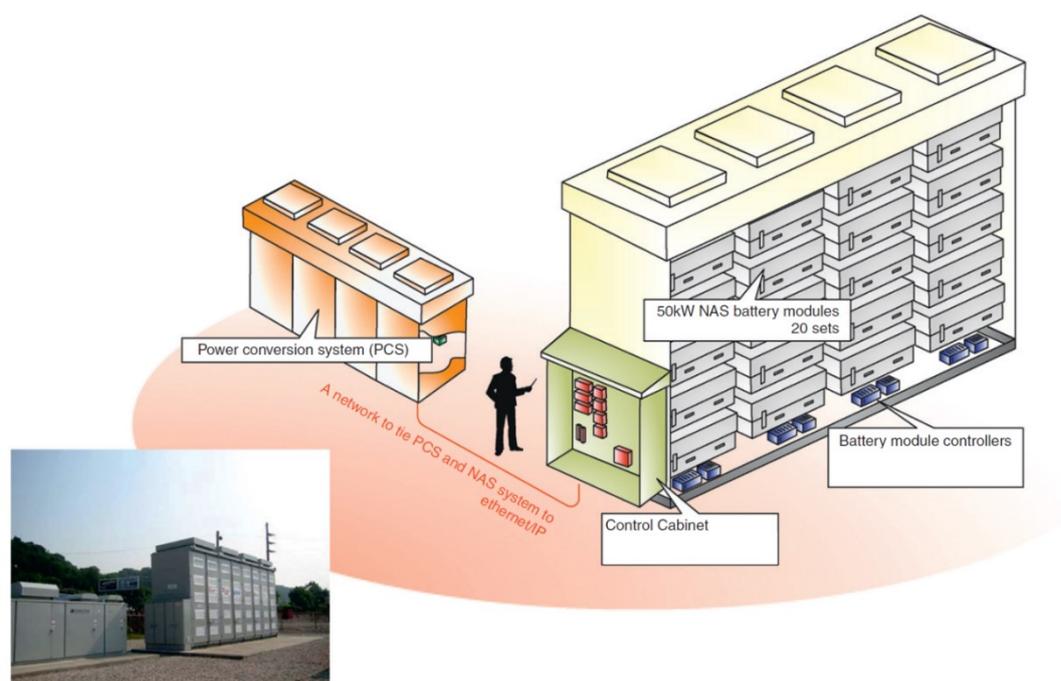


Figure 4: Schematic and picture of a 1 MW Na-S battery installation. [4]

For a more detailed technology description the reader is referred to “Encyclopedia of Electrochemical Power Sources” [8].

### Input/Output

Primary input and output are both electricity. Electricity is converted to electrochemical energy during the charge process and converted back to electricity during the discharge process as described above.

### Energy efficiency and losses

The heat loss from each battery module will be 2.2 – 4.0 kW [4]. This loss amounts to approximately 1 % per hour, and the Na-S batteries are thus not ideal for long term storage. During continued operation, which can include some hours of idle time, the Ohmic losses in the charge/discharge reaction will balance the heat loss [8]. The heat loss should thus not be treated as an independent source of energy loss during operation as it is included in the battery efficiency. Simple air cooling is sufficient for maintaining temperature and build into standard battery units. The battery temperature should be maintained to prevent the electrodes from solidifying since freeze-thaw cycles significantly reduce battery lifetime [9].

Individual battery cells have been measured with efficiencies at 89 % [9]. The efficiency of a grid size battery unit including auxiliary losses has been measured to be 83 % for an Italian installation primarily used for time shifting [9]. Reliable data for the efficiency in operation mode with constant power adjustment is not available for recently produced Na-S battery units.

### Regulation ability and other system services

The response time (i.e. the time it takes for the battery to supply requested charge or discharge power) is according to the manufacture <1 ms at operation temperature[10]. Measurements find that the battery can

change from full rated charging power to full rated discharging power in less than 50 ms [9] This is possibly limited by the power conversion system (PCS). Na-S batteries are able to provide energy pulses above rated discharge power for up to minutes at a time [8]. Pulses can be as large as 6 times rated power capacity for 30 s [11]. The other systems in the total installation, e.g., the PCS, and the grid connection must, however, be dimensioned accordingly for the pulse power capability to be utilized. This will increase cost.

Grid scale battery operation depends on the application. Batteries used for time shifting will generally complete a single charge/discharge cycle over 24 hours. Batteries used for various other grid services including stabilization of input from renewables will often not undergo traditional battery cycling but frequently switch between being charged and discharged according to demand.

Due to its short response time combined with relatively large storage and power capacity, Na-S batteries can provide a range of system services. NGK Insulators states: "The NAS battery systems also provide additional functions, including primary reserve, secondary reserve, load balancing and voltage control." [1]

**Typical characteristics and capacities**

Na-S battery installations come in two typical sizes. The larger installations used for time shifting have 34-50 MW capacity with 6-7.2 hours of storage capacity at full load (245-300 MWh). Information for three such installations are shown in Table 22. Smaller installations of up to 8 MW capacity have been installed during the last 20 years in 200 different locations [1]. In all cases the storage capacity corresponds to 6-8 hours of full power output capacity. As the batteries are highly modular, the installation size can be easily be varied according to demand. The power capacity to storage capacity is, however, for currently available commercial products fixed at a ratio of 1:6-8 [10].

Location	Rokkasho village, Aomori, Japan	Campania Region (3 sites), Italy	Buzen City, Fukuoka, Japan
			
Commissioned	2008	2015	2016
Storage capacity	245 MWh	250 MWh	300 MWh
Power capacity	34 MW	34.8 MW	50 MW
Energy density		<41.6 kWh/m <sup>3</sup> *	26 kWh/m <sup>3</sup>
Specific energy		<76 Wh/kg**	56 Wh/kg

Total land use	17.5 m <sup>2</sup> /MWh	77 m <sup>2</sup> /MWh	47 m <sup>2</sup> /MWh
----------------	--------------------------	------------------------	------------------------

Table 22: Larger Na-S battery installations [1], [9], [12]. \*Value for individual battery assembly units. \*\* Value for individual battery modules

New installations will for economic reasons likely consist of the standard commercially available units mentioned in

An alternative research route is to use the Na-S chemistry in a flow battery [20], [21].

Due to the similarity with Na-NiCl<sub>2</sub> batteries, synergies in research and development efforts can be expected.

Examples of market standard technology. NGK Insulators states that container type units as those used for the Buzen City installation will decrease construction time and cost compared to previous installations.

The lifetime in number of cycles for Na-S batteries depend on the usage. The number of cycles can be increased by utilizing less than the full storage capacity in each cycle as can be seen in Figure 5. The ratio of energy discharged from the battery relative to the fully charged state is referred to as the Depth of Discharge (DoD). At 0 % DoD the battery is fully charged. At 100 % DoD the battery is fully discharged.

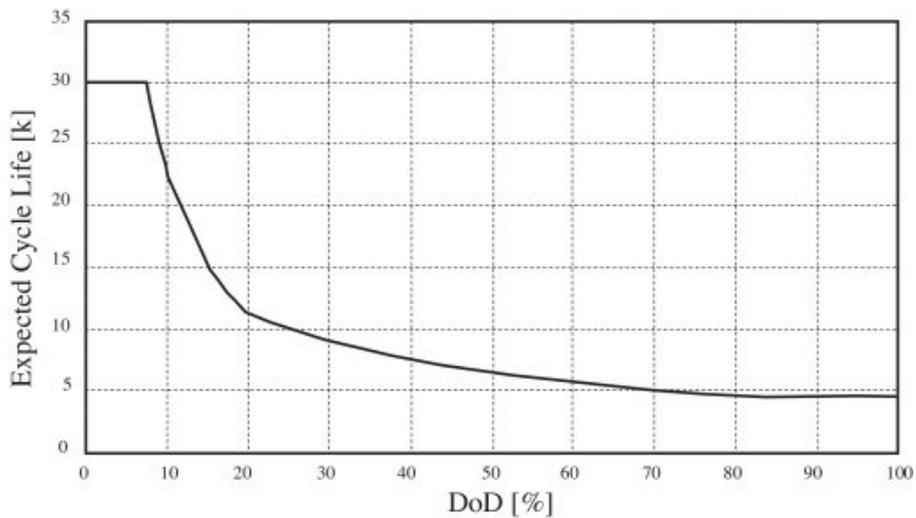


Figure 5: Expected number of cycles (in thousands) as function of Depth of Discharge (DoD) during cycles [9].

A Na-S battery used for time shifting with daily cycles of >80 % DoD will have an expected lifetime of 4500 cycles. If used for grid services, the average DoD will likely be smaller increasing the expected cycle lifetime. The technical lifetime is expected to be 15 years at a usage of 300 cycles at >80 % DoD per year [13] [14]. Longer technical lifetimes have not been reported. This is potentially due battery lifetime being limited by cycle lifetime during standard battery operation. An extended technical lifetime might not be obtainable by simply reducing the number of annual cycles or DoD for various reasons such as corrosion.

### Typical storage period

The typical storage period depends on operation. It ranges from minutes to hours. With charge/discharge times of 6-8 h the normal storage period will be on this scale for optimal battery storage utilization.

## Space Requirement

Space requirement per MWh are given in Table 22. The space requirements in Table 22 are calculated by dividing the total land use of the installations with the storage capacities. Footprint of current grid scale installations vary from 17.5 to 77 m<sup>2</sup>/MWh. The footprint is highly sensitive to the layout of the installation and the used battery units and other equipment. The value of 47 m<sup>2</sup>/MWh for Buzen City, where highly standardized container units are installed, is likely the most representative for future grid scale installations.

## Advantages/disadvantages

General advantages and disadvantages of batteries in comparison to other technologies for energy storage are listed in **Error! Reference source not found.**.

Advantages	Disadvantages
Short response time	
Flexible installation size	Relatively short lifetime
High energy efficiency	
Versatile application	Large investment cost
Relatively compact	
Low maintenance	

Table 23: General advantages and disadvantages of batteries in comparison to other technologies for energy storage

Compared to many other batteries, Na-S batteries have the advantage that they are composed of inexpensive and abundant raw materials. Therefore, they have the potential to be very low cost and be manufactured on very large scale. Na-S batteries are well proven and developed for grid scale applications and have been commercially available for grid scale purposes for 15 years. They are well suited for energy intensive storage applications but can also be used for power intensive purposes. The cost per MW power capacity is, however, larger than for batteries mainly intended for power intensive applications. Na-S batteries have significant pulse power capabilities, i.e. they can operate at higher power than rated for short durations of time [8], [11].

Na-S batteries require high temperatures and should remain heated, as the battery can only survive a limited (in the order of 20) freeze-thaw cycles in which the temperature is lowered and the molten electrodes solidify [9]. They are thus not suited for longer periods of idle storage with resulting heat losses but should ideally always be charging or discharging for optimal utilization. The market for Na-S batteries is currently limited, due to only one commercial manufacturer existing. Due to the elevated temperatures and the highly reactive molten electrode materials, safety concerns and requirements are also higher for Na-S batteries than most other types of batteries. However, only one safety incident has been reported as a battery caught fire in 2011 [6].

## Environment

The batteries contain molten sodium, sulfur and polysulfides. These all pose potential safety risks. Detailed safety and risk assessments are available in references [4], [9]. Sodium is the only material which must be recycled as hazardous [4].

### Research and development perspectives

It is not possible to quantify the full potential for improvements through R&D at the given time. The potential is however, estimated to be substantial in terms of both technical and financial specifications [15].

All critical components of the battery are undergoing active research. These include the BASE, the sealing materials, the sodium electrode, the sulfur electrode, and battery interfaces [16]. Research efforts are especially focused on geometry optimizations [17] [18] and improvement of Na ionic conductivity through the BASE [19]. New solid electrolytes to replace BASE are also being considered [15].

An alternative research route is to use the Na-S chemistry in a flow battery [20], [21].

Due to the similarity with Na-NiCl<sub>2</sub> batteries, synergies in research and development efforts can be expected.


### Examples of market standard technology

NGK Insulators is the only commercial manufacturer of Na-S batteries. They currently supply two types of modular units which are shown in Figure 6. These modular units can be used to form installations of the desired size. The recently installation in Buzen City consist of container type units such as the units shown in Figure 6.

### New container type unit

The NAS battery system is a “Plug and Play” design built around standard 20 foot ocean freight containers. The containerized design expedites transportation and installation and helps minimize installation costs.

Rated Output	800kW and 4,800kwh
Configuration	Four container subunits, series connected. A subunit includes six NAS modules, each rated at 33kW and 200kWh.
Dimension	6.1W x 5.6D x 5.5H (m)
Weight	86tonnes

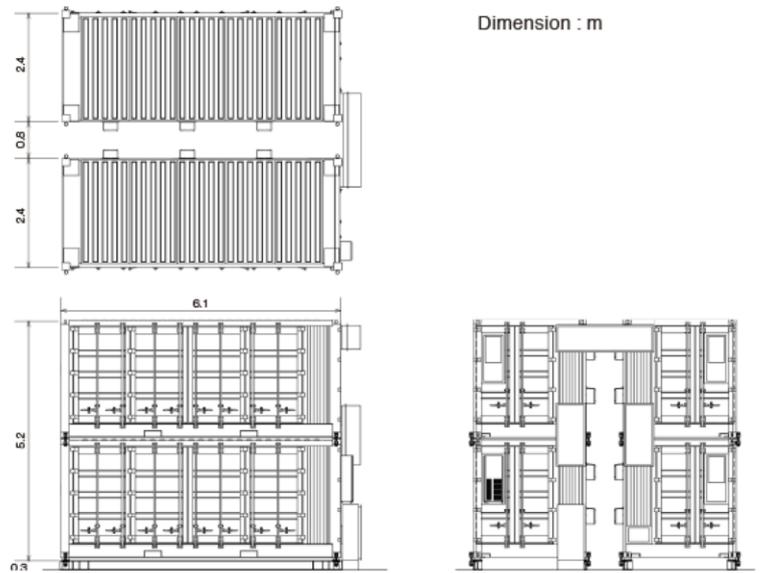

### Package type unit

The enclosure package and battery modules are installed on site. This design achieves more compact system comparing with containerized design.

Rated Output	1,200kW and 8,640kWh
Configuration	40 NAS modules, each rated at 30kW and 216kWh.
Dimension	10.2W x 4.4D x 4.8H (m)
Weight	132tonnes

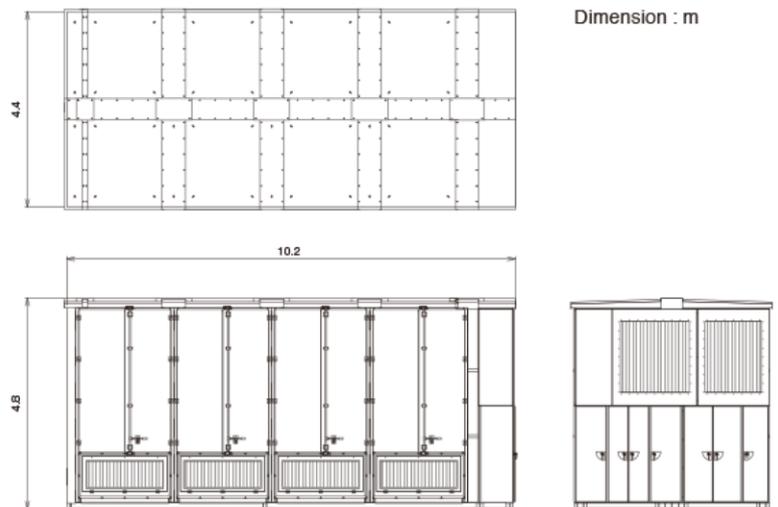


Figure 6: Commercial units available from NGK Insulators (<https://www.ngk.co.jp/nas/>) [10].

## Prediction of performance and cost

### Data for 2015

The Italian case (Campania Region) presented above has been used for economic data to as large an extent as possible [9], [22]. A significant reason for placing emphasis on this specific installation is that the owner, Italian grid operator Terna, has made financial and measured technical data available. Using real data is preferred over the use of estimates. However, it should be noted, that the cost might be relatively large compared to the market situation since Terna, for safety considerations following a 2011 fire incident in a Na-S battery, have requested fewer battery cells in each module than standard.

The balance between power capacity and energy storage capacity in battery installations will influence the investment costs per MW and MWh. The ratio can be quantified through the discharge time at rated power,  $h$ . It is nearly constant at 6-7.2 hours for currently available units.  $h$  is used to calculate the investment cost per storage capacity from the investment cost per power capacity.

O&M costs are obtained from Carlsson et al. [23] (assumed similar to 2013 values), and Zakeri and Syri [24].

### Assumptions for the period 2020 to 2050

Estimates for 2020 and 2030 in the data sheet below are based on data from IRENA [25]–[27]. Values in USD have been converted to € using an exchange rate of 0.86. The specific investment cost is adjusted to account for an expected decrease in  $h$  for the most common market-standard units from 7.2 h to 6 h.

As discussed in the Chapter Electricity Storage, the current PCS cost including grid connection is 0.4-0,5 M€/MW. This is used as reference value for the “capacity component”. The inverter costs, which account for approximately 50 % of cost [13], [22], [24], is predicted to decrease by 20 % in 2020 and 50 % in 2030 [25], [26]. The other 50 % of cost is assumed constant. Cost reductions of capacity components is assumed to not occur beyond 2030.

2050 values of the battery cost (here “energy component”) predicted from learning curves have previously found cost reductions of approximately 10 % [23] and 25 % [28] for the period 2030 to 2050. The average (17.5 %) is used for the energy component cost in 2050.

“Other project costs” is assumed to be 14 % of CAPEX (here “Specific investment”), as was the case for the Terna unit [29].

O&M costs are assumed to be constant in the given units.

No development in calendar lifetime, cycle lifetime, and efficiency is assumed to take place beyond 2030. The regulatory ability is assumed to not improve.

### Learning curves and technological maturity

Cost has been reduced with the introduction of large scale production of highly standardized units [12]. The level of maturity for system level scale is late “Category 2: Pioneer Phase” but entering “Category 3: Commercial technologies with moderate deployment”.

### Uncertainty

As the technology is just about to enter Category 3 level maturity, a technology development track cannot yet be established without large uncertainty. Uncertainties for 2020 and 2030 are when possible obtained from IRENA [26], [27]. Uncertainties in 2050 are assumed to be percentagewise similar to those in 2030. For the “capacity component” the maximum values for PCS cost found by Zakeri and Syri [24] are used as baseline. The uncertainties are calculated for future years by keeping the relative uncertainty compared to the cost prediction constant.

The uncertainties for O&M costs are determined using the literature review by Zakeri and Syri [24]. The uncertainties are calculated from the expected value using the relative difference between the extrema and the average in the literature review. Uncertainties are in general large.

### Additional remarks

Since battery units are highly modular and equipment is the main cost of a full installation, a close to linear scaling in total cost vs. installation size is expected from a technological point of view. Significant financial benefits from increasing installation sizes will rely on negotiations with the manufacturer.

Even though Na-S batteries have high commercial potential, rapid cost reduction of alternative storage solutions, e.g., Li-ion batteries, might halter commercial deployment and technological development of Na-S batteries. This can prevent Na-S batteries from reaching full commercial potential.

## Quantitative description

Technology	NaS battery									
	2015	2020	2030	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref
Energy/technical data					Lower	Upper	Lower	Upper		
Form of energy stored	Electricity									
Application	System, power- and energy-intensive									
Energy storage capacity for one unit (MWh)	250	300	300	300	30	3000	30	3000	A,B,Q	[9]
Output capacity for one unit (MW)	35	50	50	50	5	500	5	500	A,B,Q	[9]
Input capacity for one unit (MW)	35	50	50	50	5	500	5	500	A,B,Q	[9]
Round trip efficiency - DC (%)	83	83	85	85	71	92	74	96	C	[9];[26]
- Charge efficiency (%)	-	-	-	-	-	-	-	-		
- Discharge efficiency (%)	-	-	-	-	-	-	-	-		
Energy losses during storage (%/day)	0	0	0	0	0	1	0	1	D,Q	[11]/[30]/[26]
Forced outage (%)	0	0	0	0	0	2	0	2	E,Q	[13]
Planned outage (weeks per year)	0	0	0	0	0	0	0	0	F,Q	[13]
Technical lifetime (years)	15	19	24	24	10	28	14	36	G	[13];[25]+[27]
Construction time (years)	0.5	0.5	0.5	0.5	0.2	2.0	0.2	2.0	Q	[1]
<b>Regulation ability</b>										
Response time from idle to full-rated discharge (sec)	0.001	0.001	0.001	0.001	0.001	0.02	0.001	0.02	H	[10]+[28]
Response time from full-rated charge to full-rated discharge (sec)	0.050	0.050	0.050	0.050	0.001	0.05	0.001	0.05	H,I,Q	[9]
<b>Financial data</b>										
Specific investment (M€2015 per MWh)	0.46	0.37	0.23	0.20	0.25	0.73	0.13	0.39	G	[22];[25]+[26]
- energy component (M€/MWh)	0.31	0.25	0.14	0.11	0.18	0.50	0.08	0.23	G, J	[22]+[26]
- capacity component (M€/MW)	0.63	0.41	0.33	0.33	0.22	0.78	0.18	0.64	G, K	[22]+[26]
- other project costs (M€/MWh)	0.06	0.05	0.03	0.03	0.04	0.10	0.02	0.05	G	[22]+[26]
Fixed O&M (% total investment)	1.5	1.5	1.5	1.5	0.8	7.2	0.8	7.2	G,L,M	[23];[24]
Variable O&M (€2015/MWh)	1.8	1.8	1.8	1.8	0.3	5.6	0.3	5.6	G	[24]+[23]
<b>Technology specific data</b>										
Alternative Investment cost (M€2015/MW)	3.3	2.2	1.4	1.2	1.5	4.4	0.8	2.3	G	[22];[25]+[26]
Lifetime in total number of cycles	4500	5600	7500	7500	1100	11200	1500	15000	N, G	[9];[25]+[27]
Specific power (W/kg)	9.3	9.3	9.3	9.3	6.98	11.63	6.98	11.63	O,P,Q	[10]
Power density (W/m <sup>3</sup> )	4300	4300	4300	4.300	3225	5375	3225	5375	O,P,Q	[10]
Specific energy (Wh/kg)	56	56	56	56	42	70	42	70	O,P,Q	[10]
Energy density (Wh/m <sup>3</sup> )	26000	26000	26000	26000	19500	32500	19500	32500	O,P,Q	

### Notes:

- A Specific Italian installation from 2015 used here as example. Assuming installations similar to Buzen City discussed above to become standard in the future.
- B Highly modular technology type with near linear scaling between total cost and installation size. Power and storage capacity cannot be varied independently.
- C Grid size unit including balancing and auxiliary losses. Excluding converters. Assumes no improvement between 2030 and 2050.
- D Ohmic losses maintain the temperature of the battery during operation. Losses are thus included in round trip efficiency [7]. No electrical self-discharge. If idle the heat loss is as much as 1 % of storage capacity per hour but highly variational. IRENA reports as "worst" value of 1.0 % [26]
- E Forced outage is minimal. Only reported case is a 2011 fire incident [9].
- F On the order of 1 h per year.
- G Assumptions for development and uncertainty discussed above in "Prediction of performance" and "Uncertainty".
- H Due to absence of predictions in literature, no development is assumed as an estimate.
  - I Measurement. Possibly limited by PCS.
- J Includes "Batteries" from reference [22] for 2015 values.
- K Includes "PCS-SCI", "Auxiliary equipment", and "Switching and actuating equipment" from reference [22] for 2015 values.
- L Highly uncertain. Reported in range 2000 to 17300 €2015/MW/year [24]
- M Does not include replacement costs. The batteries do not need replacement within lifetime [13],[10].
- N See Figure 5.
- O Data for standard NGK container unit.
- P Not the technological maximum values, i.e., the density of single cells, but the specifications for a full market-standard commercial product.
- Q Uncertainties are based on a qualified guess.

## References

- [1] NGK Insulators LTD, "Case Studies." pp. 1–13, 2016.
- [2] "DOE Global Energy Storage Database." [Online]. Available: <https://www.energystorageexchange.org/>. [Accessed: 29-Mar-2017].
- [3] IEC, "Electrical Energy Storage," 2011.
- [4] C.-H. Dustmann and A. Bito, "SECONDARY BATTERIES – HIGH TEMPERATURE SYSTEMS | Safety," in *Encyclopedia of Electrochemical Power Sources*, 2009, pp. 324–333.
- [5] B. Dunn, H. Kamath, and J.-M. Tarascon, "Electrical Energy Storage for the Grid: A Battery of Choices," *Science* (80-. ), vol. 334, no. 6058, pp. 928–935, 2011.
- [6] J. Cho, S. Jeong, and Y. Kim, "Commercial and research battery technologies for electrical energy storage applications," *Prog. Energy Combust. Sci.*, vol. 48, pp. 84–101, Jun. 2015.
- [7] J. Garche and C. K. Dyer, *Encyclopedia of electrochemical power sources*. Academic Press, 2009.
- [8] R. Holze, "SECONDARY BATTERIES – HIGH TEMPERATURE SYSTEMS: Sodium-Sulfur," in *Encyclopedia of Electrochemical Power Systems*, vol. 200, 2009, pp. 302–311.
- [9] M. Andriollo et al., "Energy intensive electrochemical storage in Italy: 34.8 MW sodium-sulphur secondary cells," *J. Energy Storage*, vol. 5, pp. 146–155, Feb. 2016.
- [10] NGK Insulators LTD, "Structure of NAS Energy Storage System," 2016. [Online]. Available: <https://www.ngk.co.jp/nas/specs/>.
- [11] H. Chen, T. N. Cong, W. Yang, C. Tan, Y. Li, and Y. Ding, "Progress in electrical energy storage system: A critical review," *Prog. Nat. Sci.*, vol. 19, no. 3, pp. 291–312, 2009.
- [12] NGK Insulators LTD, "The World's Largest NAS Battery Installation Commences Operation Short Installation Period Achieved through Containerized, Compact Format," 2016. [Online]. Available: <http://www.ngk.co.jp/english/news/2016/0303.html>.
- [13] G. Huff et al., "DOE/EPRI 2013 electricity storage handbook in collaboration with NRECA," Rep. SAND2013- ..., no. July, p. 340, 2013.
- [14] NGK Insulators LTD, "Comparison of Battery Technologies | Why NAS? | NAS." [Online]. Available: <https://www.ngk.co.jp/nas/why/comparison.html>. [Accessed: 13-Sep-2017].
- [15] O. Teller et al., "Joint EASE/EERA Recommendations for a European Energy Storage Technology Development Roadmap Towards 2030," 2013.

- [16] Z. Wen, Y. Hu, X. Wu, J. Han, and Z. Gu, "Main Challenges for High Performance NAS Battery: Materials and Interfaces," *Adv. Funct. Mater.*, vol. 23, no. 8, pp. 1005–1018, Feb. 2013.
- [17] G. Kim, Y.-C. Park, Y. Lee, N. Cho, C.-S. Kim, and K. Jung, "The effect of cathode felt geometries on electrochemical characteristics of sodium sulfur (NaS) cells: Planar vs. tubular," *J. Power Sources*, vol. 325, pp. 238–245, Sep. 2016.
- [18] S. I. Kim, W. Il Park, K. Jung, and C.-S. Kim, "An innovative electronically-conducting matrix of the cathode for sodium sulfur battery," *J. Power Sources*, vol. 320, pp. 37–42, Jul. 2016.
- [19] K. . Ahlbrecht, C. Bucharsky, M. Holzapfel, J. Tübke, and M. J. Hoffmann, "Investigation of the wetting behavior of Na and Na alloys on uncoated and coated Na- $\beta$ "-alumina at temperatures below 150 °C," *Ionics (Kiel)*, pp. 1–9, Mar. 2017.
- [20] X. Yu and A. Manthiram, "Ambient-Temperature Sodium-Sulfur Batteries with a Sodiated Nafion Membrane and a Carbon Nanofiber-Activated Carbon Composite Electrode," *Adv. Energy Mater.*, vol. 5, no. 12, pp. 1–6, 2015.
- [21] X. Yu and A. Manthiram, "Performance Enhancement and Mechanistic Studies of Room-Temperature Sodium–Sulfur Batteries with a Carbon-Coated Functional Nafion Separator and a Na<sub>2</sub>S/Activated Carbon Nanofiber Cathode," *Chem. Mater.*, vol. 28, no. 3, pp. 896–905, Feb. 2016.
- [22] R. Benato, G. Bruno, F. Palone, R. Polito, and M. Rebolini, "Large-Scale Electrochemical Energy Storage in High Voltage Grids: Overview of the Italian Experience," *Energies*, vol. 10, no. 1, p. 108, Jan. 2017.
- [23] J. E. Al Carlsson, "ETRI 2014 - Energy Technology Reference Indicator projections for 2010-2050," 2014.
- [24] B. Zakeri and S. Syri, "Electrical energy storage systems: A comparative life cycle cost analysis," *Renew. Sustain. Energy Rev.*, vol. 42, pp. 569–596, 2015.
- [25] K.-P. Kairies, "Battery storage technology improvements and cost reductions to 2030: A Deep Dive," *Int. Renew. Energy Agency Work.*, 2017.
- [26] IRENA, "Electricity storage and renewables: Costs and markets to 2030 - Cost-of-service tool. Version 1.0," 2017.
- [27] P. Ralon, M. Taylor, and A. Ilas, "Electricity storage and renewables: costs and market to 2030," no. October. 2017.
- [28] L. Sigrist and E. Peirano, "E-Highway2050: Battery Storage Technology Assessment," in WP3 workshop April 15th, 2014.
- [29] R. Benato et al., "Sodium nickel chloride battery technology for large-scale stationary storage in the high voltage network," *J. Power Sources*, vol. 293, pp. 127–136, 2015.

[30] G. L. Soloveichik, "Battery Technologies for Large-Scale Stationary Energy Storage," *Annu. Rev. Chem. Biomol. Eng.*, vol. 2, pp. 503–27, 2011.

## 183 NA-NICL<sub>2</sub> BATTERIES

### Contact information:

Danish Energy Agency: Thomas Mandal Østergaard

Energinet.dk: Rune Duban Grandal

Author: Rune Christensen, DTU Energy

### Publication date

December 2018

### Amendments after publication date

Date	Description
15.03.2019	Correction in the datasheet to the “Energy storage capacity for one unit (MWh)”, “Output capacity for one unit (MW)” and “Input capacity for one unit (MW)”. Correction to note I.

### Brief technology description

Na-NiCl<sub>2</sub>, or Sodium-nickel chloride, batteries are secondary (i.e. rechargeable) batteries. They are also known as ZEBRA (Zeolite Battery Research Africa Project) batteries. They are applicable for both power-intensive and energy-intensive electrical energy storage. They can be used on both grid level and for mobile applications such as electric and hybrid vehicles [1].

Na-NiCl<sub>2</sub> batteries are similar to the more mature Na-S batteries. The key components of a Na-NiCl<sub>2</sub> battery cell are the molten sodium anode, a ceramic β-alumina oxide solid state electrolyte (BASE), and a porous cathode, where the reactant is NiCl<sub>2</sub>. The cathode also contains liquid NaAlCl<sub>4</sub> to obtain sufficient ionic conductivity [2], [3]. A schematic of a cell can be seen in Figure 1.

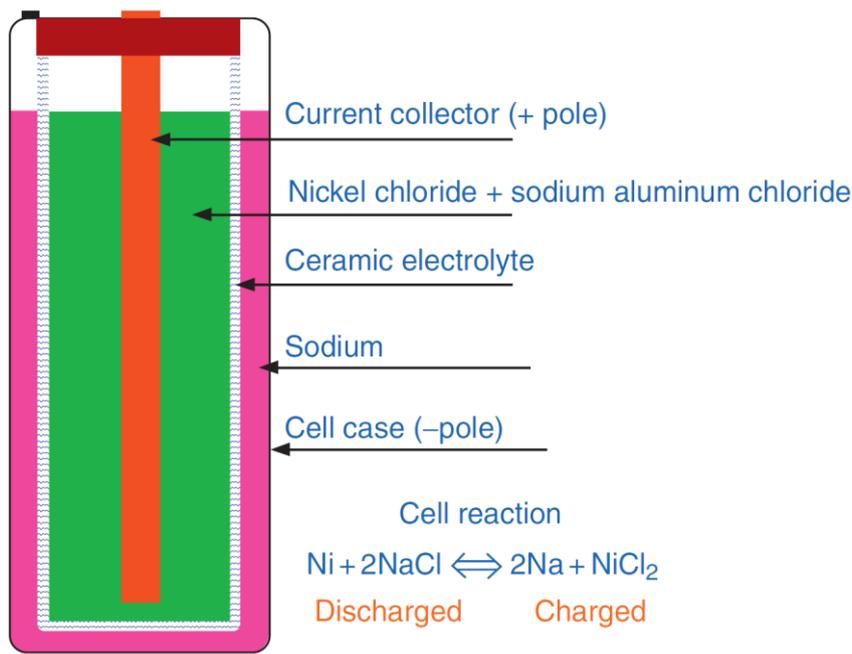


Figure 1: Schematic of Na-NiCl<sub>2</sub> battery cell. The “Ceramic electrolyte” is BASE [1].

A picture of five connected cells and the components used to manufacture a cell can be seen in Figure 2.



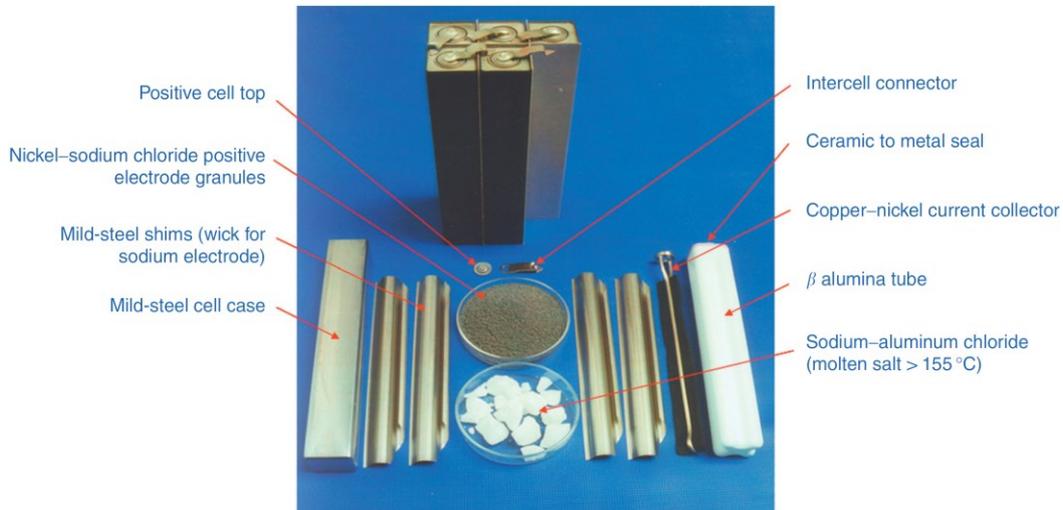


Figure 2: Na-NiCl<sub>2</sub> battery cell components [1].

Cells are assembled in a fully discharged state. This allows the sodium to be supplied in the form of NaCl as can be seen from the discharge reaction:



During charge the reverse reaction occurs. The reaction has a full cell potential of 2.58 V at 300 °C. The operating temperature is 250 °C to 350 °C to ensure sufficient Na ionic conductivity through the BASE [4]. A lower limit operation temperature of 150 °C is required to maintain liquid NaAlCl<sub>4</sub> [1]. An illustration of the charging reaction can be seen in Figure 3.

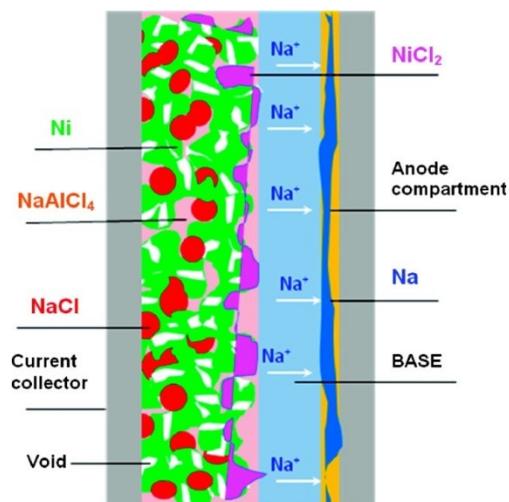


Figure 3: Illustration of Na-NiCl<sub>2</sub> charging process [2].

The battery cells are connected in battery units with thermal insulation, heating and cooling systems, and various control systems. Battery modules can be combined in larger battery units for grid scale applications. Current commercial grid scale units are shown in Section “Examples of market standard technology”. A grid scale Na-NiCl<sub>2</sub> battery installation consists as a minimum of a unit containing the battery modules, a battery management system, and a power conversion system required to connect the batteries to the grid.

For a more detailed technology description the reader is referred to “Encyclopedia of Electrochemical Power Sources” [1].

### Input/output

The primary input and output are both electricity. Electricity is converted to electrochemical energy during charge. The electrochemical energy is converted back to electricity during discharge in the reaction process described above.

### Energy efficiency and losses

Heat loss is reported to be less than 0.6 % of total energy storage capacity per hours for a 17.8 kWh battery module and less than 0.3 % of total storage capacity per hour for a 35.7 kWh battery module [1]. The heat loss depends on the specific assembly unit. Heat loss in large battery installations consisting on multiple assembly units, e.g., 10 identical container assembly units, each containing multiple battery modules is expected to scale approximately linearly with installation size. The heat loss in percentage of total energy storage capacity is thus approximately independent of total installation size. During continued operation, which can include some hours of idle time, the Ohmic losses in the charge/discharge reaction will balance the heat loss. The heat loss should thus not be treated as an independent source of energy loss during operation as it is included in the battery efficiency. Simple air cooling is sufficient for maintaining temperature during operation and build into standard battery units.

Na-NiCl<sub>2</sub> batteries can be repeatedly cooled to ambient temperatures and reheated, i.e. undergo so-called freeze-thaw cycles, without any decrease to battery lifetime [1], [4], [5]. Typical time scales are days to solidify during cooling and tens of hours to liquidize during reheating [6]. Na-NiCl<sub>2</sub> batteries should remain heated during shorter idle periods.

At grid scale battery operation, the DC efficiency of a Na-NiCl<sub>2</sub> module has been measured to 90 % [7]. A 0.5 MW Na-NiCl<sub>2</sub> battery unit has been measured to 89 % [4]. Auxiliary losses, e.g., from cooling account for approximately 2 % [7].

### Regulation ability and other system services

Standard recharging is slower than discharging the battery, i.e. the standard charging input will be lower than the rated output capacity. Commercial data states 6-8 hours to recharge a battery with 3 hour capacity at rated discharge capacity [1], [8]. Fast recharge at a rated equal to or above the rated output power is possible at the cost of decreased energy efficiency and accelerated battery degradation [9]. At low charge/discharge rates (approximately 1/3 of rated power) the full battery energy storage capacity can be used. At rated power output only 80 % of storage capacity should be utilized to prevent accelerated degradation [4].

The response time (i.e. the time it takes for the battery to supply requested charge or discharge power) is stated to be 20 ms [10] and measured to be less than 1 second when the battery is operational [4]. The response time from non-operational mode with the battery at operating temperature takes 45 seconds. [4].

Given the necessary power conversion system (PCS) equipment etc. is installed, Na-NiCl<sub>2</sub> batteries are able to provide energy pulses of up to at least 3 times rated power capacity for periods measured as long as 30 min but with storage capacity reduced by a factor of two compared to rated discharge rate [4]. The effect of such operation on battery lifetime is not known.

Grid scale battery operation depends on the application. Batteries used for time shifting will generally complete a single charge/discharge cycle over 24 hours. Batteries used for various other grid services including stabilization of input from renewables will often not undergo traditional battery cycling but frequently switch between being charged and discharged according to demand.

Na-NiCl<sub>2</sub> batteries can provide a range of system services. The manufacturer FZSoNick states the following applications: Load levelling, power quality, renewable resource optimization, and utility grid ancillary services [8].

### Typical characteristics and capacities

Some noteworthy European stationary installations of Na-NiCl<sub>2</sub> batteries are listed in Table 1.

Name	Location	Year of commissioning	Storage capacity	Rated power output capacity
FIAMM Green Energy Island	Almisano, Italy	2010	230 kWh	180 kW

EDF EN Gabardone Project	Colombiers, France	2013	70 kWh	20 kW
Terna Storage Lab 1+2 (3 installations)	Codrongianos (Sardinia) and Ciminna (Sicily), Italy	2014 and 2015	4150 kWh 2000 kWh 4150 kWh	1200 kW 1000 kW 1200 kW

Table 1: Selected Na-NiCl installations in Europe [4], [11], [12].

The energy density and specific energy calculated for the Energy Spring 164 system from FZSoNick [8] (See Figure 5) is 32.8 kWh/m<sup>3</sup> and 56 Wh/kg, respectively.

### Typical storage period

The storage period for Na-NiCl<sub>2</sub> batteries depends on the operation of the batteries and can range from minutes to hours.

### Space Requirement

For the Energy Spring 164 system from FZSoNick [8], the footprint of a single battery assembly unit is 10.5 m<sup>2</sup>/MWh. Data is not available for footprint of full installations of Na-NiCl<sub>2</sub> batteries. Assuming Na-NiCl<sub>2</sub> battery assembly units will occupy a similar fraction of total installation area as Na-S battery units, the total installation footprint can be estimated to 70 – 116 m<sup>2</sup>/MWh on the basis of large recent Na-S battery installations [13]–[15]. This estimate takes into consideration that the battery unit footprint is 1.5 times larger per MWh for current commercially available Na-NiCl<sub>2</sub> battery units than commercially available Na-S battery units (See Figure 5 and reference [16]).

### Advantages/disadvantages

General advantages and disadvantages of batteries in comparison to other technologies for energy storage are listed in Table 3.

Advantages	Disadvantages
Short response time	
Flexible installation size	Relatively short lifetime
High energy efficiency	
Versatile application	Large investment cost
Relatively compact	
Low maintenance	

**Table 3: General advantages and disadvantages of batteries in comparison to other technologies for energy storage**

Even compared to other batteries, Na-NiCl<sub>2</sub> batteries are considered reliable and low maintenance [8], [17]. Na-NiCl<sub>2</sub> are high temperature batteries, however they can operate at lower temperatures than Na-S batteries. They can in contrast to Na-S batteries withstand repeated cooling and reheating without degradation [4], [5]. They have significant pulse power capabilities, i.e. they can operate at higher power than rated for short durations of time [18][19]. They are among the most efficient large scale batteries. They are, despite the highly reactive molten sodium electrode and elevated temperatures, considered relatively safe due to intrinsic safety features [4], [18], [20].

The batteries are currently expensive compared to other batteries for grid scale application for both energy intensive and power intensive applications. There is currently only one trading manufacturer. The energy storage capacity is directly coupled to the usage of nickel, which account for 47% [21] to 60 % [22] of raw material costs. The raw material cost of nickel is approximately 18 \$/kWh at a price of 11.6 \$/kg [21]–[23]. Cost of Ni is currently not critical to the overall battery cost but could become significant in case of large production cost reductions.

### Environment

Operating batteries contain molten sodium, which pose a potential safety and environmental risks. Risk analyses can be found in References [4], [20]. Raw materials used in the production of Na-NiCl<sub>2</sub> batteries are nonhazardous and globally available [20]. Discharged batteries can easily be recycled and the nickel reclaimed [17], [20]. A detailed Life Cycle Assessment (LCA) can be found in Reference [24].

### Research and development perspectives

It is not possible to quantify the full potential for improvements through R&D at the given time. The potential is however, estimated to be substantial in terms of both technical and financial specifications [25].

All critical components of the battery are undergoing active research. These include the BASE, the sealing materials, the sodium electrode, the cathode, and battery interfaces. Research efforts are especially focused on geometry optimizations and improvement of Na ionic conductivity through the BASE. New solid electrolytes to replace BASE are also being considered [25].

Research is also going into slightly changed chemistries which would change the battery characteristics significantly [3], [26].

Due to the similarity with Na-S batteries, synergies in research and development efforts can be expected.

### Examples of market standard technology

FZSoNick, a subsidiary of FIAMM, is the only currently trading commercial manufacturer of Na-NiCl<sub>2</sub> batteries [8]. Illustration and technical specifications available at below referenced URL are presented for a grid scale assembly unit in Figure 4 - Figure 5. Units are highly modular and can be combined to an installation of desired size.



Figure 4: Energy Spring 164 system from FZSoNick [8].

## Energy Spring 164 Technical Specification for configuration of 64 ST523

<b>Battery / Chemistry Type</b>	NaNiCl <sub>2</sub>
<b>Constant Power Discharge (Rated)</b>	400 kW for 3 hours
<b>Nominal Energy Capacity</b>	1.4 MWh (100% DOD)
<b>System Rating (Voltage, Current Capacity)</b>	Nom. 620 VDC, Nom. 2432 Ah
<b>Min / Max Operative System Voltages</b>	500 VDC / 700 VDC
<b>Standard Charge / Discharge hours</b>	8 hours of charge, 3 hours of discharge
<b>Standard Circuit Design</b>	Up to 64 battery modules connected in parallel
<b>Enclosure Dimensions</b>	L: 6058 mm / 238.5 in H: 2896 mm / 114 in W: 2438 mm / 96 in
<b>Weight (metric ton)</b>	25 t (with battery modules), 10 t (without battery modules)
<b>Heater Consumption during floating</b>	<10 kW
<b>Ventilation</b>	Not need Air Conditioning, only forced-air ventilation for power electronics
<b>Design Cycle Life</b>	4500 Cycles at 80% DOD
<b>Product / Material Specifications</b>	Please refer to ST523 battery specifications
<b>BMS Characteristics</b>	Please refer to ST523 battery specifications

Figure 5: Specifications for Energy Spring 164 system from FZSoNick [8].

[http://www.fzsonick.com/media/369733/20161221\\_energy-spring-164\\_datasheet-a4.pdf](http://www.fzsonick.com/media/369733/20161221_energy-spring-164_datasheet-a4.pdf)

### Prediction of performance and cost

#### Data for 2015

The Italian “Terna Storage Lab” installation reported above has been used for economic data to as large extend as possible [4], [12]. A significant reason for placing emphasis on this specific installation is that the owner, Italian grid operator Terna, has made financial and measured technical data available. This is preferred over estimates.

The balance between power capacity and energy storage capacity in battery installations will influence the investment costs per MW and MWh. The ratio can be quantified through the discharge time at rated power,  $h$ , and has historically varied. Calculated as a weighted average for the “Terna Storage Lab”,  $h$  is 3 hours. This is similar to  $h$  for currently available commercial grid-scale units.

O&M costs are obtained from Carlsson et al. [27] (assumed similar to 2013 values for Na-S batteries in good agreement with EPRI data [28]), and Zakeri and Syri [29]. It is highly uncertain how O&M costs will change in the future with deployment of highly standardized container type units.

### ***Assumptions for the period 2020 to 2050***

Estimates for 2020 and 2030 in the data sheet below are based on data from IRENA [30]–[32]. Values in USD have been converted to € using an exchange rate of 0.86.

As discussed in the Chapter Electricity Storage, the current PCS cost including grid connection is 0.4-0,5 M€/MW. This is used as reference value for the “capacity component”. The inverter costs, which account for approximately 50 % of cost [13], [22], [24], is predicted to decrease by 20 % in 2020 and 50 % in 2030 [25], [26]. The other 50 % of cost is assumed constant. Cost reductions of capacity components is assumed to not occur beyond 2030.

2050 values of the battery cost (here “energy component”) predicted from learning curves have previously found cost reductions of approximately 10 % [23] and 25 % [28] for the period 2030 to 2050 for Na-S batteries. As Na-S and Na-NiCl<sub>2</sub> batteries have similar cost drivers, the average (17.5 %) is used for the energy component cost in 2050.

“Other project costs” is assumed to be 8 % of CAPEX (here “Specific investment”), as was the case for the Terna unit [29].

O&M costs are assumed to be constant in the given units.

No development in calendar lifetime, cycle lifetime, and efficiency is assumed to take place beyond 2030. The regulatory ability is assumed to not improve.

### ***Learning curves and technological maturity***

The level of maturity for grid scale Na-NiCl<sub>2</sub> batteries is “Category 2: Pioneer Phase”. Based on the current commercial situation it is not possible to establish learning curves. The technology is for grid scale applications suffering from slow rate of deployment compared to other grid scale batteries despite being relatively old. It is doubtful whether grid scale Na-NiCl<sub>2</sub> batteries will ever achieve Category 3 maturity: “Commercial technologies with moderate deployment”.

### **Uncertainty**

As the technology is in Category 2 level maturity, a technology development track cannot yet be established without large uncertainty. Uncertainties for 2020 and 2030 are when possible obtained from IRENA [26], [27]. Uncertainties in 2050 are assumed to be percentagewise similar to those in 2030. For the “capacity component” the maximum values for PCS cost found by Zakeri and Syri [24] are used as baseline. The uncertainties are calculated for future years by keeping the relative uncertainty compared to the cost prediction constant.

The uncertainties for O&M costs are determined using the literature review by Zakeri and Syri [24]. The uncertainties are calculated from the expected value using the relative difference between the extrema and the average in the literature review. Uncertainties are in general large.

### Additional remarks

Since battery units are highly modular and equipment is the main cost of a full installation, a close to linear scaling in total cost vs. installation size is expected from a technological point of view. Significant financial benefits from increasing installation sizes will rely on negotiations with the manufacturer.

Even though Na-NiCl<sub>2</sub> batteries have high commercial potential, rapid cost reduction of alternative storage solutions, e.g. Li-ion batteries could halter commercial deployment and technological development of Na-NiCl<sub>2</sub> batteries. This can prevent Na-NiCl<sub>2</sub> batteries from reaching full commercial potential.

## Quantitative description

Assumptions for prediction of development are discussed above.

Technology	Na-NiCl <sub>2</sub> battery										
	2015	2020	2030	2050	Uncertainty (2020)		Uncertainty (2050)		Note	Ref	
<b>Energy/technical data</b>					<b>Lower</b>	<b>Upper</b>	<b>Lower</b>	<b>Upper</b>			
Form of energy stored	Electricity										
Application	System, power- and energy-intensive										
Energy storage capacity for one unit (MWh)	3.43	4.15	4.15	4.15	3.11	5.19	3.11	5.19	A,B,P	[12]+[11]	
Output capacity for one unit (MW)	1.13	1.2	1.2	1.2	0.90	1.50	0.90	1.50	A,B,P	[12]+[11]	
Input capacity for one unit (MW)	0.42	0.45	0.45	0.45	0.34	0.56	0.34	0.56	C,P	[34]+[8]	
Round trip efficiency DC(%)	87	87	87	87	81	93	83	95	D	[4]+[7]; [31]	
- Charge efficiency (%)	-	-	-	-	-	-	-	-			
- Discharge efficiency (%)	-	-	-	-	-	-	-	-			
Energy losses during storage (%/day)	0	0	0	0	0	15	0	15	E,P	[35]+[5];[31]	
Forced outage (%)	0	0	0	0	0	2	0	2	F,P	[8]	
Planned outage (weeks per year)	0	0	0	0	0	0	0	0	F,P	[8]	
Technical lifetime (years)	15	17	23	23	9	25	12	33		[28]+[8];[30]+[32]+[31]	
Construction time (years)	0.5	0.5	0.5	0.5	0.2	2.0	0.2	2.0	G,P	[11]	
<b>Regulation ability</b>											
Response time from idle to full-rated discharge (sec)	0.02	0.02	0.02	0.02	0.001	0.02	0.001	0.02		[10]/[4]+[33]	
Response time from full-rated charge to full-rated discharge (sec)	0.5	0.5	0.5	0.5	0.001	0.5	0.001	0.5	H,P	[4]	
<b>Financial data</b>											
Specific investment (M€2015 per MWh)	1.0	0.42	0.26	0.23	0.32	0.53	0.18	0.30	I, J	[12]+[28]; [30]+[31]	
- energy component (M€/MWh)	0.76	0.26	0.14	0.11	0.21	0.32	0.09	0.14	K	[12]; [31]	
- capacity component (M€/MW)	0.48	0.41	0.33	0.33	0.30	0.58	0.25	0.47	L	[12]; [31]	
- other project costs (M€/MWh)	0.08	0.03	0.02	0.02	0.03	0.04	0.01	0.02		[12]	
Fixed O&M (% total investment)	1.5	1.5	1.5	1.5	0.9	2.0	0.9	2.0	M	[29]+[28]+[27]	
Variable O&M (€2015/MWh)	0.6	0.6	0.6	0.6	0.4	2.1	0.4	2.1	N	[29]	
<b>Technology specific data</b>											
Alternative Investment cost (M€2015/MW)	3.0	1.4	0.9	0.8	1.1	1.8	0.6	1.0	I	[12]+[28]	
Lifetime in total number of cycles	4500	4500	4500	4500	1500	11300	1500	11300	O	[4]+[8];[30]+[32]	
Specific power (W/kg)	16	16	16	16	12	20	12	20	O,P	[8]	
Power density (W/m <sup>3</sup> )	9350	9350	9350	9350	7012	11687	7012	11687	O,P	[8]	
Specific energy (Wh/kg)	56	56	56	56	42	70	42	70	O,P	[3]	
Energy density (Wh/m <sup>3</sup> )	32700	32700	32700	32700	24525	40875	24525	40875	O,P	[3]	

- A. Italian batteries (Codrongianos (Sardinia) and Ciminna (Sicily)) used as standard.
- B. Highly modular technology type with near linear scaling between total cost and installation size. Power and storage capacity cannot be varied independently.
- C. Can fast recharge with rate identical to discharge rate. Standard charge/discharge time is 8/3 h.
- D. Efficiency varies depending on use. Loss due to balance of system is approximately 2 % higher than for Li-ion batteries with similar PCS equipment [7]
- E. During intended continuous operation, Ohmic losses maintain the temperature of the battery. Losses are thus included in round trip efficiency. No electrical self-discharge. Heat losses during idle periods on the order of 0.5 %/h discussed above. IRENA finds self-discharge per day to vary between 0.1 % and 15 % depending on unit and use [31]
- F. Highly reliable and with no downtime required for maintenance during lifetime according to manufacturer.
- G. Can be down to 2 months.
- H. Measurement. Possibly limited by PCS.
- I. For 2015, the specific storage to power capacity ratio is set to the average value for Italian “Terna Storage Lab” batteries. For future installations, the 4150 kWh and 1200 kW system is assumed.
- J. Development rates from IRENA are used for prediction of future cost [30]
- K. Includes “Batteries” from reference [12]
- L. Includes “PCS-SCI”, “Transformer”, “Auxiliary equipment”, “Switching and actuating equipment”, and “System Controls & Instrumentation (SCI)” from reference [12].
- M. Assumed similar to Na-S batteries in good agreement with data from EPRI [28]
- N. Highly uncertain. Average value given. Reported in range 0.38 to 2.1 [29]
- O. Data for Energy Spring 164 system from FZSoNick. Irena do not expected improvements on cell level. Improvements on installation level might occur [32]
- P. Uncertainties are based on a qualified guess.

### References

- [1] J. L. Sudworth and R. C. Galloway, "SECONDARY BATTERIES – HIGH TEMPERATURE SYSTEMS | Sodium–Nickel Chloride," in *Encyclopedia of Electrochemical Power Sources*, 2009, pp. 312–323.
- [2] Z. Yang et al., "Electrochemical Energy Storage for Green Grid," *Chem. Rev.*, vol. 111, no. 5, pp. 3577–3613, May 2011.
- [3] X. Lu, G. Li, J. Y. Kim, J. P. Lemmon, V. L. Sprenkle, and Z. Yang, "A novel low-cost sodium–zinc chloride battery," *Energy Environ. Sci.*, vol. 6, no. 6, p. 1837, 2013.
- [4] R. Benato et al., "Sodium nickel chloride battery technology for large-scale stationary storage in the high voltage network," *J. Power Sources*, vol. 293, pp. 127–136, 2015.
- [5] G. L. Soloveichik, "Battery Technologies for Large-Scale Stationary Energy Storage," *Annu. Rev. Chem. Biomol. Eng.*, vol. 2, pp. 503–27, 2011.
- [6] B. Parkhideh, "Project : Storage Technologies for Hybrid Electric Buses - Subject : ZEBRA Battery," 2006.
- [7] M. Pietrucci, "Progetti Pilota Power Intensive: Descrizione degli impianti e delle tecnologie," 2017.
- [8] FZSoNick, "DATASHEETS," 2017. [Online]. Available: <http://www.fzsonick.com/en/emea/energy-storage/prodotti/spring,-mod-164,-324.aspx>.
- [9] M. Hosseinifar and A. Petric, "Effect of High Charge Rate on Cycle Life of ZEBRA (Na/NiCl<sub>2</sub>) Cells," *J. Electrochem. Soc.*, vol. 163, no. 7, pp. A1226–A1231, 2016.
- [10] T. V Rachel Carnegie Douglas Gotham David Nderitu Paul Preckel, "Utility Scale Energy Storage Systems," 2013.
- [11] "DOE Global Energy Storage Database." [Online]. Available: <https://www.energystorageexchange.org/>. [Accessed: 29-Mar-2017].
- [12] R. Benato, G. Bruno, F. Palone, R. Polito, and M. Rebolini, "Large-Scale Electrochemical Energy Storage in High Voltage Grids: Overview of the Italian Experience," *Energies*, vol. 10, no. 1, p. 108, Jan. 2017.
- [13] NGK Insulators LTD, "Case Studies." pp. 1–13, 2016.
- [14] NGK Insulators LTD, "The World's Largest NAS Battery Installation Commences Operation Short Installation Period Achieved through Containerized, Compact Format," 2016. [Online]. Available: <http://www.ngk.co.jp/english/news/2016/0303.html>.
- [15] M. Andriollo et al., "Energy intensive electrochemical storage in Italy: 34.8 MW sodium-sulphur secondary cells," *J. Energy Storage*, vol. 5, pp. 146–155, Feb. 2016.
- [16] NGK Insulators LTD, "Structure of NAS Energy Storage System," 2016. [Online]. Available: <https://www.ngk.co.jp/nas/specs/>.
- [17] K. Bradbury, "Energy Storage Technology Review," *A Br. Introd. to Batter.*, no. September, pp. 1–33, 2010.
- [18] IEC, "Electrical Energy Storage," 2011.
- [19] A. Colthorpe, "NGK's NAS sodium sulfur grid-scale batteries in depth E," *Energy Storage News*, 2017.

- [20] C.-H. Dustmann and A. Bito, "SECONDARY BATTERIES – HIGH TEMPERATURE SYSTEMS | Safety," in *Encyclopedia of Electrochemical Power Sources*, 2009, pp. 324–333.
- [21] R. C. Galloway, -Mes-Dea Sa, and C.-H. Dustmann, "ZEBRA Battery -Material Cost Availability and Recycling," vol. 1519, 2003.
- [22] H.-J. Chang, N. L. Canfield, K. Jung, V. L. Sprenkle, and G. Li, "Advanced Na-NiCl<sub>2</sub> Battery Using Nickel-Coated Graphite with Core– Shell Microarchitecture."
- [23] Fred Lambert, "Breakdown of raw materials in Tesla's batteries and possible bottlenecks | Electrek," *Electrek*, 2016. [Online]. Available: <https://electrek.co/2016/11/01/breakdown-raw-materials-tesla-batteries-possible-bottleneck/>. [Accessed: 12-Sep-2017].
- [24] S. Longo, V. Antonucci, M. Cellura, and M. Ferraro, "Life cycle assessment of storage systems: the case study of a sodium/nickel chloride battery," *J. Clean. Prod.*, vol. 85, pp. 337–346, 2014.
- [25] O. Teller et al., "Joint EASE/EERA Recommendations for a European Energy Storage Technology Development Roadmap Towards 2030," 2013.
- [26] X. Lu et al., "Liquid-metal electrode to enable ultra-low temperature sodium–beta alumina batteries for renewable energy storage," *Nat. Commun.*, vol. 5, pp. 5884–5901, Aug. 2014.
- [27] J. E. Al Carlsson, "ETRI 2014 - Energy Technology Reference Indicator projections for 2010-2050," 2014.
- [28] G. Huff et al., "DOE/EPRI 2013 electricity storage handbook in collaboration with NRECA," *Rep. SAND2013- ...*, no. July, p. 340, 2013.
- [29] B. Zakeri and S. Syri, "Electrical energy storage systems: A comparative life cycle cost analysis," *Renew. Sustain. Energy Rev.*, vol. 42, pp. 569–596, 2015.
- [30] K.-P. Kairies, "Battery storage technology improvements and cost reductions to 2030: A Deep Dive," *Int. Renew. Energy Agency Work.*, 2017.
- [31] IRENA, "Electricity storage and renewables: Costs and markets to 2030 - Cost-of-service tool. Version 1.0," 2017.
- [32] P. Ralon, M. Taylor, and A. Ilas, *Electricity storage and renewables: costs and market to 2030*, no. October. 2017.
- [33] L. Sigrist and E. Peirano, "E-Highway2050: Battery Storage Technology Assessment," in *WP3 workshop April 15th*, 2014.
- [34] J. Garche and C. K. Dyer, *Encyclopedia of electrochemical power sources*. Academic Press, 2009.
- [35] H. Chen, T. N. Cong, W. Yang, C. Tan, Y. Li, and Y. Ding, "Progress in electrical energy storage system: A critical review," *Prog. Nat. Sci.*, vol. 19, no. 3, pp. 291–312, 2009.